



# SEL-487E-5 Transformer Protection Relay

## Transformer Protection Relay With Sampled Values or TiDL Technology



### Key Features and Benefits


The SEL-487E-5 Transformer Protection Relay With Sampled Values or TiDL<sup>®</sup> Technology provides three-phase differential protection for transformer applications with as many as seven three-phase restraint current inputs. A second three-phase differential element is also supported for busbar protection.

- ▶ **High-Speed Differential Protection.** A two-stage slope adapts automatically to external fault conditions, providing fast, sensitive, dependable, and secure differential protection, even for CT saturation and heavily distorted waveforms. Two independent differential zones are available, one of which supports additional features that accommodate transformer differential protection.
- ▶ **Inrush and Overexcitation Detection.** Combined harmonic blocking and restraint features provide maximum security during transformer magnetizing inrush conditions. Waveshape-based inrush detection addresses inrush conditions that contain low second and fourth harmonic content.
- ▶ **Turn-to-Turn Winding Fault Protection.** Innovative negative-sequence differential elements provide transformer windings protection from as little as two percent turn-to-turn winding faults.
- ▶ **Restricted Earth Fault Protection.** Three independent REF elements provide sensitive protection for faults close to the winding neutral in grounded wye-connected transformers.
- ▶ **Combined Overcurrent.** Configurations exist for a wide variety of transformer applications. Use the combined overcurrent elements for transformers connected to ring-bus or breaker and one-half systems. This feature mathematically sums two terminal current inputs to form a single operating quantity.
- ▶ **Distance Protection.** Mho or quadrilateral characteristics protect transformers and transmission lines with four zones of phase distance and ground distance elements. Line harmonic blocking, load-encroachment, coupling capacitor voltage transformer (CCVT) detection, and out-of-step blocking logic add security to your distance protection scheme.
- ▶ **Fault Locator.** Efficiently dispatch line crews to quickly isolate line problems and restore service faster. An independent fault locator is available for each current terminal.

- ▶ **Transformer and Feeder Backup Protection.** Adaptive time-overcurrent elements with selectable operating quantity, programmable pickup, and time-delay settings provide transformer and feeder backup protection.
- ▶ **Second-Harmonic Blocking for Feeder Protection:** You can order the second-harmonic blocking option to secure feeder protection elements during inrush conditions. This option provides second-harmonic calculations for each individual terminal in addition to transformer differential harmonic blocking elements.
- ▶ **Reclosing Control.** You can incorporate programmable three-pole trip and reclose of as many as seven independent breakers into an integrated substation control system.
- ▶ **Reverse Power Flow and Overload Condition Protection.** The SEL-487E directional real- and reactive-power elements guard against reverse power flow and overload conditions.
- ▶ **Synchronism Check.** Synchronism check can prevent circuit breakers from closing if the corresponding phases across the open circuit breaker are excessively out of phase, magnitude, or frequency. The synchronism-check function has a user-selectable synchronizing voltage source and incorporates slip frequency, two levels of maximum angle difference, and breaker close time into the closing decision.
- ▶ **Input/Output Scaling.** The SEL-2600 RTD Module provides as many as 12 temperature inputs, and the SEL-2505/SEL-2506 Remote I/O Modules provide a scalable number of discrete I/O points.
- ▶ **Two CT Input Levels.** Selectable 1 A or 5 A nominal secondary input levels are available for any three-phase winding input.
- ▶ **Large CT Mismatch Ratio.** The relay can accommodate CT ratio mismatch as great as 35:1.
- ▶ **Breaker Failure.** High-speed (less than one cycle) open-pole detection logic reduces coordination times for critical breaker failure applications. Apply the relay to supply breaker failure protection for all supported breakers. Logic for breaker failure retrip and initiation of transfer tripping is included.
- ▶ **IEC 60255-149 Compliant Thermal Model.** The relay can provide a configurable thermal model for the protection of a wide variety of devices. This function can activate a control action or issue an alarm or trip when equipment overheats as a result of adverse operation conditions. A separate resistance temperature detector (RTD) module is required for this application.
- ▶ **Ethernet Access.** The optional Ethernet card grants access to all relay functions. Use IEC 61850 Manufacturing Message Specification (MMS) or DNP3 protocol directly to interconnect with automation systems. You can also connect to DNP3 networks through a communications processor. Use File Transfer Protocol (FTP) for high-speed data collection. Connect to substation or corporate LANs to transmit synchrophasors by using TCP or UDP internet protocols.
- ▶ **Serial Data Communication.** The relay can communicate serial data through SEL ASCII, SEL Fast Message, SEL Fast Operate, MIRRORED BITS<sup>®</sup>, and DNP3 protocols. Synchrophasor data are provided in either SEL Fast Message or IEEE C37.118 format.
- ▶ **Automation.** The enhanced automation features include programmable elements for local control, remote control, protection latching, and automation latching. Local metering on the large front-panel LCD eliminates the need for separate panel meters. Serial and Ethernet links efficiently transmit key information, including metering data, protection element and control I/O status, synchrophasor data, IEC 61850 GOOSE messages, Sequential Events Recorder (SER) reports, breaker monitoring, relay summary event reports, and time synchronization. Apply expanded SELOGIC<sup>®</sup> control equations with math and comparison functions in control applications. Incorporate as many as 1000 lines of automation logic to accelerate and improve control actions.
- ▶ **Synchrophasors.** You can make informed load dispatch decisions based on actual real-time phasor measurements from relays across your power system. Record streaming synchrophasor data from the relay for system-wide disturbance recording. Control the power system by using local and remote synchrophasor data.
- ▶ **Breaker and Battery Monitoring.** You can schedule breaker maintenance when accumulated breaker duty (independently monitored for each pole) indicates possible excess contact wear. The relay records electrical and mechanical operating times for both the last operation and the average of operations since function reset. Alarm contacts provide notification of substation battery voltage problems (as many as two independent battery monitors in some SEL-400 series relays) even if voltage is low only during trip or close operations.
- ▶ **Digital Secondary Systems (DSS) Technologies.** You can order the relay as an SV publisher, an SV subscriber, or a TiDL relay. DSS capable relays receive current and voltage information that is published by remote merging units instead of standard PT and CT inputs. DSS technologies reduce copper cable lengths and associated installation labor costs and improve the overall safety of the substation.
- ▶ **IEC 61850 SV Subscriber.** The SV subscriber relay can subscribe to current and voltage information that is published by as many as 24 SV merging units.

- ▶ **IEC 61850 SV Publisher.** The SV publisher can publish current and voltage information that is provided to subscribing remote relays. Full backup protection is supported in the merging unit in case of a loss of communications with subscribing relays.
- ▶ **TiDL Relay.** The TiDL relay can receive current and voltage information from as many as eight SEL-TMUs (TiDL Merging Units) over direct point-to-point fiber-optic connections. The TiDL relay automatically synchronizes data collection, alleviating the need or impact of an external clock on protection.
- ▶ **Selective Protection Disabling.** The subscriber or TiDL relay provides selective disabling of protection functions by using hard-coded logic or available torque-control equations in case of a loss of communications between your merging unit and relay that results in the loss of relevant analog data.
- ▶ **Current Summation.** The relay can combine multiple currents from remote merging units to simplify external wiring.
- ▶ **Six Independent Settings Groups.** The relay includes group logic to adjust settings for different operating conditions, such as station maintenance, seasonal operations, emergency contingencies, loading, source changes, and adjacent relay settings changes. Select the active group settings by control input, command, or other programmable conditions.
- ▶ **Software-Invertible Polarities.** Inverting individual or grouped CT and PT polarities allows you to account for field wiring or zones of protection changes. CEV files and all metering and protection logic use the inverted polarities, whereas COMTRADE event reports do not use inverted polarities but rather record signals as applied to the relay.
- ▶ **Flexible AC Input Card Configurations.** When ordered with two ac input cards, the relay supports as many as 7 three-phase current terminals (S, T, U, W, X, Y, Z) and 2 three-phase voltage terminals (V, Z), where Terminal Z can be ordered as either a voltage or current terminal. When ordered with a single ac input card, the relay supports 3 three-phase current terminals (W, X, Y) and 1 three-phase voltage terminal (Z).
- ▶ **Parallel Redundancy Protocol (PRP).** PRP provides seamless recovery from any single Ethernet network failure. The Ethernet network and all traffic are fully duplicated with both copies operating in parallel.
- ▶ **High-Availability Seamless Redundancy (HSR) Protocol.** HSR provides seamless recovery from any single Ethernet network failure with this protocol, in accordance with IEC 62439-3. All HSR compatible devices are connected in a ring and the traffic is fully duplicated and sent in both clockwise and counterclockwise directions around the ring.
- ▶ **IEC 61850 Operating Modes.** The relay supports IEC 61850 standard operating modes such as Test, Blocked, On, and Off.
- ▶ **IEEE 1588, Precision Time Protocol (PTP).** PTP provides high-accuracy timing over an Ethernet network.
- ▶ **Digital Relay-to-Relay Communications.** MIRRORRED BITS communications can monitor internal element conditions between bays within a station, or between stations, using SEL fiber-optic transceivers. Send digital, analog, and virtual terminal data over the same MIRRORRED BITS channel.
- ▶ **Sequential Events Recorder (SER).** The SER records the last 1000 events, including setting changes, startups, and selectable logic elements.
- ▶ **Oscillography and Event Reporting.** The relay records voltages, currents, and internal logic points at a sampling rate as fast as 8 kHz. Offline phasor and harmonic-analysis features allow investigation of bay and system performance. Time-tag binary COMTRADE event reports with high-accuracy time stamping for accuracy better than 10  $\mu$ s.
- ▶ **Digitally Signed Upgrades.** The relay supports upgrading the relay firmware with a digitally signed upgrade file. The digitally signed portion of the upgrade file helps ensure firmware and device authenticity after it is sent over a serial or Ethernet connection.
- ▶ **Increased Security.** The relay divides control and settings into seven relay access levels; the relay has separate breaker, protection, automation, and output access levels, among others. Set unique passwords for each access level.
- ▶ **Rules-Based Settings Editor.** You can communicate with and set the relay by using an ASCII terminal or use Grid Configurator to configure the relay and analyze fault records with relay element response. Use as many as 200 aliases to rename any digital or analog quantity in the relay.

# Functional Overview

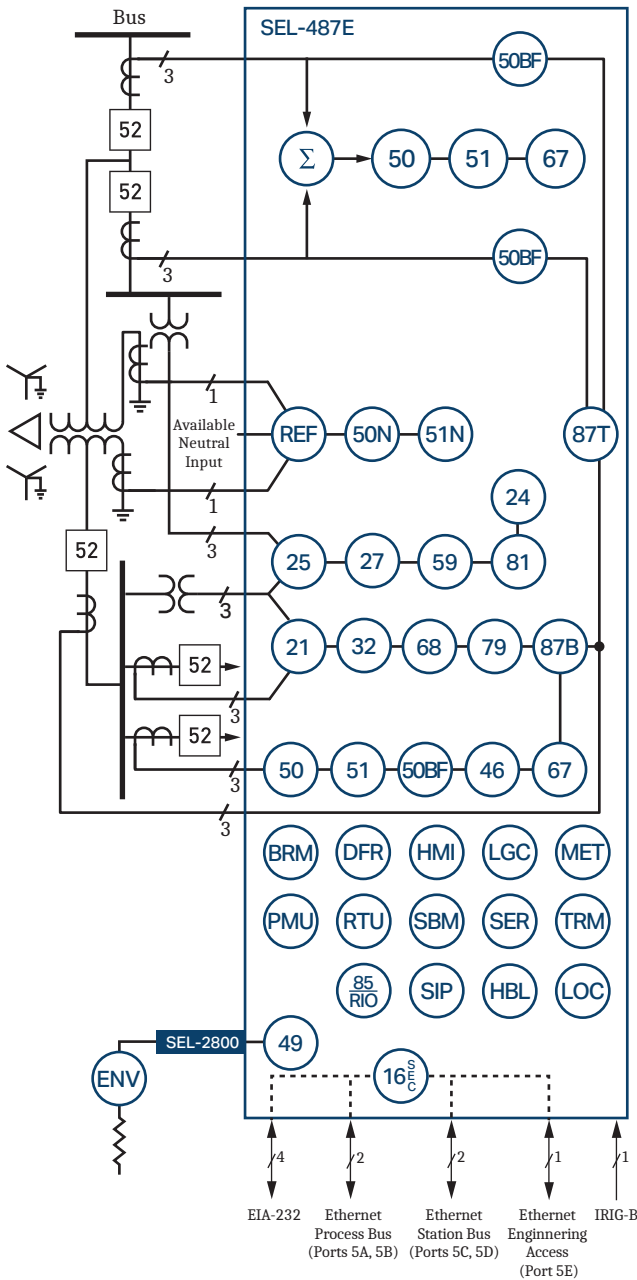

### ANSI NUMBERS/ACRONYMS AND FUNCTIONS


|        |   |
|--------|---|
| 16 SEC | Access Security (Serial, Ethernet)                                    |
| 21*    | Phase and Ground Distance   |
| 24     | Volts/Hertz   |
| 25     | Synchronism Check   |
| 27     | Undervoltage  |
| 32     | Directional Power   |
| 46     | Current Unbalance   |
| 49     | IEEE C59.71 and IEC 60255-Compliant Thermal Model                     |
| 50BF   | Dual Breaker Failure Overcurrent                                      |
| 50N    | Neutral Overcurrent   |
| 50     | Overcurrent (Phase, Zero-Sequence, and Negative-Sequence)             |
| 51N    | Neutral Time-Overcurrent  |
| 51     | Time-Overcurrent (Phase, Zero-Sequence, and Negative-Sequence)        |
| 59     | Overvoltage   |
| 67     | Directional Overcurrent (Phase, Zero-Sequence, and Negative-Sequence) |
| 68*    | Out-of-Step Block   |
| 79*    | Autoreclosing   |
| 81     | Over- and Underfrequency  |
| 85 RIO | SEL MIRRORING BITS Communications                                     |
| 87T    | Transformer Differential (Unrestrained, Restrained, Neg. Seq.)        |
| 87B*   | Bus Differential (Restrained)   |

### ADDITIONAL FUNCTIONS

|     |                                |
|-----|--------------------------------|
| BRM | Breaker Wear Monitor           |
| DFR | Event Reports                  |
| ENV | SEL-2600 RTD Module*           |
| HBL | Harmonic Blocking              |
| HMI | Operator Interface             |
| LDP | Load Data Profiling            |
| LGC | SELogic Control Equations      |
| LOC | Fault Locator                  |
| MET | High-Accuracy Metering         |
| PMU | Synchrophasors                 |
| REF | Restricted Earth Fault         |
| RTU | Remote Terminal Unit           |
| SBM | Station Battery Monitor        |
| SER | Sequential Events Recorder     |
| SIP | Software-Invertible Polarities |
| TRM | Transformer Monitor            |

\* Optional Feature  
 Note: Both copper and fiber-optic Ethernet ports are available.

Figure 1 SEL-487E-5 SV Publisher Functional Overview

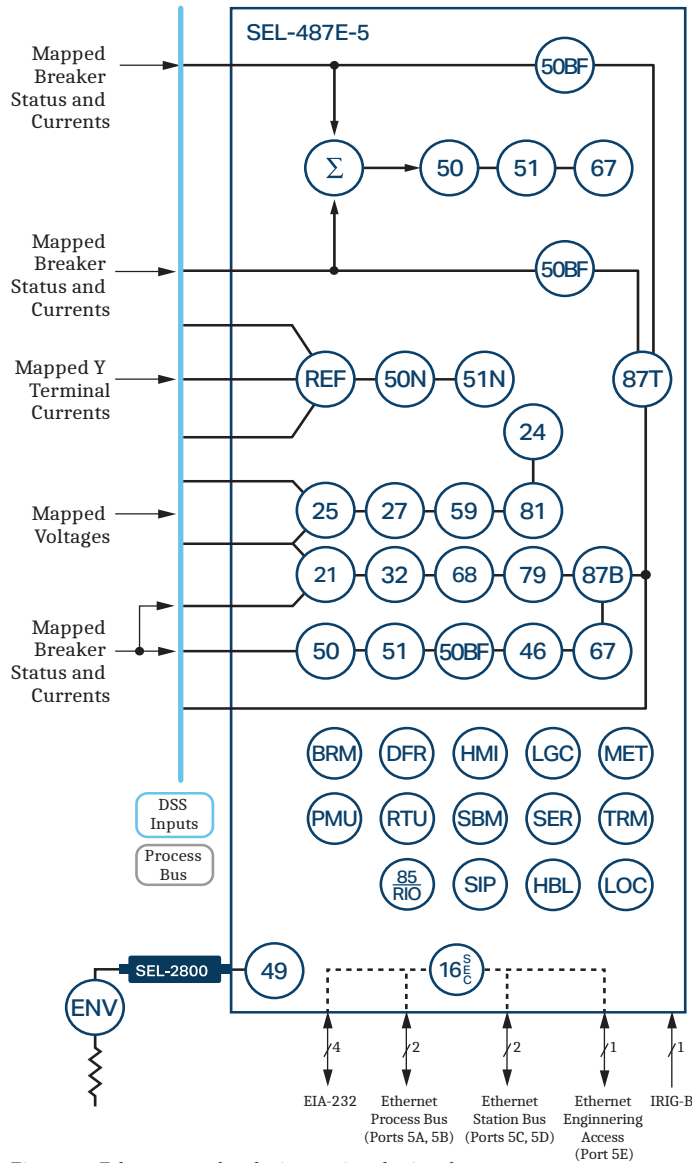

ANSI NUMBERS / ACRONYMS AND FUNCTIONS

|        |   |
|--------|---|
| 16 SEC | Access Security (Serial, Ethernet)                                    |
| 21*    | Phase and Ground Distance   |
| 24     | Volts/Hertz   |
| 25     | Synchronism Check   |
| 27     | Undervoltage  |
| 32     | Directional Power   |
| 46     | Current Unbalance   |
| 49     | IEEE C59.71 and IEC 60255-Compliant Thermal Model                     |
| 50BF   | Dual Breaker Failure Overcurrent                                      |
| 50N    | Neutral Overcurrent   |
| 50     | Overcurrent (Phase, Zero-Sequence, and Negative-Sequence)             |
| 51N    | Neutral Time-Overcurrent  |
| 51     | Time-Overcurrent (Phase, Zero-Sequence, and Negative-Sequence)        |
| 59     | Overvoltage   |
| 67     | Directional Overcurrent (Phase, Zero-Sequence, and Negative-Sequence) |
| 68*    | Out-of-Step Block   |
| 79*    | Autoreclosing   |
| 81     | Over- and Underfrequency  |
| 85 RIO | SEL MIRRORING BITS Communications                                     |
| 87T    | Transformer Differential (Unrestrained, Restrained, Neg. Seq.)        |
| 87B*   | Bus Differential (Restrained)   |

ADDITIONAL FUNCTIONS

|     |                                |
|-----|--------------------------------|
| BRM | Breaker Wear Monitor           |
| DFR | Event Reports                  |
| ENV | SEL-2600 RTD Module*           |
| HBL | Harmonic Blocking              |
| HMI | Operator Interface             |
| LDP | Load Data Profiling            |
| LGC | SELogic Control Equations      |
| LOC | Fault Locator                  |
| MET | High-Accuracy Metering         |
| PMU | Synchphasors                   |
| REF | Restricted Earth Fault         |
| RTU | Remote Terminal Unit           |
| SBM | Station Battery Monitor        |
| SER | Sequential Events Recorder     |
| SIP | Software-Invertible Polarities |
| TRM | Transformer Monitor            |

\* Optional Feature  
Note: Both copper and fiber-optic Ethernet ports are available.

Five-port Ethernet card ordering option depicted.

Figure 2 SEL-487E-5 SV Subscriber or TiDL Relay Functional Overview

SV

The SEL-487E SV Subscriber subscribes to data that are published from a merging unit, such as the SEL-487E SV Publisher or SEL-401 Protection, Automation, and Control Merging Unit. The SEL-487E SV Publisher can be used as a conventional hardwired relay or to provide voltage and current information to other relays over the process bus. The data can be synchronized using Precision Time Protocol (PTP).

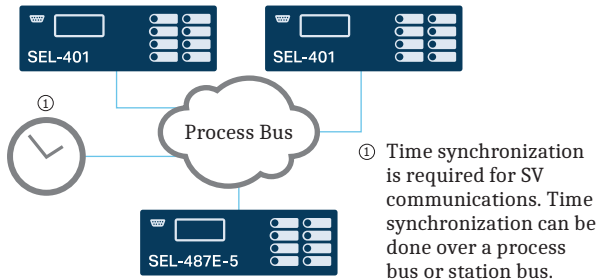


Figure 3 SV Network

## TiDL

The SEL-487E-5 TiDL receives and automatically synchronizes data streams from connected and commissioned SEL-TMU devices. The TiDL technology does not require an external time source for local relay protection functions.




Figure 4 SEL TiDL System

## Protection Features

### Differential Element

In the SEL-487E, the phase differential elements employ operate ( $IOP_n$ , where  $n = A, B, C$ ) and restraint ( $IRTN$ ) quantities that the relay calculates from the selected winding input currents. Figure 5 shows the characteristic of the filtered differential element as a straight line through the origin of the form:

$$IOPA (IRTA) = SLP_c \cdot IRTA$$

For operating quantities (IOPA) exceeding the threshold level O87P and falling in the operate region of Figure 5, the filtered differential element issues an output. There are two slope settings, namely Slope 1 (SLP1) and Slope 2 (SLP2). Slope 1 is effective during normal operating conditions, and Slope 2 is effective when the fault detection logic detects an external fault condition. In general, the relay uses filtered and unfiltered (instantaneous) analog quantities in two separate algorithms to form the differential element. The adaptive differential element responds to most internal fault conditions in less than one and a half cycles.

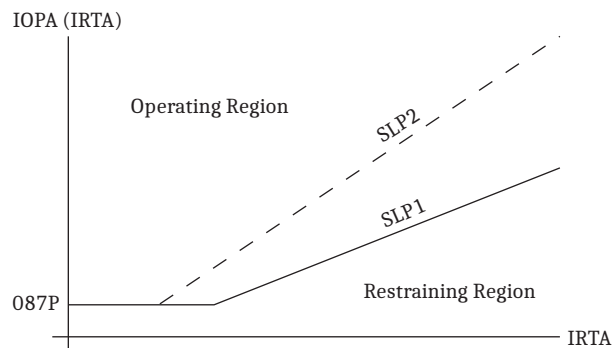


Figure 5 Adaptive Slope Differential Characteristics

The differential element includes one harmonic blocking and one harmonic restraint element; select either one or both of them. The combination of harmonic blocking and restraint elements provides optimum operating speed and security during inrush conditions. Waveshape-based inrush detection addresses inrush conditions that contain low second- and fourth-harmonic content. Fast subcycle

external fault detection supervision adds security during external faults with CT saturation. The harmonic blocking element includes common or independent second- and fourth-harmonic blocking and independent fifth-harmonic blocking.

### Negative-Sequence Differential Element

Turn-to-turn internal faults on transformer windings may not cause enough additional current flow at the transformer bushing CTs to assert a phase-current differential element, but left undetected can be very destructive to the transformer. When turn-to-turn faults occur, the autotransformer effect on the shorted section of winding causes a very large current flow relative to the shorted windings but small compared to the remainder of the unaffected winding. To detect these destructive internal faults, the SEL-487E uses a sensitive negative-sequence current differential element. This element detects the phase-current unbalance caused by internal fault by using a single-slope characteristic. Using negative-sequence restraint, the differential element is not affected by fluctuating negative-sequence quantities on the power system and is able to detect turn-to-turn short-circuit conditions in as little as two percent of the total transformer winding. External fault detection logic from the phase-differential element is used to block the negative-sequence differential element, keeping it secure during external faults and inrush conditions when CT saturation may occur.

### V/Hz Elements

The SEL-487E provides comprehensive V/Hz protection (24). The SEL-487E maintains frequency tracking from 40.0 to 65.0 Hz when voltage inputs are provided to the relay. Two independent V/Hz curves with definite and custom 20-point curve characteristics can be selected using programmable logic. Use the two independent V/Hz curves for loaded versus unloaded transformer protection, allowing maximum sensitivity to overexcitation conditions during all modes of transformer operation. The single V/Hz element in the relay can be assigned to either set of three-phase voltage inputs.

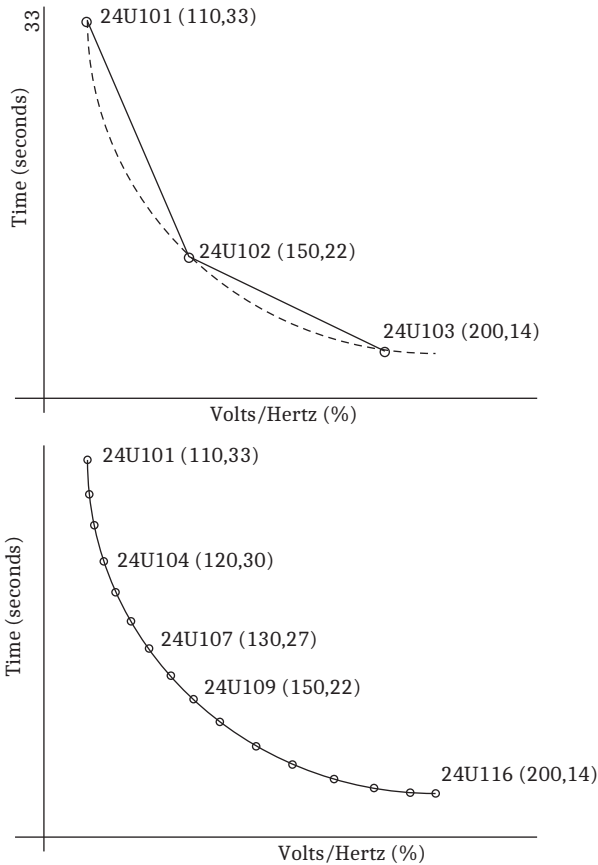


Figure 6 Volts/Hertz Curve Diagrams

## Distance Elements

The SEL-487E protects transformers and transmission lines with as many as four zones of phase distance and ground distance elements with either mho or quadrilateral characteristics. You can set all four zones independently in the forward or reverse direction. The distance elements are secured with load-encroachment logic, which prevents operation of the phase distance elements under high load conditions; line harmonic-blocking logic, which prevents element operation when a transformer in the protection zone is being energized or experiencing an overexcitation condition; and CCVT transient detection, which blocks the distance elements when there is transient on the system with CCVTs that may cause the distance element to overreach. All mho elements use positive-sequence memory polarization that expands the operating characteristic in proportion to the source impedance. This provides dependable and secure operation for close-in faults. The quadrilateral phase and ground distance elements provide improved fault and arc resistance coverage, including application on short lines.

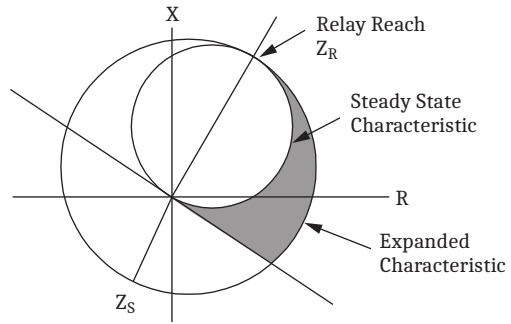


Figure 7 Mho Characteristics

## Out-of-Step Detection

The SEL-487E supports out-of-step detection by using timers and blinders that are set outside any of the distance elements. A power swing is declared when an impedance locus travels through the blinders slower than a preset time. This logic blocks the distance elements in case of a stable power swing.

## Adaptive Time-Overcurrent Elements (51S)

The relay supports 21 adaptive time-overcurrent elements with selectable operate quantity and programmable time-delay and pickup levels. Choose from the ten time-overcurrent curves shown in Table 1 (five IEC and five U.S.). Each torque-controlled time-overcurrent element has two reset characteristics. One choice resets the elements if current drops below pickup for one cycle while the other choice emulates the reset characteristic of an electromechanical induction disk relay.

Table 1 Supported Time-Overcurrent Curves

| U.S. Curves             | IEC Curves              |
|-------------------------|-------------------------|
| U1 (moderately inverse) | C1 (standard inverse)   |
| U2 (inverse)            | C2 (very inverse)       |
| U3 (very inverse)       | C3 (extremely inverse)  |
| U4 (extremely inverse)  | C4 (long-time inverse)  |
| U5 (short-time inverse) | C5 (short-time inverse) |

The adaptive time-overcurrent elements in the SEL-487E allow the selection of a wide variety of current sources as operate quantities to the element. Select the time-overcurrent element operate quantity from any one of the following current sources:

- Filtered phase currents:  $I_{AmFM}$ ,  $I_{BmFM}$ ,  $I_{CmFM}$
- Maximum filtered phase current:  $I_{MAXmF}$
- Combined filtered phase currents (any two terminals):  $I_{AmmFM}$ ,  $I_{BmmFM}$ ,  $I_{CmmFM}$

- Maximum filtered combined phase current:  $IMAXmmF$
- Filtered positive-, negative-, and zero-sequence:  $I1mFM$ ,  $3I2mFM$ ,  $3I0mFM$ ,  $I1mmM$ ,  $3I2mmM$ ,  $3I0mmM$
- RMS currents:  $IARMS$ ,  $IBmRMS$ ,  $ICmRMS$ ,  $IMAXmR$ ,  $IAmRMS$ ,  $IBmmRMS$ ,  $ICmmRMS$ ,  $IMAXmmR$

where:

$m$  = Relay current terminals S, T, U, W, X, Y, Z

$mm$  = Relay current terminals ST, TU, UW, WX

F = Filtered

M = Magnitude

MAX = Maximum magnitude A-, B-, C-phase currents

In addition to the selectable operate quantity, the 51S element time-delay and pickup level inputs are SELOGIC-programmable settings. This flexibility allows these inputs to be set to fixed numerical values to operate as standard time overcurrent elements, or the pickup and time-dial settings can be programmed as SELOGIC math variables. Programming the time-delay and pickup levels as math variables allows the numeric value of the pickup and time-delay settings to change based on system conditions without the added delay of having to change relay setting groups. For example, change pickup and time-delay settings dynamically in a parallel transformer application based upon single or parallel transformer configurations. Another example would be changing feeder time-overcurrent element pickup and coordination delays based upon distributed generation being connected downstream of a transformer.

## REF Protection

Apply the REF protection feature to provide sensitive detection of internal ground faults on grounded wye-connected transformer windings and autotransformers. Use single-phase neutral current inputs for providing neutral CT operating current for as many as three windings. Polarizing current is derived from the residual current calculated for the corresponding protected winding. A directional element determines whether the fault is internal or external. Zero-sequence current thresholds supervise tripping. The relay can accommodate CT ratio mismatch as great as 35:1.

## Synchronism Check

Synchronism-check elements prevent circuit breakers from closing if the corresponding phases across the open circuit breaker are excessively out of phase, magnitude,

or frequency. The SEL-487E synchronism-check elements selectively close circuit breaker poles under the following criteria:

- The systems on both sides of the open circuit breaker are in phase (within a settable voltage angle difference).
- The voltages on both sides of the open circuit breaker are healthy (within a settable voltage magnitude window).

The synchronism-check function is available for each breaker with a user-selectable reference voltage. Each element has a user-selectable synchronizing voltage source and incorporates slip frequency, two levels of maximum angle difference, and breaker close time into the closing decision. Include the synchronism-check element outputs in the close SELOGIC control equations to program the relay to supervise circuit breaker closing.

## Current Unbalance Elements

The current unbalance logic uses the average terminal current to calculate the percentage difference between the individual phase current and the terminal median current. If the percentage difference is greater than the pickup value setting, the phase unbalance element is asserted. To prevent this element from asserting during fault conditions and after a terminal circuit breaker has closed, the final terminal unbalance output is supervised using current, fault detectors, and the open-phase detection logic.

## Fault Identification Logic

The purpose of the fault identification logic is to determine, on a per-terminal basis, which phase(s) was involved in a fault for which the transformer tripped. Determining the faulted phase is based on current inputs from wye-connected CTs. The logic does not determine the faulted phase for the following cases:

- Delta-connected CTs ( $CTCONm = D$ )
- Where only zero-sequence current flows through the relay terminal (no negative-sequence current and no positive-sequence current)


This logic identifies a sector in which a faulted phase(s) can appear by comparing the angle between the negative- and zero-sequence currents  $I2m$  and  $I0m$  ( $m = S, T, U, W, X, Y, Z$ ).

## Application Examples

The SEL-487E-5 offers comprehensive transformer protection features. Around the clock winding phase compensation simplifies setting the transformer protection elements. Harmonic restraint and blocking using second and fourth harmonic quantities provide secure operation during transformer energization, while maintaining sen-


sitivity for internal faults. Waveshape-based inrush detection addresses inrush conditions that contain low second and fourth harmonic content. For applications without voltage inputs (therefore no volts/hertz element), use the fifth harmonic monitoring to detect and alarm on over-excitation conditions.

The SEL-487E-5 can be used in applications with as many as seven three-phase current inputs. For the application shown in *Figure 8*, the SEL-487E subscribes to a total of four IEC 61850 9-2 SV streams from two different merging units. The SV publishers and subscriber for this application are connected through a process bus network switch. The same network switch is being used to communicate GOOSE messages and time-synchronize the system by using a PTP time source.

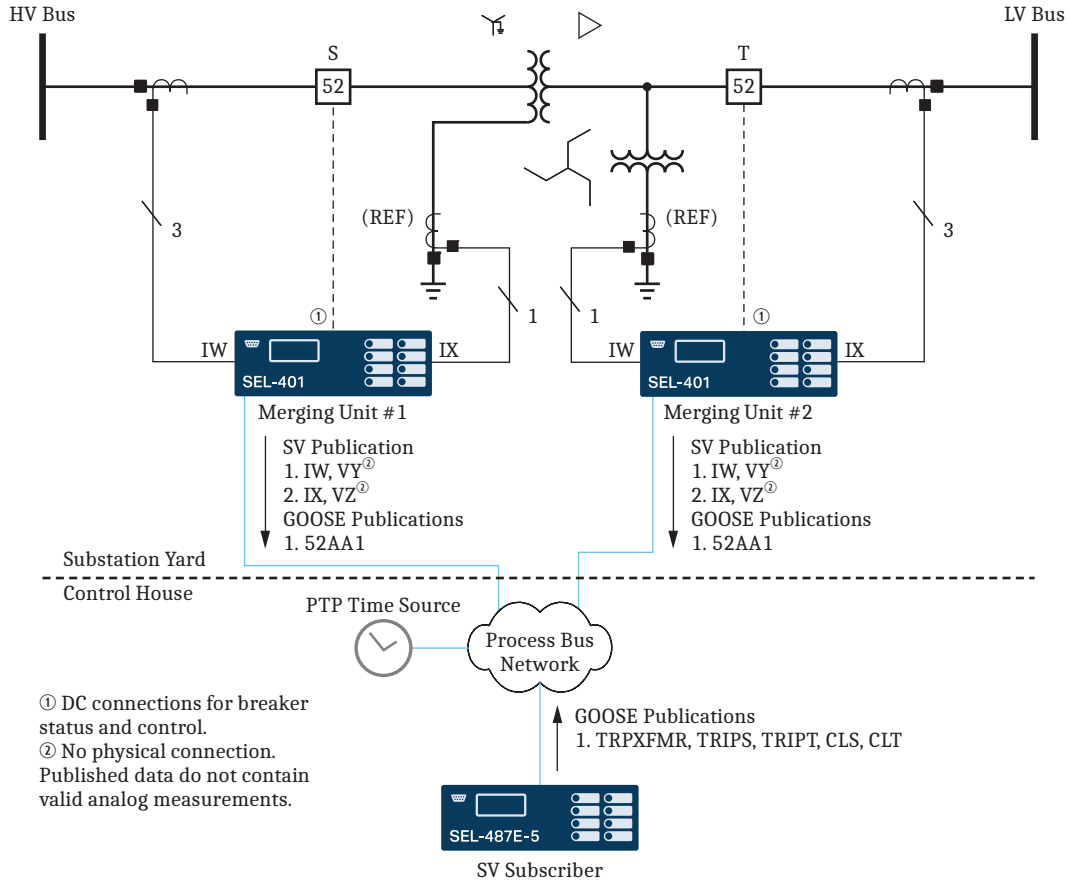

**Figure 8 Wye-Delta Transformer With Grounding Bank (SV)**

This application is also support in SEL-487E-5 TiDL or SV Publisher models. *Figure 8* shows the SEL-487E-5 SV Publisher used as a conventional hardwired relay.

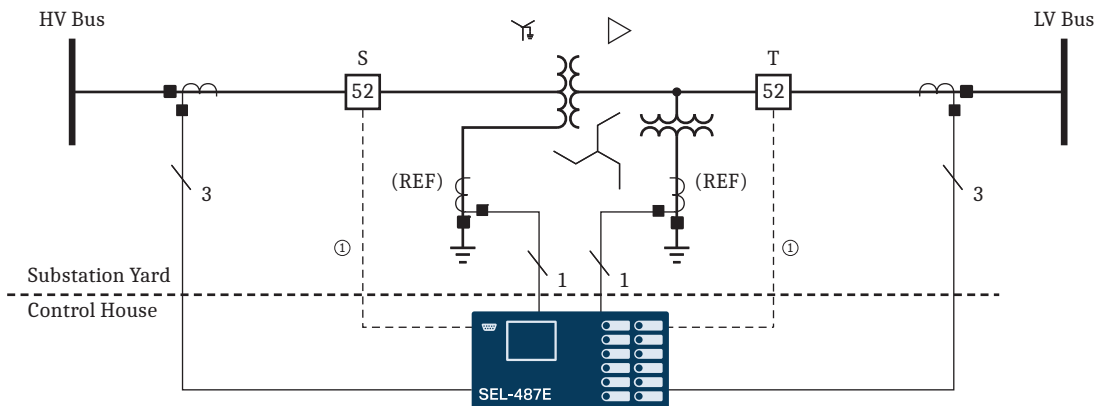

**Figure 9 Wye-Delta Transformer With Grounding Bank (Conventional)**

Use the negative-sequence differential element for sensitive detection of inter-turn faults within the transformer winding.


Phase, negative-, and zero-sequence overcurrent elements provide backup protection. Use breaker failure protection with subsidence detection to detect breaker failure and minimize system coordination times.

When voltage inputs are provided to the SEL-487E, voltage-based protection elements and frequency tracking are made available. Frequency tracking from 40.0 to 65.0 Hz over- and undervoltage, and frequency elements, along with volts/hertz elements provide the SEL-487E with accurate transformer protection for off-frequency events and overexcitation conditions.

Use the SEL-487E for complete protection of generator step-up (GSU) transformer applications. Use built-in thermal elements for monitoring both generator and transformer winding temperatures. Apply the volts/hertz

element with two level settings for overexcitation protection of loaded and unloaded generator operating conditions. Set the directional power elements to detect forward and reverse power flow conditions for monitoring and protection of the generator step-up (GSU) transformer in prime power, standby, base load, and peak shaving applications.

When the SEL-487E is applied to an autotransformer with both HV and LV busbars installed in a breaker-and-a-half configuration, the relay has enough current inputs for all CTs. In the SV version of the application shown in *Figure 10*, the SEL-487E-5 SV Subscriber Relay subscribes to a total of five IEC 61850 9-2 SV streams from three different merging units. The SV publishers and subscriber for this application are connected through a process bus network switch. The same network switch communicates GOOSE messaging and time-synchronizes the system by using a PTP time source.

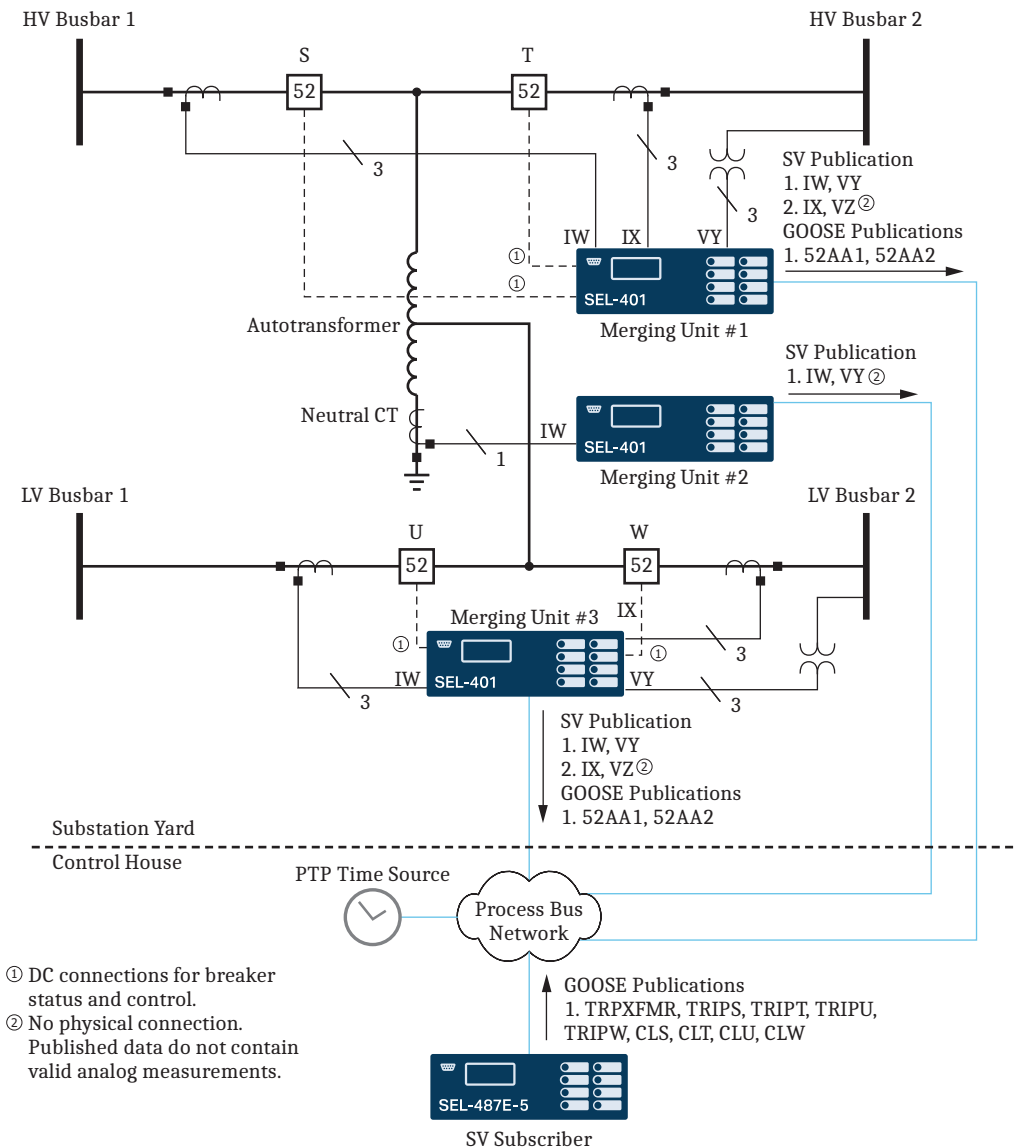


**Figure 10 Autotransformer Application**


## Distance Protection

The SEL-487E-5 simultaneously supports as many as four zones of phase and ground distance protection, using mho or quadrilateral characteristics. You can use expanded SELOGIC control equations to tailor the relay further to your particular application. The SEL-487E-5 distance elements are flexible enough to be used for transmission line or transformer winding protection, as shown in *Figure 11* and *Figure 12*.

In this example, the SEL-487E-5 uses one SEL TiDL Merging Unit (SEL-TMU) with 4 CT and 4 PT inputs. The CT and PT connections are wired to the SEL-TMU, and the SEL-TMU publishes these current and voltage values to the SEL-487E-5 TiDL relay over a fiber-optic connection by using SEL T-protocol. The SEL-487E-5 sends trip and control signals to the SEL-TMU over the same fiber-optic connection.

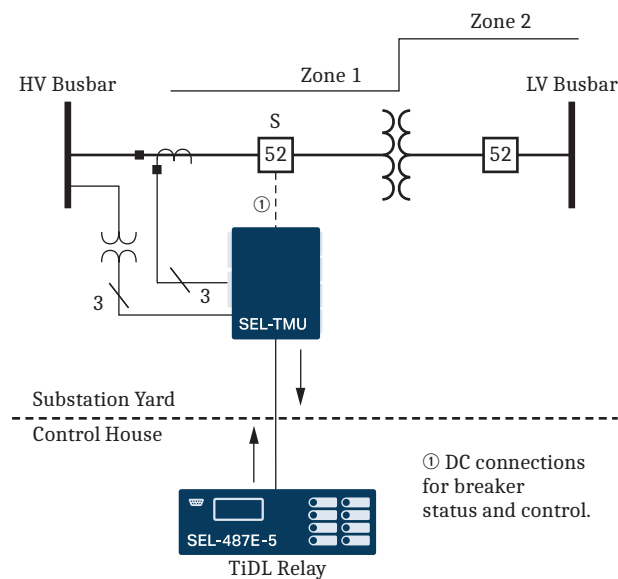


**Figure 11 Transformer Distance Application (TiDL)**

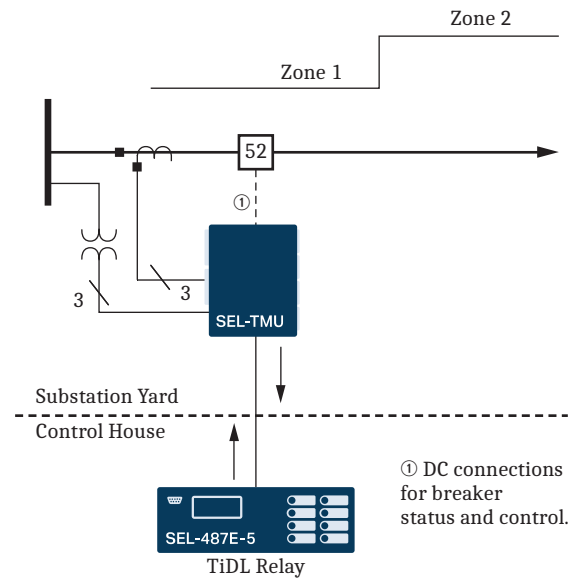

**Figure 12 Transmission Line Distance Application (TiDL)**

## Pad-Mounted Switchgear


Use the SEL-487E to protect pad-mounted switchgear with a single device for as many as seven terminals. Protect all terminals with comprehensive overcurrent elements and secure each terminal from in-rush conditions with second-harmonic blocking. Use dynamic voltage source selection to automatically switch voltage reference for each terminal.

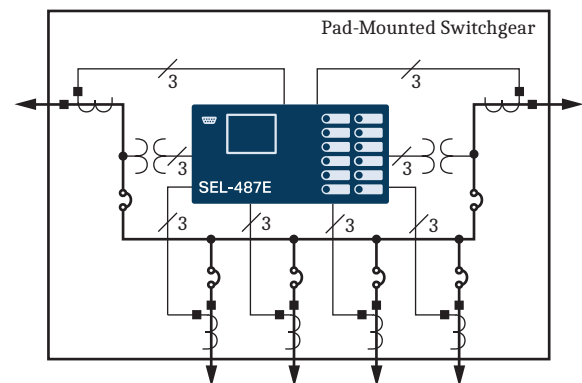

**Figure 13 Pad-Mounted Switchgear Application (Conventional)**

## Seven Terminal Feeder Protection

Use the seven three-phase current terminals on the SEL-487E to provide comprehensive feeder protection and control including overcurrent, reclosing, directional overcurrent, and breaker failure protection for seven feeders. A single SEL-487E can provide full feeder functionality of seven single function feeder relays thereby reducing the device count within the system. *Figure 14* shows a TiDL system that can be used for this application; however, an IEC 61850 9-2 system or conventional hardwired configuration is also supported.

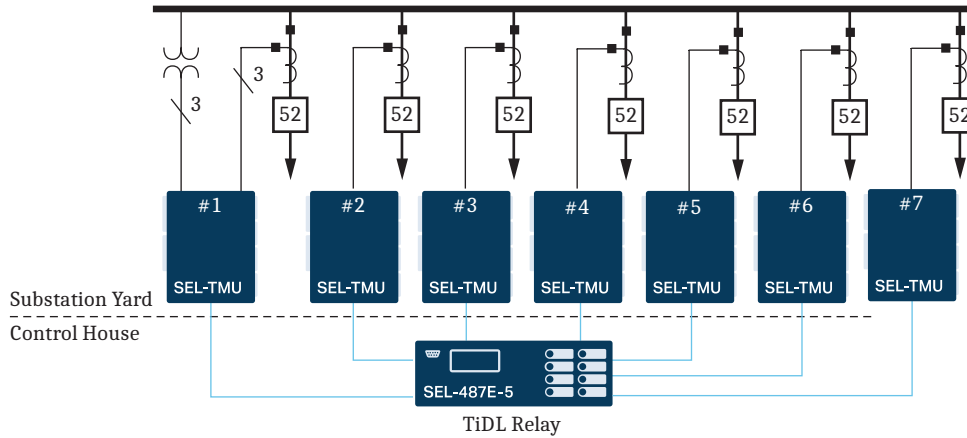

**Figure 14 Seven Terminal Feeder Application (TiDL)**

## Synchrophasor Applications

Use the SEL-487E as a station-wide synchrophasor measurement and recording device. The SEL-487E provides as many as 24 analog channels of synchrophasor data and can serve as a central phasor measurement unit in any substation or power generation facility. The SEL-487E can be configured to send five unique synchrophasor data streams over serial and Ethernet ports, measure voltage and current phase angle relationships at

generators and transformers, key source nodes for stability studies, and load angle measurements. Use the SEL-487E to store as much as 120 seconds of IEEE C37.118 binary synchrophasor data for all 24 analog channels at a recording rate of 60 messages per second. A SELOGIC control equation triggers storage of data. Capture data as necessary, and then store this information in SEL-487E nonvolatile memory. Use this capability to record system transients for comparison to state machine estimations.

## Additional Features


### Front-Panel Display

The LCD shows event, metering, setting, and relay self-test status information. The target LEDs display relay target information as shown in *Figure 15*.


The LCD is controlled by the navigation pushbuttons (*Figure 16*), automatic messages the relay generates, and user-programmed analog and digital display points. The rotating display scrolls through alarm points, display points, and metering screens. If none are active, the relay scrolls through displays of the fundamental and rms metering screens. Each display remains for a user-programmed time (1–15 s) before the display continues scrolling. Any message the relay generates because of an alarm condition takes precedence over the rotating display.

*Figure 15* and *Figure 16* show close-up views of the front panel of the SEL-487E. The front panel includes a 128 x 128 pixel, 3" x 3" LCD screen; LED target indicators; and pushbuttons with indicating LEDs for local control functions. The asserted and deasserted colors for the LEDs

are programmable. Configure any of the direct-acting pushbuttons to navigate directly to any HMI menu item for fast viewing of events, alarm points, display points, or the SER.

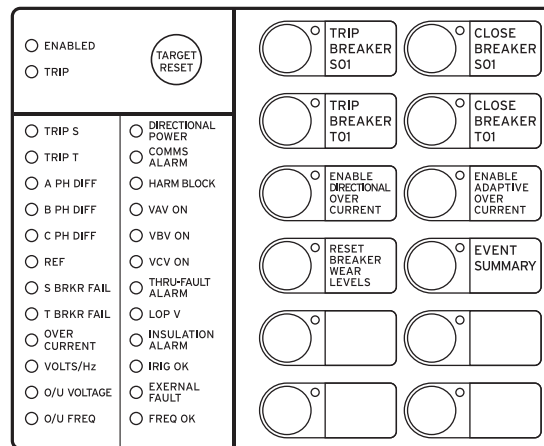

**Figure 15 Factory-Default Status and Trip Target LEDs (12 Pushbutton, 24 Target LED Option)**

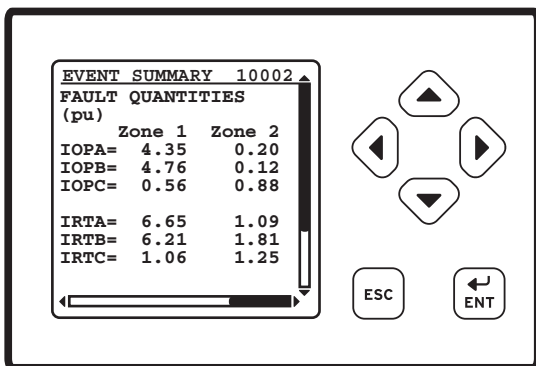

**Figure 16** Factory-Default Front-Panel Display and Pushbuttons

## Bay Control

The SEL-487E provides dynamic bay one-line diagrams on the front-panel screen with disconnect and breaker control capabilities for user-selectable bay types. You can download the Grid Configurator interface from [selinc.com](http://selinc.com) to obtain additional user-selectable bay types. The bay control can control as many as 20 disconnects and 7 breakers, depending on the one-line diagram selected. Operate disconnects and breakers with ASCII commands, SELOGIC control equations, Fast Operate Messages, and from the one-line diagram. The one-line diagram includes user-configurable apparatus labels and as many as six user-definable analog quantities.

## One-Line Bay Diagrams


The SEL-487E offers a variety of preconfigured one-line diagrams for common bus configurations. Once you select a one-line diagram, you can customize the names for all of the breakers, disconnect switches, and buses. Most one-line diagrams contain analog display points. You can set these display points to any of the available analog quantities with labels, units, and scaling. The SEL-487E updates these values along with the breakers and switch position in real time to give instant status and complete control of a bay. The following diagrams demonstrate some of the preconfigured bay arrangements available in the SEL-487E.

Programmable interlocks help prevent operators from incorrectly opening or closing switches or breakers. The SEL-487E not only prevents operators from making an incorrect control decision, but it can notify and/or alarm upon initiation of an incorrect operation.


## Circuit Breaker Operations From the Front Panel

Figure 17–Figure 20 are examples of some of the selectable one-line diagrams in the SEL-487E. Select the one-line diagram from the Bay settings. Additional settings for defining labels and analog quantities are also found in the Bay settings. One-line diagrams are composed of the following:


- Bay names and bay labels
- Busbar and busbar labels
- Breaker and breaker labels
- Disconnect switches and disconnect switch labels
- Analog display points

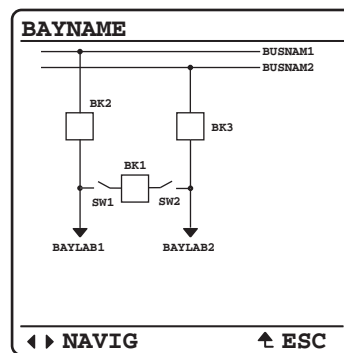

**Figure 17** Breaker-and-a-Half

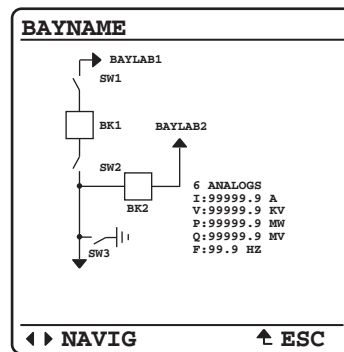

**Figure 18** Ring Bus With Ground Switch

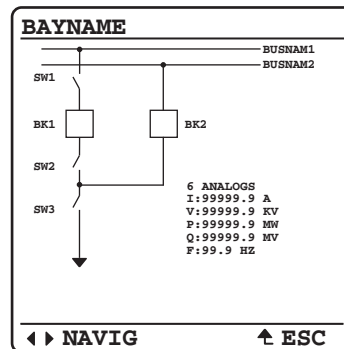

**Figure 19** Double Bus/Double Breaker

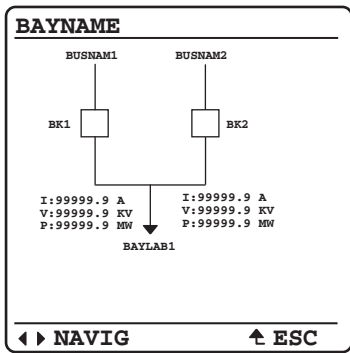


Figure 20 Source Transfer Bus

Figure 21 shows the breaker control screens available when the ENT pushbutton is pressed with the circuit breaker highlighted as shown in Figure 21(a).

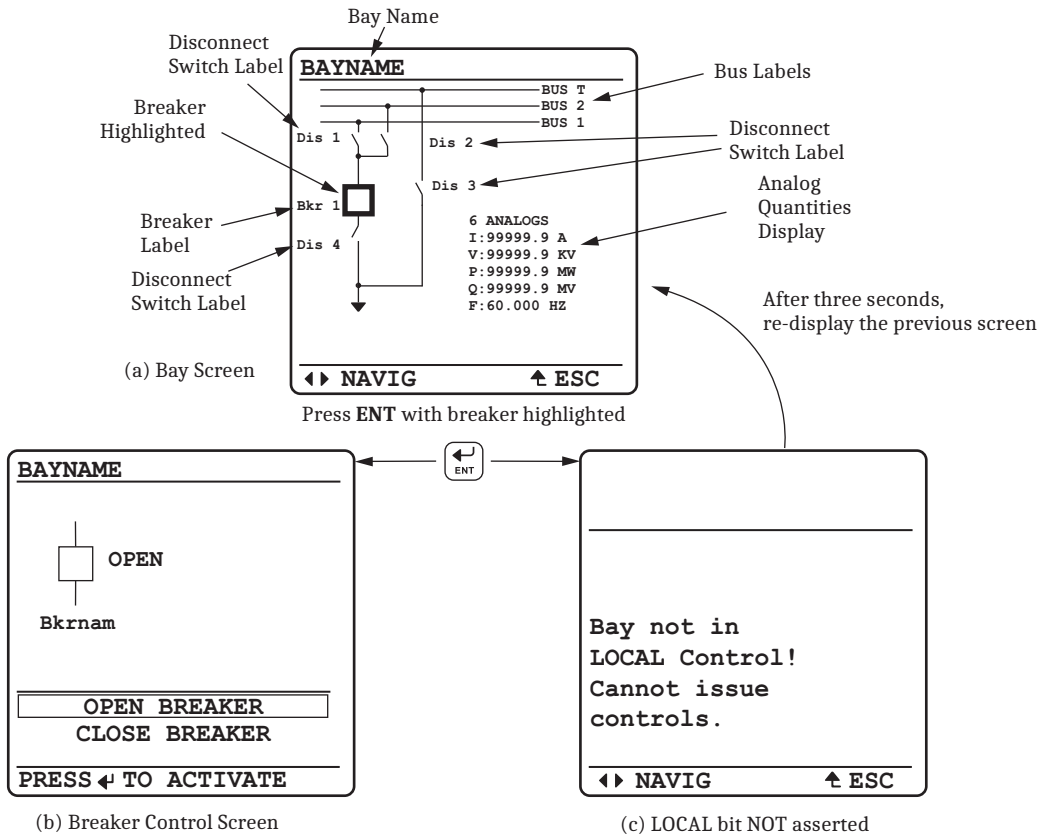


Figure 21 Screens for Circuit Breaker Selection

## Rack-Type Breakers Mosaics

The SEL-487E supports the display of rack-type (also referred to as truck-type) circuit breakers. The rack-type breakers have three positions: racked out, test, and racked in. When in the test or racked-in positions, the breaker can be displayed as open or closed. When racked out, no breaker open/close display are available. The rack-type breakers are a display-only functionality and do not impact any circuit breaker control capabilities.

## Status and Trip Target LEDs

The SEL-487E includes programmable status and trip target LEDs, as well as programmable direct-action control pushbuttons on the front panel. Figure 15 shows these targets.

The SEL-487E features a versatile front panel that you can customize to fit your needs. Use SELOGIC control equations and slide-in configurable front-panel labels to change the function and identification of target LEDs and operator control pushbuttons and LEDs. The blank slide-in label set is included with the SEL-487E. You can use templates supplied with the relay or hand label supplied blank labels and print label sets from a printer.

## Alarm Points

You can display messages on the SEL-487E front-panel LCD that indicate alarm conditions in the power system. The relay uses alarm points to place these messages on the LCD.

Figure 22 shows a sample alarm points screen. The relay can display as many as 66 alarm points. The relay automatically displays new alarm points while in manual-scrolling mode and in autoscrolling mode. You can configure the alarm points message and trigger it either immediately by using inputs, communications, or conditionally by using powerful SELOGIC control equations. The asterisk next to the alarm point indicates an active alarm. Use the front-panel navigation pushbuttons to clear inactive alarms.

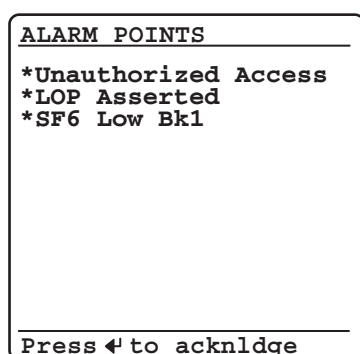


Figure 22 Sample Alarm Points Screen

## Advanced Display Points

Create custom screens showing metering values, special text messages, or a mix of analog and status information. Figure 23 shows an example of how you can use display points to show circuit breaker information and current metering. You can create as many as 160 display points. All display points occupy only one line on the display at all times. The height of the line is programmable as either single or double, as shown in Figure 23. These screens become part of the autoscrolling display when the front panel times out.

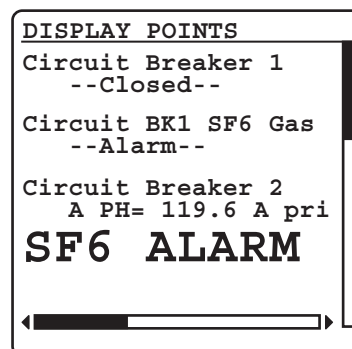


Figure 23 Sample Display Points Screen

## Communications Features

See *Specifications on page 29* for specific supported protocols.

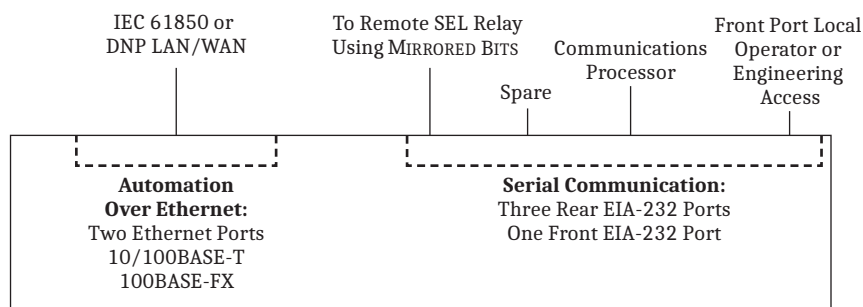


Figure 24 System Functional Overview

The relay offers the following communications features:

- Four independent EIA-232 serial ports.
- Access to event history, relay status, and meter information from the communications ports.
- Password-controlled settings management and automation features.
- SCADA interface capability, including FTP, IEC 61850 Edition 2.1, DNP3 LAN/WAN (via

Ethernet), and DNP3 (via serial port). The relay does not require special communications software. You only need ASCII terminals, printing terminals, or a computer supplied with terminal emulation and a serial communications port.

- Synchrophasor data at 60 message-per-second data format.

## Ethernet Card

The Ethernet card has five small form-factor pluggable (SFP) ports.<sup>a</sup> **PORT 5A** and **PORT 5B** are reserved for the process bus network. **PORT 5C** and **PORT 5D** are reserved for the station bus network. The process and station bus networks support PRP, HSR, and fast failover redundancy modes. **PORT 5E** operates on an isolated network with a unique IP address making it ideal for engineering and data access. All ports support 100 Mbps speeds. **PORT 5A** and **PORT 5B** also support 1 Gbps speeds to satisfy potentially large traffic requirements on the process bus. The process bus, station bus, and engineering access networks use separate MAC addresses and are logically delineated, including in the Configured IED Description (CID) file.<sup>b</sup>

Use popular Telnet applications for easy terminal communications with SEL relays and other devices. Transfer data at high speeds for fast file uploads. The Ethernet card communicates using FTP applications for easy and fast file transfers.

Communicate with SCADA by DNP3 and other substation IEDs by using IEC 61850 Manufacturing Message Specification (MMS) and GOOSE messaging.

Choose Ethernet connection media options for primary and standby connections:

- 10/100BASE-T twisted pair network<sup>c</sup>
- 100BASE FX fiber-optic network
- 1000BASE-X fiber-optic network<sup>d</sup>

## Telnet and FTP

Use Telnet to access relay settings, metering, and event reports remotely by using the ASCII interface. Use FTP to transfer settings files to and from the relay via the high-speed Ethernet port.

## DNP3 LAN/WAN

DNP3 LAN/WAN provides the relay with DNP3 Level 2 Outstation functionality over Ethernet. Configure DNP3 data maps for use with specific DNP3 masters.

<sup>a</sup> SFP transceivers are not included with the card and must be ordered separately. See [selinc.com/products/sfp](http://selinc.com/products/sfp) for a list of compatible SFP transceivers.

<sup>b</sup> This paragraph describes the five-port Ethernet card ordering option. It does not apply to the four-port Ethernet card ordering option.

<sup>c</sup> Four-port Ethernet card ordering option only.

<sup>d</sup> Gigabit speeds are only available on **PORT 5A** and **PORT 5B** of the five-port Ethernet card ordering option.

## PTP

The Ethernet card provides the ability for the relay to accept IEEE 1588 PTPv2 for data time synchronization. PTP support includes the Default, Power System, and Power Utility Automation Profiles. When connected directly to a grandmaster clock providing PTP at 1-second synchronization intervals, the relay can be synchronized to an accuracy of  $\pm 100$  ns in the PTP time scale.

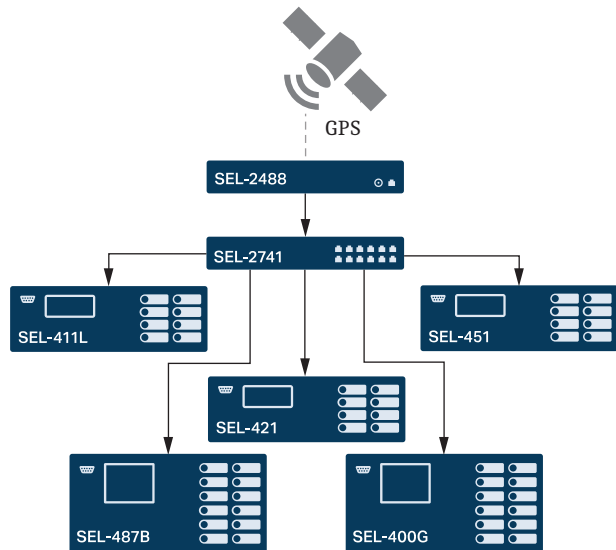


Figure 25 Example PTP Network

## SNTP Time Synchronization

Use SNTP to synchronize relays to as little as  $\pm 1$  ms with no time source delay. Use SNTP as a primary time source, or as a backup to a higher accuracy time input to the relay.

## PRP

Use PRP to provide seamless recovery from any single Ethernet network failure, in accordance with IEC 62439-3. The Ethernet network and all traffic are fully duplicated with both copies operating in parallel.

## HSR

Use HSR to provide seamless recovery from any single Ethernet network failure, in accordance with IEC 62439-3. All HSR compatible devices are connected in a ring and the traffic is fully duplicated and sent in both clockwise and counterclockwise directions around the ring.

## HTTP Web Server

The relay can serve read-only webpages displaying certain settings, metering, and status reports. The web server also allows quick and secure firmware upgrades over Ethernet. As many as four users can access the embedded HTTP server simultaneously.

## IEC 61850 Ethernet Communications

IEC 61850 Ethernet-based communication protocols provide interoperability between intelligent devices within the substation. Standardized logical nodes allow interconnection of intelligent devices from different manufacturers for monitoring and control of the substation.

Eliminate system RTUs by streaming monitor and control information from the intelligent devices directly to remote SCADA client devices.

You can order the relay with IEC 61850 protocol for relay monitor and control functions, including:

- The SEL-487E-5 SV Publisher supports as many as seven SV publications with one or two Application Service Data Units (ASDUs). The following IEC 61850-9-2LE compliant variants are supported:
  - F4000S1I4U4: IEC 61850-9-2LE compatible variant optimized for 50 Hz systems.
  - F4800S1I4U4: IEC 61850-9-2LE compatible variant optimized for 60 Hz systems.
- The following IEC 61869-9 compliant variants provide different current and voltage channel capacities within a single SV stream:
  - F4800S1-2I0-18U0-6: As many as 18 current and 6 voltage channels are supported for units with current channels S, T, U, W, X, and Y and voltage channels V and Z.
  - F4800S1-2I0-21U0-3: As many as 21 current and 3 voltage channels are supported for units with current channels S, T, U, W, X, Y, and Z and voltage channel V.
  - F4800S1-2I0-9U0-3: As many as 9 current and 3 voltage channels are supported for units with current channels W, X, and Y and voltage channel Z.
- As many as 128 incoming GOOSE messages. You can use the incoming GOOSE messages to control as many as 256 control bits in the relay with <3 ms latency from device to device depending on network design. These messages provide binary control inputs to the relay for high-speed control functions and monitoring.
- As many as eight outgoing GOOSE messages. Configure outgoing GOOSE messages for Boolean or analog data such as high-speed control and monitoring of external breakers, switches, and other devices. Boolean data are provided with <3 ms latency from device to device depending on network design.
- IEC 61850 Data Server. The relay equipped with embedded IEC 61850 Ethernet protocol provides data according to predefined logical node objects. Each relay supports as many as seven simultaneous MMS client sessions, with support to association-based and indexed reports. Relevant Relay Word

bits are available within the logical node data, so status of relay elements, inputs, outputs, or SELOGIC control equations can be monitored.

- As many as 256 virtual bits. Configure the virtual bits within GOOSE messaging to represent a variety of Boolean values available within the relay. These bits that the relay receives are available for use in SELOGIC control equations.
- As many as 64 remote analog outputs. Assign the remote analog outputs to virtually any analog quantity available in the relay. You can also use SELOGIC math variables to develop custom analog quantities for assignment as remote analog outputs. Remote analog outputs that use GOOSE messages provide peer-to-peer transmission of analog data. Each relay can receive as many as 256 remote analog inputs and use those inputs as analog quantities within SELOGIC control equations.
- IEC 61850 standard operating modes. The relay supports Test, Blocked, On, and Off. The relay also supports Simulation mode for added flexibility.

## MMS File Services

This service of IEC 61850 MMS provides support for file transfers completely within an MMS session. All relay files that can be transferred via FTP can also be transferred via MMS file services.

## MMS Authentication

When enabled via a setting in the Configured IED Description (CID) file, the relay requires authentication from any client requesting to initiate an MMS session.

## Architect Software

Use ACCELERATOR Architect SEL-5032 Software to manage the IEC 61850 configuration for devices on the network. This Windows-based software provides easy-to-use displays for identifying and binding IEC 61850 network data among logical nodes that use IEC 61850-compliant CID files. Architect uses CID files to describe the data available in each relay.


## Serial Communications MIRRORED BITS Communications

The SEL patented MIRRORED BITS technology provides bidirectional relay-to-relay digital communication.

*Figure 26* shows two relays with SEL-2815 Fiber-Optic Transceivers that use MIRRORED BITS communications. MIRRORED BITS communications can operate simultaneously on any two serial ports. This bidirectional digital communication creates additional outputs (transmitted

MIRRORED BITS) and additional inputs (received MIRRORED BITS) for each serial port operating in the MIRRORED BITS communications mode.

Communicated information can include digital, analog, and virtual terminal data. Virtual terminal allows operator access to remote relays through the local relay. You can use this MIRRORED BITS protocol to transfer information between stations to enhance coordination and achieve faster tripping.

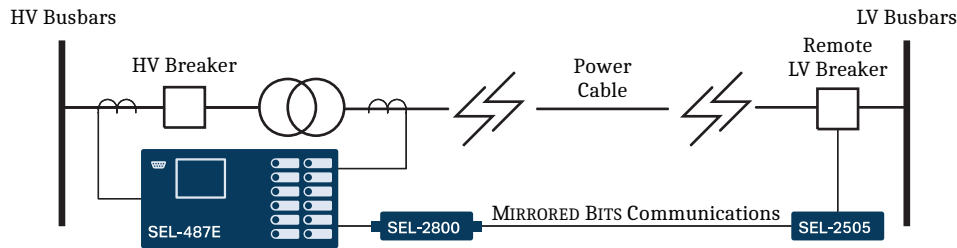

**Figure 26 Integral Communication Provides Secure Protection, Monitoring, and Control as Well as Terminal Access to Both Relays Through One Connection**

## Open Communications Protocols

The relay does not require special communications software. ASCII terminals, printing terminals, or a computer supplied with terminal emulation and a serial or Ethernet communications port are all that is required. *Table 2* lists a brief description of the terminal protocols.

**Table 2 Open Communications Protocol**

| Type  | Description  |
|---|--|
| ASCII   | Plain-language commands for human and simple machine communications. Use for metering, setting, self-test status, event reporting, and other functions.  |
| Compressed ASCII                                | Comma-delimited ASCII data reports. Allows external devices to obtain bay data in an appropriate format for direct import into spreadsheets and database programs. Data are checksum protected.  |
| Extended Fast Meter, Fast Operate, and Fast SER | Binary protocol for machine-to-machine communications. Quickly updates SEL-2032 Communications Processors, RTUs, and other substation devices with metering information, bay element, I/O status, time-tags, open and close commands, and summary event reports. Data are checksum protected. Binary and ASCII protocols operate simultaneously over the same communications lines so that control operator metering information is not lost while a technician is transferring an event report. |
| Ymodem  | Support for reading event, settings, and oscillography files.  |
| Optional DNP3 Level 2 Outstation                | DNP with point remapping. Includes access to metering data, protection elements, contact I/O, targets, SER, relay summary event reports, and settings groups.  |
| MIRRORED BITS                                   | SEL protocol for exchanging digital and analog information among SEL relays and for use as low-speed terminal connection.  |
| FTP and Telnet                                  | Use Telnet to establish a terminal-to-relay connection over Ethernet. Use FTP to move files in and out of the relay over Ethernet.   |

## Automation

### Flexible Control Logic and Integration Features

Use the control logic to perform the following:

- Replace traditional panel control switches
- Eliminate remote terminal unit (RTU)-to-bay wiring
- Replace traditional latching relays
- Replace traditional indicating panel lights

Eliminate traditional panel control switches with 96 local control points. Set, clear, or pulse local control points with the front-panel pushbuttons and display. Program the local control points to implement your control scheme via SELOGIC control equations. Use the local control points for such functions as trip testing, enabling/disabling reclosing, and tripping/closing circuit breakers.

Eliminate RTU-to-bay wiring with 96 remote control points per relay. Set, clear, or pulse remote control points via serial port commands. Incorporate the remote control

points into your control scheme via SELOGIC control equations. Use remote control points for SCADA-type control operations (e.g., trip, close, settings group selection).

Replace traditional latching relays for such functions as remote control enable with 80 latching control points. Program latch set and latch reset conditions with SELOGIC control equations. Set or reset the latch control points via control inputs, remote control points, local control points, or any programmable logic condition. The relay retains the states of the latch control points after turning on following a power interruption.

Replace traditional indicating panel lights and switches with as many as 24 latching target LEDs and as many as 12 programmable pushbuttons with LEDs. Define custom messages (i.e., BREAKER OPEN, BREAKER CLOSED, RECLOSER ENABLED) to report power system or relay con-

ditions on the large format LCD. Control displayed messages with SELOGIC control equations by driving the LCD via any logic point in the relay.

## SELOGIC Control Equations With Expanded Capabilities and Aliases

Expanded SELOGIC control equations put relay logic in the hands of the engineer. Assign inputs to suit your application, logically combine selected bay elements for various control functions, and assign outputs to your logic functions.

Programming SELOGIC control equations consists of combining relay elements, inputs, and outputs with SELOGIC control equation operators (*Table 3*). Any element in the Relay Word can be used in these equations. For complex or unique applications, these expanded SELOGIC functions allow superior flexibility.

**Table 3 SELOGIC Control Equation Operators**

| Operator Type      | Operators  | Comments  |
|--------------------|--|---|
| Boolean            | AND, OR, NOT   | Allows combination of measuring units.  |
| Edge Detection     | F_TRIG, R_TRIG   | Operates at the change of state of an internal function.                                  |
| Comparison         | >, >=, =, <=, <, <>  |   |
| Arithmetic         | +, -, *, /   | Uses traditional math functions for analog quantities in an easily programmable equation. |
| Numerical          | ABS, SIN, COS, LN, EXP, SQRT, LOG, ACOS, ASIN, CEIL, FLOOR |   |
| Precedence Control | ( )  | Allows multiple and nested sets of parentheses.   |
| Comment            | #, (* *)   | Provides for easy documentation of control and protection logic.                          |

Use the relay alias capability to assign more meaningful names to analog and Boolean quantities. This improves the readability of customized programming. Use as many as 200 aliases to rename any digital or analog quantity. The following is an example of possible applications of SELOGIC control equations that use aliases.

```

=>>SET T <Enter>
1: PMV01, THETA
(assign the alias "THETA" to math variable PMV01)

2: PMV02, TAN
(assign the alias "TAN" to math variable PMV02)

=>>SET L <Enter>
1: # CALCULATE THE TANGENT OF THETA
2: TAN:=SIN(THETA)/COS(THETA)
(use the aliases in an equation)

```

Add programmable control functions to your relay and automation systems. New functions and capabilities enable using analog values in conditional logic statements. The following are examples of possible applications of SELOGIC control equations with expanded capabilities.

- Emulate a motor-driven reclose timer, including stall, reset, and drive-to-lockout conditions.
- Scale analog values for SCADA retrieval.
- Initiate remedial action sequence based on load flow before fault conditions.
- Interlock breakers and disconnect switches.
- Restrict breaker tripping in excessive duty situations without additional relays.
- Hold momentary change-of-state conditions for SCADA polling.

# Metering and Monitoring

Access a range of useful information in the relay with the metering function. Metered quantities include fundamental primary and secondary current and voltage magnitudes and angles for each terminal. RMS voltage and current metering is also provided. Fundamental phase

and real and reactive power, per-phase voltage magnitude, angle, and frequency are displayed in the metering report for applications that use the relay voltage inputs. Terminal Z can be ordered as either a three-phase voltage input or a three-phase current input.

**Table 4 Metering Capabilities**

| Capabilities   | Description  |
|--|--|
| <b>Instantaneous Quantities</b>  |  |
| Voltages<br>$V_{A,B,C} (V, Z), V_{\phi\phi}, 3V0, V1, 3V2$   | Voltages measured at the fundamental frequency of the power system. The relay compensates for delta-connected CTs when reporting primary values.   |
| RMS Voltages<br>$V_{A,B,C} (V, Z), V_{\phi\phi}$   | RMS voltages include fundamental plus all measurable harmonics.  |
| Compensated Fundamental Currents<br>$I_{A,B,C} (S, T, U, W, X, Y, Z), 3I0, I1, 3I2$<br>$I_{A,B,C} (ST, TU, UW, WX), 3I0, I1, 3I2$  | Currents measured at the fundamental frequency of the power system with transformer phase-compensation applied.  |
| RMS Currents<br>$I_{A,B,C} (S, T, U, W, X, Y, Z)$<br>$I_{A,B,C} (ST, TU, UW, WX)$  | RMS currents include fundamental plus all measurable harmonics.  |
| <b>Power/Energy Metering Quantities</b>  |  |
| Fundamental Power Quantities<br>$S_{A,B,C}, P_{A,B,C}, Q_{A,B,C} (S, T, U, W, X, Y, Z)$<br>$S_{A,B,C}, P_{A,B,C}, Q_{A,B,C} (ST, TU, UW, WX)$<br>$S_{3\phi}, P_{3\phi}, Q_{3\phi} (S, T, U, W, X, Y, Z)$<br>$S_{3\phi}, P_{3\phi}, Q_{3\phi} (ST, TU, UW, WX)$ | Power quantities calculated using fundamental voltage and current measurements;<br>$S = MVA, P = MW, Q = MVAR.$  |
| <b>Differential Metering</b>   |  |
| Differential<br>IOPA, IOPB, IOPC, IRTA, IRTB, IRTC<br>IOPA2, IOPB2, IOPC2, IRTA2, IRTB2, IRTC2   | IOP, Zone 1 operate current magnitude (per unit).<br>IRT, Zone 1 restraint current magnitude (per unit).<br>IOP2, Zone 2 operate current magnitude (per unit).<br>IRT2, Zone 2 restraint current magnitude (per unit). |
| Harmonics<br>2nd: IOPAF2, IOPBF2, IOPCF2<br>4th: IOPAF4, IOPBF4, IOPCF4<br>5th: IOPAF5, IOPBF5, IOPCF5   | Zone 1 differential harmonic quantities represent the effective harmonic content of the operate current. This content is what the relay uses for harmonic blocking and harmonic restraint.                             |
| <b>Demand/Peak Demand Metering</b>   |  |
| $I_{A,B,C}, 3I2, 3I0 (S, T, U, W, X, Y, Z)$<br>$I_{A,B,C}, 3I2, 3I0 (ST, TU, UW, WX)$<br>IMAX (S, T, U, W, X, Y, Z)<br>IMAX (ST, TU, UW, WX)   | Thermal or rolling interval demand.  |

## Event Reporting and SER

Event reports and SER features simplify post-fault analysis and help improve your understanding of both simple and complex protective scheme operations. These features also aid in testing and troubleshooting relay settings and protective schemes.

## Oscillography and Event Reporting

In response to a user-selected internal or external trigger, the voltage, current, and element status information contained in each event report confirms relay, scheme, and system performance for every fault. The relay provides sampling rates as fast as 8 kHz for analog quantities in a COMTRADE file format, as well as eight-sample-per-cycle and four-sample-per-cycle event reports. The relay stores as much as 3 seconds of 8 kHz event data. The relay supports inclusion of user-configurable analogs in

the events. Reports are stored in nonvolatile memory. Relay settings operational in the relay at the time of the event are appended to each event report.

Each relay provides event reports for analysis with software such as SEL-5601-2 SYNCHROWAVE® Event Software. With SYNCHROWAVE Event, you can display events from several relays to make the fault analysis easier and more meaningful. Because the different relays time-stamp the events with values from their individual clocks, be sure to time synchronize the relay with an IRIG-B clock input or PTP source to use this feature.

## Event Summary

Each time the relay generates a standard event report, it also generates a corresponding event summary. This is a concise description of an event that includes the following information:

- Relay/terminal identification
- Event date and time
- Event type
- Event number
- Time source
- Active settings group
- Targets asserted during the fault
- Current magnitudes and angles for each terminal
- Voltage magnitudes and angles
- Differential operate and restraint current magnitudes
- Recloser shot count at time of trigger (if applicable)
- Fault location and type (if applicable)
- Breaker status (open/close)

With an appropriate setting, the relay sends an event summary in ASCII text automatically to one or more serial ports each time an event report is triggered.

## SV Reporting

The SV Subscriber includes a comprehensive report of the SV communication stream. The ASCII command **COM SV** displays statistics information from the sample values stream to aid in troubleshooting.

## SER

Use this feature to gain a broad perspective of relay element operation. Items that trigger an SER entry are selectable and can include as many as 250 monitoring points, such as I/O change-of-state and element pickup/dropout. The relay SER stores the latest 1000 events.

## Analog Signal Profiling

The relay provides analog signal profiling for as many as 20 analog quantities. Select any analog quantity measured or calculated by the relay for analog signal profiling. You can select signal sampling rates of 1, 5, 15, 30, and 60 minutes through settings. The analog signal profile report provides a comma-separated variable (CSV) list that you can load into any spreadsheet or database for analysis and graphical display.

SELOGIC enable/disable functions can start and stop signal profiling based on Boolean or analog comparison conditions.

## Substation Battery Monitor for DC Quality Assurance

The relay measures and reports the substation battery voltage for up to two battery systems. The SEL-411L, SEL-421, SEL-451 support two battery monitors while the SEL-487B, SEL-487E, and SEL-487V support one. Each battery monitor supports programmable threshold comparators and associated logic provides alarm and control for batteries and chargers. The relay also provides dual ground detection. Monitor dc system status alarms with an SEL communications processor and trigger messages, telephone calls, or other actions.


The measured dc voltage is reported in the METER display via serial port communications, on the LCD, and in the event report. Use the event report data to see an oscillographic display of the battery voltage. Monitor the substation battery voltage drops during trip, close, and other control operations.

## Breaker Contact Wear Monitoring

Circuit breakers experience mechanical and electrical wear during each operation. Effective scheduling of breaker maintenance takes into account the manufacturer's published data of contact wear versus interruption levels and operation count.

- Every time the breaker trips, the relay integrates interrupted current. When the result of this integration exceeds the threshold set by the breaker wear curve (*Figure 27*), the relay can alarm via an output contact or the optional front-panel display. With this information, you can schedule breaker maintenance in a timely, economical fashion.
- The relay monitors last and average mechanical and electrical interruption time per pole. You can easily determine if operating time is increasing beyond reasonable tolerance and then schedule proactive breaker maintenance. You can activate an alarm point if operation time exceeds a preset value.

The relay also monitors breaker motor run time, pole discrepancy, and breaker inactivity.

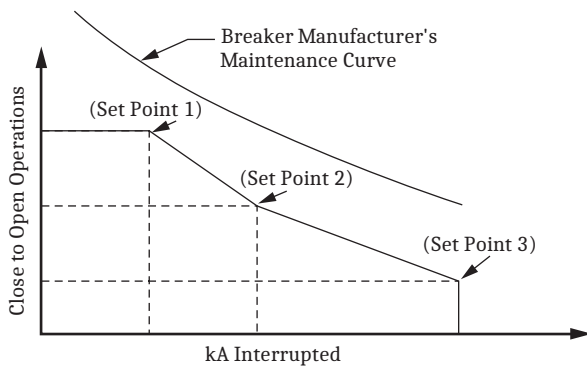

**Figure 27 Breaker Contact Wear Curve and Settings**

## Transformer Thermal Monitoring


Transformer thermal monitoring for mineral-oil immersed transformers is a standard feature in the SEL-487E. Specify the SEL-487E to provide this capability for monitoring and protection of a single three-phase transformer, as well as for monitoring and protection of three independent single-phase units. Use the thermal element to activate a control action or issue a warning or alarm when your transformer overheats or is in danger of excessive insulation aging or loss of life.

The thermal element operates in one of three modes, depending upon the presence or lack of measured temperature inputs: 1) measured ambient and top-oil temperature inputs,

2) measured ambient temperature only, and 3) no measured temperature inputs. If the relay receives measured ambient and top-oil temperatures, the thermal element calculates hot-spot temperature. When the relay receives a measurement of ambient temperature without top-oil temperature, the thermal element calculates the top-oil temperature and hot-spot temperature. In the absence of any measured ambient or top-oil temperatures, the thermal element uses a default ambient temperature setting that you select and calculates the top-oil and hot-spot temperatures. The relay uses hot-spot temperature as a basis for calculating the insulation aging acceleration factor (FAA) and loss-of-life quantities. Use the thermal element to indicate alarm conditions and/or activate control actions when one or more of the following exceed settable limits:

- Top-oil temperature
- Winding hot-spot temperature
- Insulation FAA
- Daily loss-of-life
- Total loss-of-life

Generate a thermal monitor report that indicates the present thermal status of the transformer. Historical thermal event reports and profile data are stored in the relay in hourly format for the previous 24 hours and in daily format for the previous 31 days.

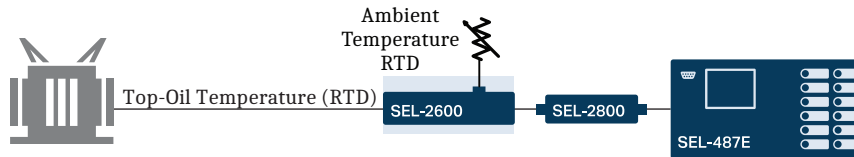

**Figure 28 Typical One-Line Diagram for Collecting Transformer Temperature Data**

## Through-Fault Event Monitor

A through fault is an overcurrent event external to the differential protection zone. Though a through fault is not an in-zone event, the currents required to feed this external fault can cause great stress on the apparatus inside the differential protection zone. Through-fault currents can cause transformer winding displacement leading to mechanical damage and increased transformer thermal wear because of mechanical stress of insulation components in the transformer. The SEL-487E through-fault

event monitor gathers current level, duration, and date/time for each through fault. The monitor also calculates a  $I^2t$  and cumulatively stores these data per phase. The SEL-487E through-fault report also provides percent of total through-fault accumulated according to the *IEEE Guide for Liquid-Immersed Transformer Through-Fault-Current Duration*, IEEE C57.109-1993. Use through-fault event data to schedule proactive transformer bank maintenance and help justify through-fault mitigation efforts. Apply the accumulated  $I^2t$  alarm capability of the relay to indicate excess through-fault current over time.

# Diagrams and Dimensions


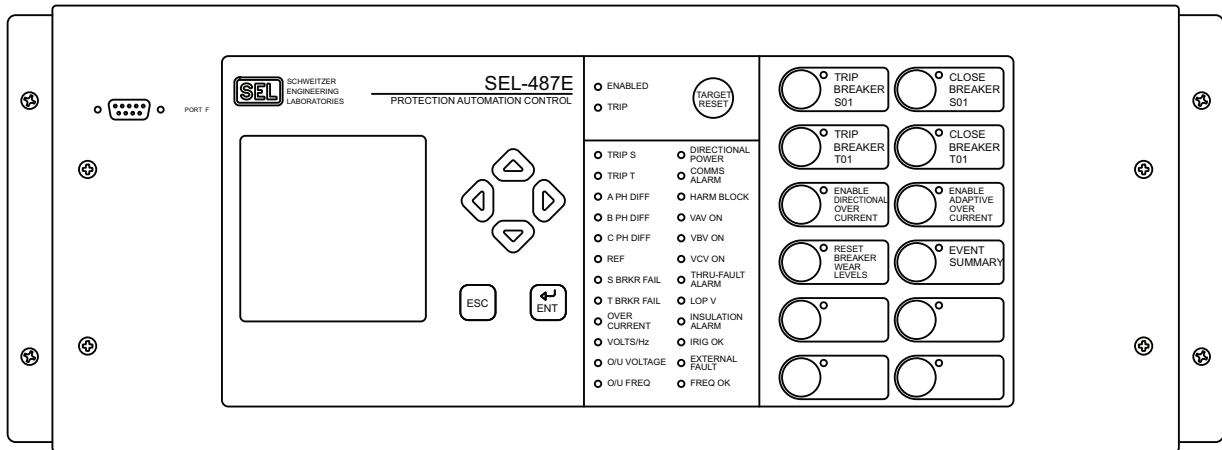



Figure 29 4U Front Panel

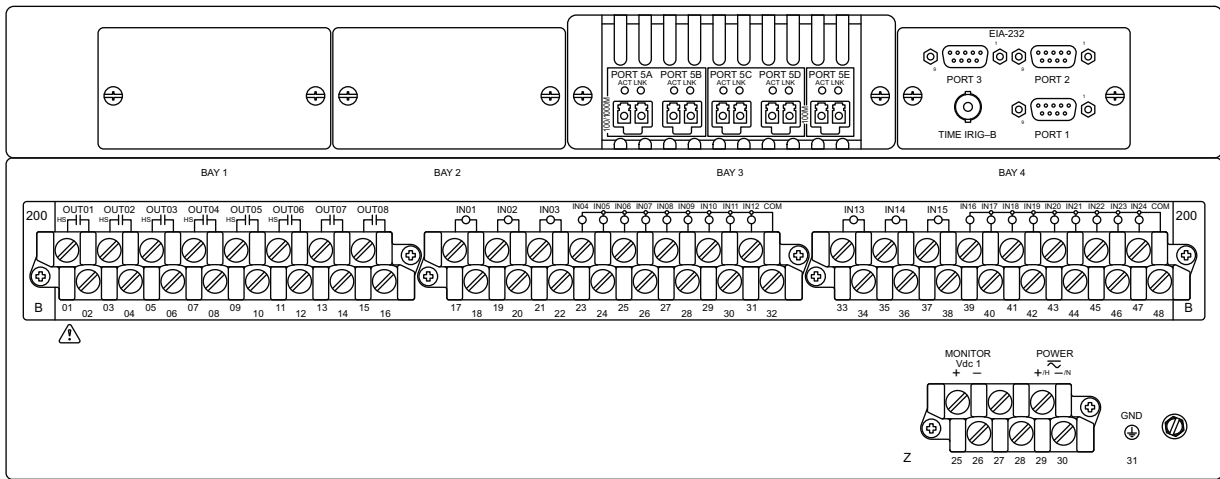

Five-port Ethernet card ordering option depicted.

17291a


Figure 30 SV Subscriber Relay Rear Panel (4U) With INT4 I/O Board

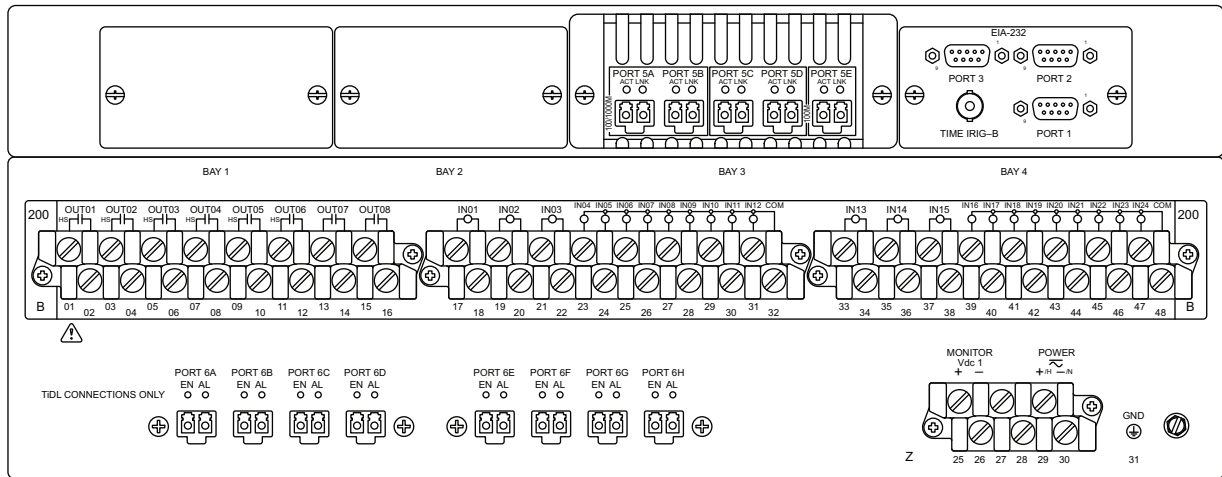

Five-port Ethernet card ordering option depicted.

17291a


Figure 31 TiDL Relay Rear Panel (4U) With INT4 I/O Board

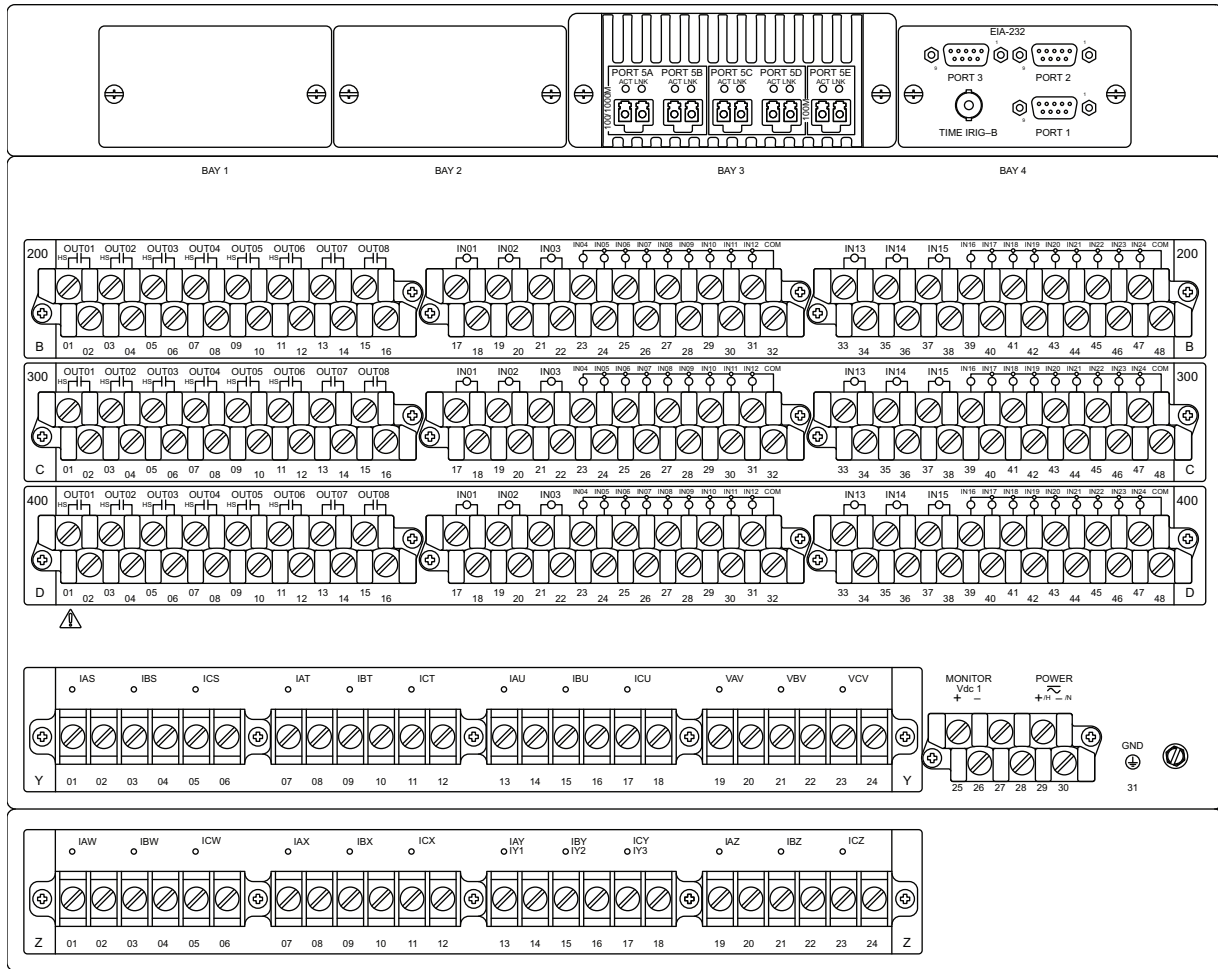

Five-port Ethernet card ordering option depicted.


17343a

**Figure 32 Dual AC Input Card Rear Panel With Fixed Terminal Blocks and Current Terminal Z (8U)**

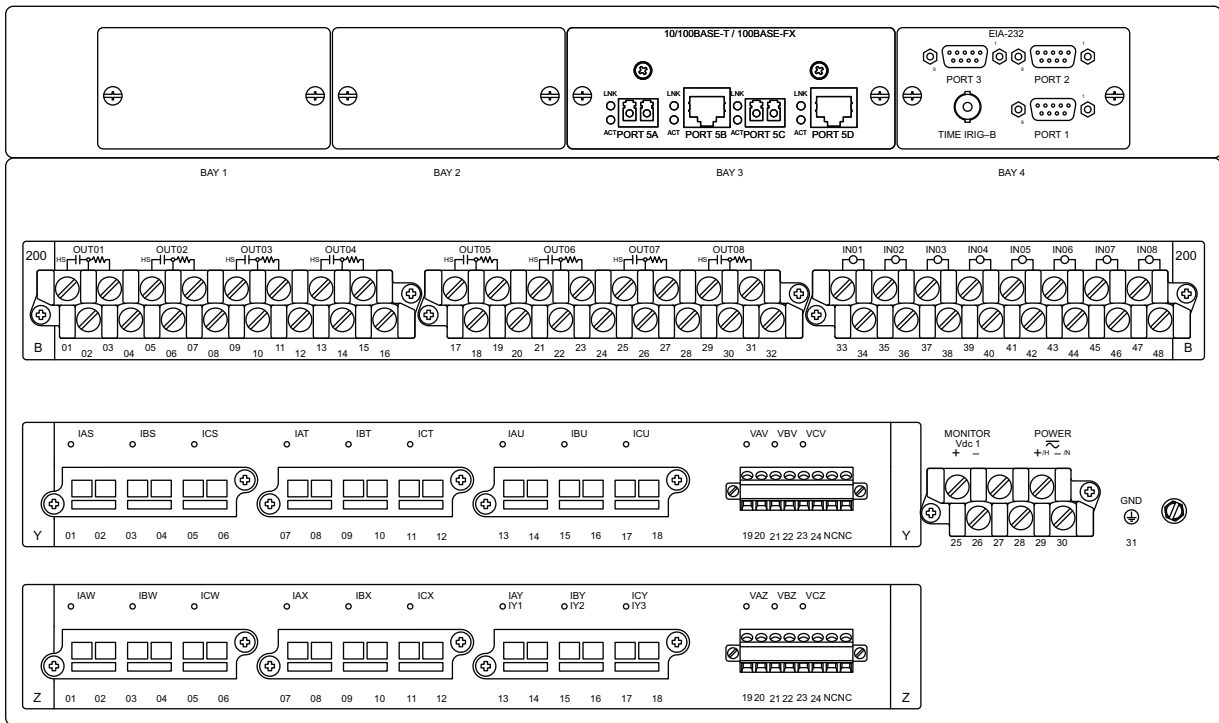

17345a

**Figure 33 Rear Panel Connectorized With LEA Voltage Inputs (6U) With INT8 I/O Board**

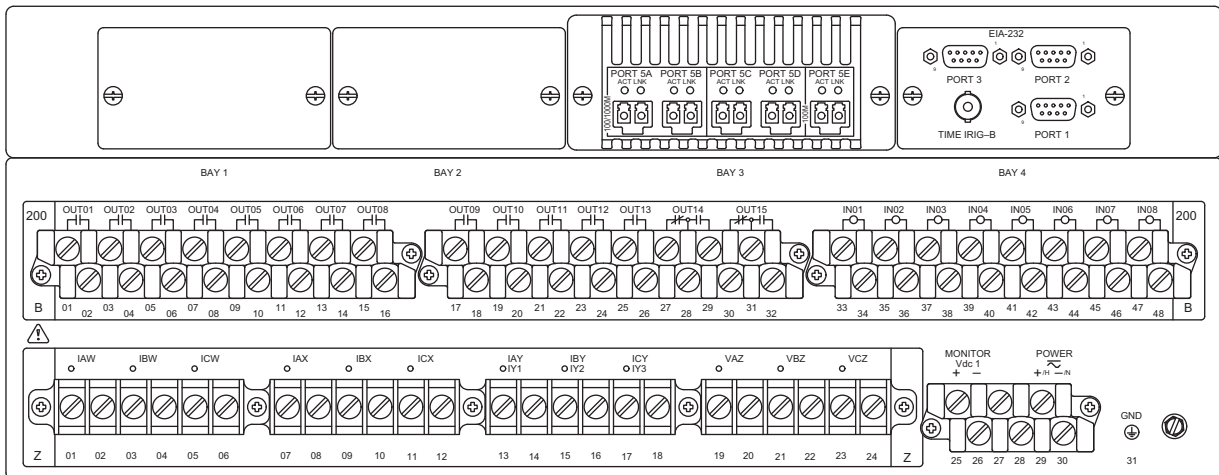


8653a

Five-port Ethernet card ordering option depicted.

**Figure 34 Single AC Input Card Rear Panel With Fixed Terminal Blocks (4U)**


### RACK-MOUNT CHASSIS

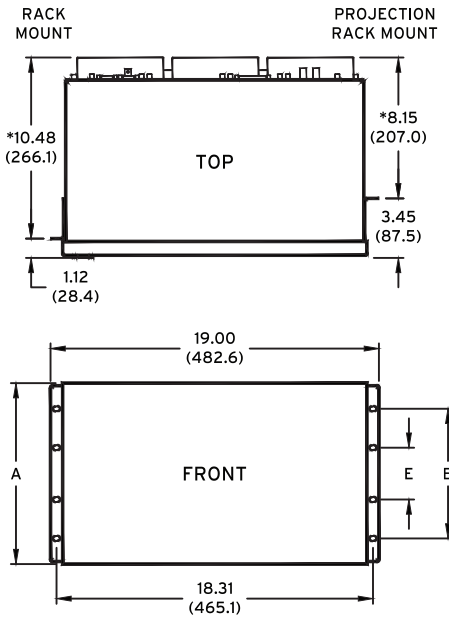

| DIMENSION | ONE I/O BOARD (4U) | TWO I/O BOARD (5U) | THREE I/O BOARD (6U) |
|-----------|--------------------|--------------------|----------------------|
| A         | 6.97<br>(177.0)    | 8.72<br>(221.5)    | 10.47<br>(265.9)     |
| B         | 4.00<br>(101.6)    | 5.75<br>(146.0)    | 7.50<br>(190.5)      |
| C         | 8.40<br>(213.4)    | 10.15<br>(257.8)   | 11.90<br>(302.3)     |
| D         | 6.85<br>(174.0)    | 8.60<br>(218.4)    | 10.35<br>(262.9)     |
| E         | N/A                | N/A                | 3.00<br>(76.2)       |


\*ADD 0.30 (7.6) FOR CONNECTORIZED RELAYS

### PANEL-MOUNT CHASSIS

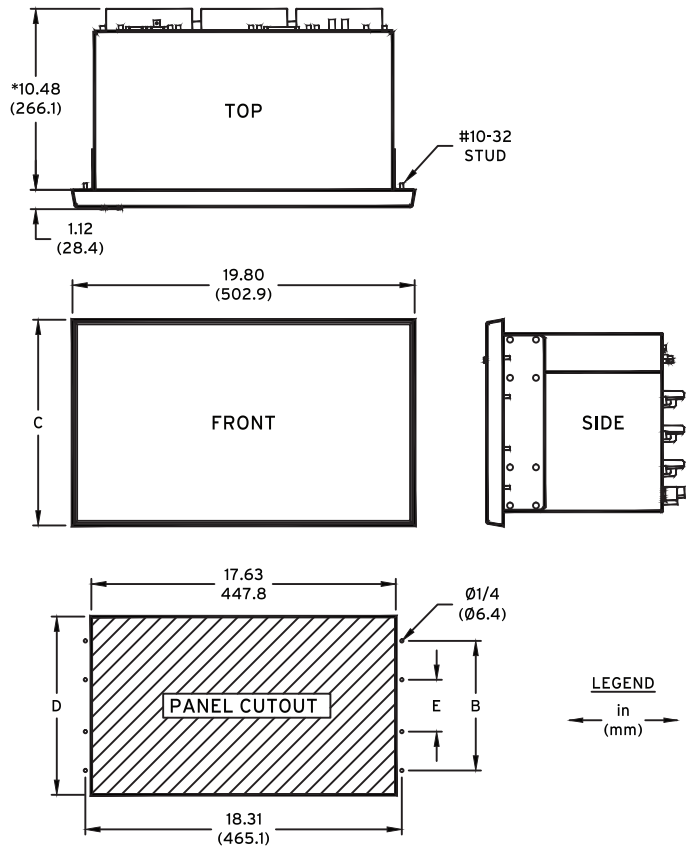

**LEGEND**  
in (mm)

**Figure 35 SEL-487E Chassis Dimensions for TiDL Relays, SV Subscribers, or Relays With a Single AC Input Card**

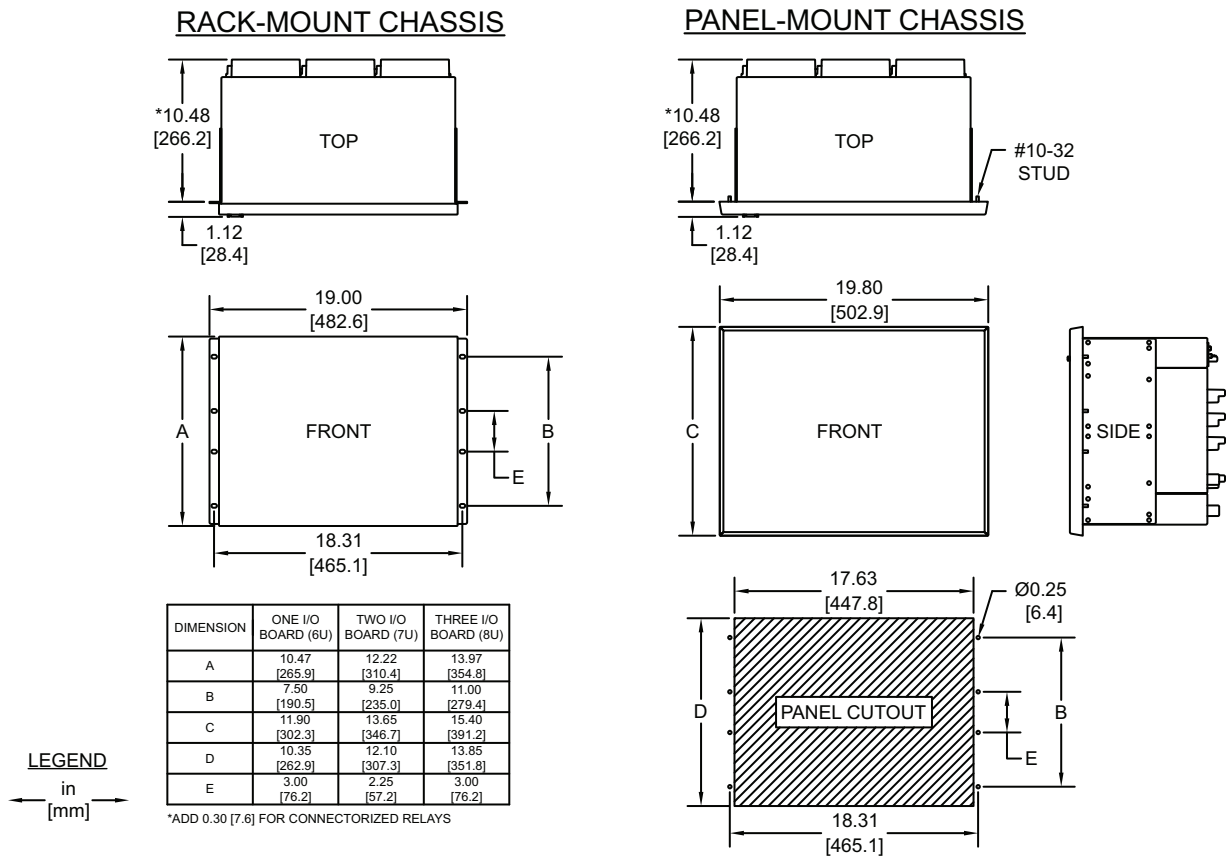

**Figure 36 SEL-487E Chassis Dimensions With Dual AC Input Cards**

## Models and Options

Consider the following options when ordering and configuring the SEL-487E.

- DSS connector type
  - IEC 61850 compliant SV publisher
  - IEC 61850 compliant SV subscriber
  - SEL TiDL relay with T-Protocol
- Chassis size
  - U is one rack unit—1.75 in or 44.45 mm
    - SEL-487E-5 SV Subscriber or TiDL relay supports 4U only
    - SEL-487E-5 SV Publisher with dual ac input cards supports 6U, 7U, and 8U
    - SEL-487E-5 SV Publisher with a single ac input card supports 4U, 5U, and 6U

## Current Channel Options

Select the CT secondary current for any one of the six terminals (S, T, U, W, X, Z) from 1 A or 5 A (all three phases 1 A or 5 A). Terminal Z can be ordered as a three-

phase current or voltage input. For neutral terminals (the three inputs of Terminal Y), you can separately select the CT secondary current for each of the three inputs. For example, select 5 A secondary currents for the three phases of Terminal S, 5 A secondary currents for the three phases of Terminal T, 1 A secondary currents for the three phases of Terminal U, 5 A secondary current for REF 1 (first neutral current input), and 1 A secondary current for REF 2 (second neutral current input). When Terminal Y is ordered with matching rated nominal current inputs, you can use that terminal as a seventh set of three-phase CT inputs: IAY, IBY, and ICY.

Although each three-phase terminals (S, T, U, W, X, and Z) can be either 1 A or 5 A, and the Y-terminals either 1 A or 5 A on a per-phase basis, the SEL-487E supports only the combinations shown in *Table 5*. SV publisher models can be ordered with the options shown in *Table 5*, while SV subscriber or TiDL relays are configured using Grid Configurator.

**Table 5 Supported 1 A/5 A Terminal Combinations (Sheet 1 of 2)**

| Terminals S, T, U  | Terminals W, X, IY1, IY2, IY3  |
|--|--|
| Terminal S = 5 A<br>Terminal T = 5 A<br>Terminal U = 5 A | Terminal W = 5 A<br>Terminal X = 5 A<br>Terminal IY1, IY2, IY3 = 5 A, 5 A, 5 A |
| Terminal S = 5 A<br>Terminal T = 5 A<br>Terminal U = 1 A | Terminal W = 5 A<br>Terminal X = 5 A<br>Terminal IY1, IY2, IY3 = 5 A, 5 A, 1 A |
| Terminal S = 5 A<br>Terminal T = 1 A<br>Terminal U = 1 A | Terminal W = 5 A<br>Terminal X = 5 A<br>Terminal IY1, IY2, IY3 = 5 A, 1 A, 1 A |
| Terminal S = 1 A<br>Terminal T = 1 A<br>Terminal U = 1 A | Terminal W = 5 A<br>Terminal X = 5 A<br>Terminal IY1, IY2, IY3 = 1 A, 1 A, 1 A |
|  | Terminal W = 1 A<br>Terminal X = 1 A<br>Terminal IY1, IY2, IY3 = 5 A, 5 A, 5 A |

**Table 5 Supported 1 A/5 A Terminal Combinations (Sheet 2 of 2)**

| Terminals S, T, U | Terminals W, X, IY1, IY2, IY3  |
|-------------------|--|
|                   | Terminal W = 1 A<br>Terminal X = 1 A<br>Terminal IY1, IY2, IY3 = 5 A, 5 A, 1 A                     |
|                   | Terminal W = 1 A<br>Terminal X = 1 A<br>Terminal IY1, IY2, IY3 = 5 A, 1 A, 1 A                     |
|                   | Terminal W = 1 A<br>Terminal X = 1 A<br>Terminal IY1, IY2, IY3 = 1 A, 1 A, 1 A                     |
|                   | Terminal W = 5 A<br>Terminal X = 5 A<br>Terminal IY1, IY2, IY3 = 5 A, 5 A, 5 A<br>Terminal Z = 5 A |
|                   | Terminal W = 1 A<br>Terminal X = 1 A<br>Terminal IY1, IY2, IY3 = 1 A, 1 A, 1 A<br>Terminal Z = 1 A |

## Interface Board (I/O) Options

**Table 6 Interface Board Information**

| Board Name | Inputs  | Description  | Outputs | Description  |
|------------|---------|--|---------|--|
| INT2       | 8       | Optoisolated, independent, level-sensitive   | 13<br>2 | Standard Form A<br>Standard Form C                               |
| INT4       | 18<br>6 | Two sets of 9 common optoisolated, level-sensitive<br>Optoisolated, independent, level-sensitive | 6<br>2  | High-speed, high-current interrupting, Form A<br>Standard Form A |
| INT7       | 8       | Optoisolated, independent, level-sensitive   | 13<br>2 | High-current interrupting, Form A<br>Standard Form C             |
| INT8       | 8       | Optoisolated, independent, level-sensitive   | 8       | High-speed, high-current interrupting, Form A                    |
| INTD       | 18<br>6 | Two sets of 9 common optoisolated, level-sensitive<br>Optoisolated, independent, level-sensitive | 8       | Standard Form A  |

- Voltage ranges for the inputs on the main board as well as for the inputs on the four interface boards
  - 24 Vdc
  - 48 Vdc
  - 110 Vdc
  - 125 Vdc
  - 220 Vdc
  - 250 Vdc
- Connector type
  - Screw-terminal block inputs
  - Connectorized
- Conformal coat
  - Conformal coating provides an additional barrier to harsh environments, such as high humidity and airborne contaminants.
- Power supply
  - 24–48 Vdc
  - 48–125 Vdc or 110–120 Vac
  - 125–250 Vdc or 110–240 Vac
- Voltage channel options
  - 300 V phase-to-neutral wye configuration PT inputs
  - Two three-phase, 8 Vac, C37.92-compliant LEA inputs

- Ethernet card options
  - Four-port Ethernet card with port combinations of:
    - Four copper (10BASE-T/100BASE-TX)
    - Four fiber (100BASE-FX)
    - Two copper (10BASE-T/100BASE-TX) and two fiber (100BASE-FX)
  - Five-port Ethernet card with small form-factor pluggable (SFP) ports (100BASE-FX and 1000BASE-X)<sup>e</sup>
- Communications protocols

- Complete group of SEL protocols (SEL ASCII, SEL Compressed ASCII, SEL Settings File Transfer, SEL Fast Meter, SEL Fast Operate, SEL Fast SER, resistance temperature detectors (RTDs), Enhanced MIRRORING BITS Communications), DNP3, and Synchrophasors (SEL Fast Message and IEEE C37.118 format)
- Above protocols plus IEC 61850 Edition 2.1 MMS, GOOSE, SV publication and subscription

Contact the SEL factory or your local Technical Service Center for particular part number and ordering information (see *Technical Support on page 38*). You can also view the latest part number and ordering information on the SEL website at selinc.com.

<sup>e</sup> All ports support 100 Mbps speeds. PORT 5A and PORT 5B also support 1 Gbps speeds.

## Specifications

**Note:** For SV subscriber applications, operating times are delayed by the configured channel delay, CH\_DLY. See *SV Network Delays on page 17.34 in the SEL-400 Series Relays Instruction Manual* for more details. For TIDL applications, the operating times are delayed by a fixed 1 ms. Use caution when setting relay coordination to account for this added delay.

**Note:** The metering and protection element accuracies specified for the SEL-487E-5 SV Subscriber Relay are valid only when using SEL merging units. For SV applications, third-party SV publisher devices are supported, but hardware accuracies and analog filtering need to be considered to determine the effect on SEL-487E-5 SV Subscriber performance.

### Compliance

Designed and manufactured under an ISO 9001 certified quality management system

#### FCC Compliance Statement

This equipment has been tested and found to comply with the limits for a Class A digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference when the equipment is operated in a commercial environment. This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instruction manual, may cause harmful interference in which case the user will be required to correct the interference at his own expense.

UL Listed to U.S. and Canadian safety standards (File E212775; NRGU, NRGU7)

CE Mark

RCM Mark

### General

#### AC Analog Inputs

Sampling Rate: 8 kHz

#### AC Current Inputs (Secondary Circuits)

**Note:** Current transformers are Measurement Category II.

#### Input Current

**Note:** Terminal Z can be ordered as either a three-phase ac current input or as a three-phase ac voltage input.

5 A Nominal: S, T, U, W, X, Y, and Z terminals

1 A Nominal: S, T, U, W, X, Y, and Z terminals

1 A/5 A Nominal: Y terminal only (REF)

#### Current Rating (With DC Offset at X/R = 10, 1.5 cycles)

5 A Nominal: 91.0 A

1 A Nominal: 18.2 A

#### Continuous Thermal Rating

5 A Nominal: 15 A  
20 A (+55°C)

1 A Nominal: 3 A  
4 A (+55°C)

#### Saturation Current (Linear) Rating

5 A Nominal: 100 A

1 A Nominal: 20 A

#### One-Second Thermal Rating

5 A Nominal: 500 A

1 A Nominal: 100 A

#### One-Cycle Thermal Rating

5 A Nominal: 1250 A-peak

1 A Nominal: 250 A-peak

#### Burden Rating

5 A Nominal: ≤0.5 VA at 5 A

1 A Nominal: ≤0.1 VA at 1 A

#### A/D Current Limit (Peak)

5 A Nominal: 247.5 A

1 A Nominal: 49.5 A

**Note:** Signal clipping may occur beyond this limit.

#### AC Voltage Inputs

Three-phase, four-wire (wye) connections are supported.

Rated Voltage Range: 55–250 V<sub>LN</sub>

Operational Voltage Range: 0–300 V<sub>LN</sub>

A/D Voltage Limit (Peak): 490 V<sub>LN</sub>

**Note:** Signal clipping can occur beyond this limit.

#### Ten-Second Thermal

Rating: 600 Vac

Burden: ≤0.1 VA @ 125 V

#### LEA Voltage Inputs

Rated Voltage Range: 4 V<sub>L-N</sub>

Operational Voltage Range: 0–8 V<sub>L-N</sub>

A/D Voltage Limit (Peak): 12.8 V<sub>LN</sub>

**Note:** Signal clipping can occur beyond this limit.

Ten-Second Thermal Rating: 300 Vac  
 Input Impedance: 1 M $\Omega$

### Frequency and Rotation

System Frequency: 50/60 Hz  
 Phase Rotation: ABC or ACB  
 Nominal Frequency Rating: 50  $\pm$  5 Hz  
 60  $\pm$  5 Hz  
 Frequency Tracking (Requires PTs): Tracks between 40.0–65.0 Hz  
 Below 40 Hz = 40 Hz  
 Above 65.0 Hz = 65 Hz  
 Default Slew Rate: 15 Hz per s

### Power Supply

24–48 Vdc

Rated Voltage: 24–48 Vdc  
 Operational Voltage Range: 18–60 Vdc  
 Vdc Input Ripple: 15% per IEC 60255-26:2013  
 Interruption: 20 ms at 24 Vdc, 100 ms at 48 Vdc  
 per IEC 60255-26:2013

Burden

SV Relay: <35 W  
 TiDL Relay: <40 W

48–125 Vdc or 110–120 Vac

Rated Voltage: 48–125 Vdc, 110–120 Vac  
 Operational Voltage Range: 38–140 Vdc  
 85–140 Vac

Rated Frequency: 50/60 Hz  
 Operational Frequency Range: 30–120 Hz

Vdc Input Ripple: 15% per IEC 60255-26:2013  
 Interruption: 14 ms @ 48 Vdc, 160 ms @ 125 Vdc  
 per IEC 60255-26:2013

Burden

SV Relay: <35 W, <90 VA  
 TiDL Relay: <40 W, <90 VA

125–250 Vdc or 110–240 Vac

Rated Voltage: 125–250 Vdc, 110–240 Vac  
 Operational Voltage Range: 85–300 Vdc  
 85–264 Vac

Rated Frequency: 50/60 Hz  
 Operational Frequency Range: 30–120 Hz

Vdc Input Ripple: 15% per IEC 60255-26:2013  
 Interruption: 46 ms @ 125 Vdc, 250 ms @ 250 Vdc  
 per IEC 60255-26:2013

Burden

SV Relay: <35 W, <90 VA  
 TiDL Relay: <40 W, <90 VA

### Control Outputs

**Note:** IEEE C37.90-2005 and IEC 60255-27:2013

Update Rate: 1/8 cycle  
 Make (Short Duration Contact Current): 30 Adc  
 1,000 operations at 250 Vdc  
 2,000 operations at 125 Vdc  
 Limiting Making Capacity: 1000 W at 250 Vdc (L/R = 40 ms)  
 Mechanical Endurance: 10,000 operations

Standard

Rated Voltage: 24–250 Vdc  
 110–240 Vrms  
 Operational Voltage Range: 0–300 Vdc  
 0–264 Vrms  
 Operating Time: Pickup  $\leq$  6 ms (resistive load)  
 Dropout  $\leq$  6 ms (resistive load)  
 Short-Time Thermal Withstand: 50 A for 1 s  
 Continuous Contact Current: 6 A at 70°C  
 4 A at 85°C  
 Contact Protection: MOV protection across open contacts  
 264 Vrms continuous voltage  
 300 Vdc continuous voltage  
 Limiting Breaking Capacity/Electrical Endurance: 10,000 operations  
 10 operations in 4 seconds, followed by  
 2 minutes idle

| Rated Voltage | Resistive Break | Inductive Break<br>L/R = 40 ms (DC)<br>PF = 0.4 (AC) |
|---------------|-----------------|--|
| 24 Vdc        | 0.75 Adc        | 0.75 Adc   |
| 48 Vdc        | 0.63 Adc        | 0.63 Adc   |
| 125 Vdc       | 0.30 Adc        | 0.30 Adc   |
| 250 Vdc       | 0.20 Adc        | 0.20 Adc   |
| 110 Vrms      | 0.30 Arms       | 0.30 Arms  |
| 240 Vrms      | 0.20 Arms       | 0.20 Arms  |

Fast Hybrid (High-Speed High-Current Interrupting)

Rated Voltage: 48–250 Vdc  
 Operational Voltage Range: 0–300 Vdc  
 Operating Time: Pickup  $\leq$  10  $\mu$ s (resistive load)  
 Dropout  $\leq$  8 ms (resistive load)  
 Short Time Thermal Withstand: 50 Adc for 1 s  
 Continuous Contact Current: 6 Adc at 70°C  
 4 Adc at 85°C  
 Contact Protection: MOV protection across open contacts  
 300 Vdc continuous voltage  
 Limiting Breaking Capacity/Electrical Endurance: 10,000 operations  
 4 operations in 1 second, followed by  
 2 minutes idle

| Rated Voltage | Resistive Break | Inductive Break      |
|---------------|-----------------|----------------------|
| 24 Vdc        | 10 Adc          | 10 Adc (L/R = 40 ms) |
| 48 Vdc        | 10 Adc          | 10 Adc (L/R = 40 ms) |
| 125 Vdc       | 10 Adc          | 10 Adc (L/R = 40 ms) |
| 250 Vdc       | 10 Adc          | 10 Adc (L/R = 20 ms) |

**Note:** Do not use hybrid control outputs to switch ac control signals.

### Control Inputs

Optoisolated (Use With AC or DC Signals)

INT2, INT7, and INT8 Interface Boards: 8 inputs with no shared terminals  
 INT4 and INTD Interface Boards: 6 inputs with no shared terminals  
 18 inputs with shared terminals  
 (2 groups of 9 inputs with each group sharing one terminal)  
 Voltage Options: 24, 48, 110, 125, 220, 250 V  
 Current Drawn: <5 mA at nominal voltage  
 <8 mA for 110 V option

## DC Thresholds (Dropout Thresholds Indicate Level-Sensitive Option)

|          |   |
|----------|---|
| 24 Vdc:  | Pickup 19.2–30.0 Vdc<br>Dropout: <14.4 Vdc  |
| 48 Vdc:  | Pickup 38.4–60.0 Vdc;<br>Dropout <28.8 Vdc  |
| 110 Vdc: | Pickup 88.0–132.0 Vdc;<br>Dropout <66.0 Vdc |
| 125 Vdc: | Pickup 105–150 Vdc;<br>Dropout <75 Vdc      |
| 220 Vdc: | Pickup 176–264 Vdc;<br>Dropout <132 Vdc     |
| 250 Vdc: | Pickup 200–300 Vdc;<br>Dropout <150 Vdc     |

AC Thresholds (Ratings Met Only When Recommended Control Input Settings Are Used—see *Table 2.1.*)

|          |   |
|----------|---|
| 24 Vac:  | Pickup 16.4–30.0 Vac rms<br>Dropout: <10.1 Vac rms  |
| 48 Vac:  | Pickup 32.8–60.0 Vac rms;<br>Dropout <20.3 Vac rms  |
| 110 Vac: | Pickup 75.1–132.0 Vac rms;<br>Dropout <46.6 Vac rms |
| 125 Vac: | Pickup 89.6–150.0 Vac rms;<br>Dropout <53.0 Vac rms |
| 220 Vac: | Pickup 150.3–264 Vac rms;<br>Dropout <93.2 Vac rms  |
| 250 Vac: | Pickup 170.6–300 Vac rms;<br>Dropout <106 Vac rms   |

Sampling Rate: 2 kHz

## Communications Ports

EIA-232: 1 Front and 3 Rear

Serial Data Speed: 300–57600 bps

## Ethernet Card Slot for Four-Port Ethernet Card

|                     |                                 |
|---------------------|---------------------------------|
| Ordering Option:    | 10/100BASE-T                    |
| Connector Type:     | RJ45                            |
| Ordering Option:    | 100BASE-FX fiber-optic Ethernet |
| Mode:               | Multi                           |
| Wavelength (nm):    | 1300                            |
| Source:             | LED                             |
| Connector Type:     | LC                              |
| Min. TX Pwr. (dBm): | –19                             |
| Max. TX Pwr. (dBm): | –14                             |
| RX Sens. (dBm):     | –32                             |
| Sys. Gain (dB):     | 13                              |

## Ethernet Card Slot for the Five-Port Ethernet Card

|  |   |
|--|---|
| Ordering Option:                           | 100BASE-FX fiber-optic Ethernet SFP transceiver |
| Part Number:                               | 8103-01 or 8109-01                              |
| Mode:                                      | Multi   |
| Wavelength (nm):                           | 1310  |
| Source:                                    | LED   |
| Connector Type:                            | LC  |
| Min. TX Pwr. (dBm):                        | –24   |
| Max. TX Pwr. (dBm):                        | –14   |
| Min. RX Sens. (dBm):                       | –31   |
| Max. RX Sens. (dBm):                       | –12   |
| Approximate Range:                         | 2 km  |
| Transceiver Internal Temperature Accuracy: | ±3.0°C  |

|  |  |
|--|--|
| Transmitter Average Optical Power Accuracy:    | ±3.0 dB  |
| Received Average Optical Input Power Accuracy: | ±3.0 dB  |
| Ordering Option:                               | 1000BASE-LX fiber-optic Ethernet SFP transceiver |
| Part Number:                                   | 8130-01, 8130-02, 8130-03, or 8130-04            |
| Mode:  | Single   |
| Wavelength (nm):                               | 1310   |
| Source:  | LED  |
| Connector Type:                                | LC   |

|                        | Part Number |         |         |         |
|------------------------|-------------|---------|---------|---------|
|                        | 8130-01     | 8130-02 | 8130-03 | 8130-04 |
| Min. TX Pwr. (dBm)     | –9.5        | –6      | –5      | –2      |
| Max. TX Pwr. (dBm)     | –3          | –1      | 0       | 3       |
| Min. RX Sens. (dBm)    | –21         | –22     | –24     | –24     |
| Max. RX Sens. (dBm)    | –3          | –3      | –3      | –3      |
| Approximate Range (km) | 10          | 20      | 30      | 40      |

|  |  |
|--|--|
| Transceiver Internal Temperature Accuracy:     | ±3.0°C   |
| Transmitter Average Optical Power Accuracy:    | ±3.0 dB  |
| Received Average Optical Input Power Accuracy: | ±3.0 dB  |
| Ordering Option:                               | 1000BASE-XD fiber-optic Ethernet SFP transceiver |
| Part Number:                                   | 8130-05  |
| Mode:  | Single   |
| Wavelength (nm):                               | 1550   |
| Source:  | LED  |
| Connector Type:                                | LC   |
| Min. TX Pwr. (dBm):                            | –5   |
| Max. TX Pwr. (dBm):                            | 0  |
| Min. RX Sens. (dBm):                           | –24  |
| Max. RX Sens. (dBm):                           | –3   |
| Approximate Range:                             | 50 km  |
| Transceiver Internal Temperature Accuracy:     | ±3.0°C   |
| Transmitter Average Optical Power Accuracy:    | ±3.0 dB  |
| Received Average Optical Input Power Accuracy: | ±3.0 dB  |
| Ordering Option:                               | 1000BASE-ZX fiber-optic Ethernet SFP transceiver |
| Part Number:                                   | 8130-06, 8130-08, or 8130-10                     |
| Mode:  | Single   |
| Wavelength (nm):                               | 1550   |
| Source:  | LED  |
| Connector Type:                                | LC   |

|                        | Part Number |         |         |
|------------------------|-------------|---------|---------|
|                        | 8130-06     | 8130-08 | 8130-10 |
| Min. TX Pwr. (dBm)     | 0           | 1       | 5       |
| Max. TX Pwr. (dBm)     | 5           | 5       | 8       |
| Min. RX Sens. (dBm)    | -24         | -36     | -36     |
| Max. RX Sens. (dBm)    | -3          | -10     | -10     |
| Approximate Range (km) | 80          | 160     | 200     |

Transceiver Internal Temperature Accuracy:  $\pm 3.0^{\circ}\text{C}$

Transmitter Average Optical Power Accuracy:  $\pm 3.0$  dB

Received Average Optical Input Power Accuracy:  $\pm 3.0$  dB

Ordering Option: 1000BASE-SX fiber-optic Ethernet SFP transceiver

Part Number: 8131-01

Mode: Multi

Wavelength (nm): 850

Source: LED

Connector Type: LC

Min. TX Pwr. (dBm): -9

Max. TX Pwr. (dBm): -2.5

Min. RX Sens. (dBm): -18

Max. RX Sens. (dBm): 0

Approximate Range: 300 m for 62.5/125  $\mu\text{m}$ ; 550 m for 50/125  $\mu\text{m}$

Transceiver Internal Temperature Accuracy:  $\pm 3.0^{\circ}\text{C}$

Transmitter Average Optical Power Accuracy:  $\pm 3.0$  dB

Received Average Optical Input Power Accuracy:  $\pm 3.0$  dB

#### Optional TiDL Communication Ports

Number of Ports: 8

Protocol: T-Protocol

Supported SFP Transceivers: 8103-01 or 8109-01

**Note:** For SFP Transceiver specification, see *Ethernet Card Slot for the Five-Port Ethernet Card* on page 31.

#### Time Inputs

##### IRIG Time Input–Serial PORT 1

Input: Demodulated IRIG-B

Rated I/O Voltage: 5 Vdc

Operational Voltage Range: 0–8 Vdc

Logic High Threshold:  $\geq 2.8$  Vdc

Logic Low Threshold:  $\leq 0.8$  Vdc

Input Impedance: 2.5 k $\Omega$

##### IRIG-B Input–BNC Connector

Input: Demodulated IRIG-B

Rated I/O Voltage: 5 Vdc

Operational Voltage Range: 0–8 Vdc

Logic High Threshold:  $\geq 2.2$  Vdc

Logic Low Threshold:  $\leq 0.8$  Vdc

Input Impedance: 50  $\Omega$  or  $>1$  k $\Omega$

Dielectric Test Voltage: 0.5 kVac

#### PTP

Input: IEEE 1588 PTPv2

Profiles: Default, IEEE C37.238-2011 (Power Profile), IEC/IEEE 61850-9-3-2016 (Power Utility Automation Profile)

Synchronization Accuracy:  $\pm 100$  ns @ 1-second synchronization intervals when communicating directly with master clock

#### Operating Temperature

$-40^{\circ}$  to  $+85^{\circ}\text{C}$  ( $-40^{\circ}$  to  $+185^{\circ}\text{F}$ )

**Note:** LCD contrast impaired for temperatures below  $-20^{\circ}$  and above  $+70^{\circ}\text{C}$ .

#### Humidity

5% to 95% without condensation

#### Weight (Maximum)

##### SV Publisher Relay With Dual AC Input Cards

6U Rack Unit: 15.9 kg (35 lb)

7U Rack Unit: 17.6 kg (39 lb)

8U Rack Unit: 20.4 kg (45 lb)

##### SV Publisher Relay With a Single AC Input Card

4U Rack Unit: 10.2 kg (22.5 lb)

5U Rack Unit: 11.8 kg (26 lb)

6U Rack Unit: 13.5 kg (30 lb)

##### SV Subscriber

4U Rack Unit: 6.57 kg (14.47 lb)

##### TiDL Relay

4U Rack Unit: 6.74 kg (14.87 lb)

#### Terminal Connections

Rear Screw-Terminal Tightening Torque, #8 Ring Lug

Minimum: 1.0 Nm (9 in-lb)

Maximum: 2.0 Nm (18 in-lb)

User terminals and stranded copper wire should have a minimum temperature rating of  $105^{\circ}\text{C}$ . Ring terminals are recommended.

#### Wire Sizes and Insulation

Wire sizes for grounding (earthing) and contact connections are dictated by the terminal blocks and expected load currents. You can use the following table as a guide in selecting wire sizes:

| Connection Type                 | Min. Wire Size                | Max. Wire Size                |
|---------------------------------|-------------------------------|-------------------------------|
| Grounding (Earthing) Connection | 14 AWG (2.5 mm <sup>2</sup> ) | N/A                           |
| Contact I/O                     | 18 AWG (0.8 mm <sup>2</sup> ) | 10 AWG (5.3 mm <sup>2</sup> ) |
| Other Connection                | 18 AWG (0.8 mm <sup>2</sup> ) | 10 AWG (5.3 mm <sup>2</sup> ) |

#### Type Tests

##### Installation Requirements

Overvoltage Category: 2

Pollution Degree: 2

##### Safety

Product Standards: IEC 60255-27:2013  
IEEE C37.90-2005  
21 CFR 1040.10

Dielectric Strength: IEC 60255-27:2013, Section 10.6.4.3  
2.5 kVac, 50/60 Hz for 1 min: Analog Inputs, Contact Outputs, Digital Inputs  
3.6 kVdc for 1 min: Power Supply, Battery Monitors  
2.5 kVdc for 1 min: IRIG-B  
1.1 kVdc for 1 min: Ethernet

|  |   |  |   |
|--|---|--|---|
| Impulse Withstand:                         | IEC 60255-27:2013, Section 10.6.4.2<br>IEEE C37.90-2005<br>Common Mode:<br>±1.0 kV: Ethernet<br>±2.5 kV: IRIG-B<br>±5.0 kV: All other ports<br>Differential Mode:<br>0 kV: Analog Inputs, Ethernet,<br>IRIG-B, Digital Inputs<br>±5.0 kV: Standard Contact Outputs,<br>Power Supply Battery Monitors<br>+5.0 kV: Hybrid Contact Outputs | Surge Immunity:                          | IEC 61000-4-5:2005<br>Zone A:<br>±2 kV <sub>L-L</sub><br>±4 kV <sub>L-E</sub><br>±4 kV: Communication Ports<br><b>Note:</b> Cables connected to IRIG-B ports<br>shall be less than 10 m in length for Zone<br>A compliance.<br>Zone B:<br>±2 kV: Communication Ports                    |
| Insulation Resistance:                     | IEC 60255-27:2013, Section 10.6.4.4<br>>100 MΩ @ 500 Vdc  | Conducted Immunity:                      | IEC 61000-4-6:2013<br>20 V/m; (>35 V/m, 80% AM, 1 kHz)<br>Sweep: 150 kHz–80 MHz<br>Spot: 27, 68 MHz   |
| Protective Bonding:                        | IEC 60255-27:2013, Section 10.6.4.5.2<br><0.1 Ω @ 12 Vdc, 30 A for 1 min  | Power Frequency Immunity<br>(DC Inputs): | IEC 61000-4-16:2015<br>Zone A:<br>Differential: 150 V <sub>RMS</sub><br>Common Mode: 300 V <sub>RMS</sub>   |
| Ingress Protection:                        | IEC 60529:2001 + CRGD:2003<br>IEC 60255-27:2013<br>IP30 for front and rear panel<br>IP10 for rear terminals with<br>installation of ring lug<br>IP40 for front panel with installation of<br>serial port cover<br>IP52 for front panel with installation of<br>dust protection accessory  | Power Frequency Magnetic<br>Field:       | IEC 61000-4-8:2009<br>Level 5:<br>100 A/m; ≥60 Seconds; 50/60 Hz<br>1000 A/m 1 to 3 Seconds; 50/60 Hz<br><b>Note:</b> 50G1P ≥0.05 (ESS = N, 1, 2)<br>50G1P ≥0.1 (ESS = 3, 4)  |
| Max Temperature of Parts<br>and Materials: | IEC 60255-27:2013, Section 7.3  | Power Supply Immunity:                   | IEC 61000-4-11:2004<br>IEC 61000-4-17:1999/A1:2001/A2:2008<br>IEC 61000-4-29:2000<br>AC Dips & Interruptions<br>Ripple on DC Power Input<br>DC Dips & Interruptions<br>Gradual Shutdown/Startup (DC only)<br>Discharge of Capacitors<br>Slow Ramp Down/Up<br>Reverse Polarity (DC only) |
| Flammability of Insulating<br>Materials:   | IEC 60255-27:2013, Section 7.6<br>Compliant   | Damped Oscillatory<br>Magnetic Field:    | IEC 61000-4-10:2016<br>Level 5:<br>100 A/m  |
| <b>Electromagnetic (EMC) Immunity</b>      |   |  |   |
| Product Standards:                         | IEC 60255-26:2013<br>IEC 60255-27:2013<br>IEEE C37.90-2005  | <b>EMC Compatibility</b>                 |   |
| Surge Withstand Capability<br>(SWC):       | IEC 61000-4-18:2006 + A:2010<br>IEEE C37.90.1-2012<br>Slow Damped Oscillatory, Common and<br>Differential Mode:<br>±1.0 kV<br>±2.5 kV<br>Fast Transient, Common and Differential<br>Mode:<br>±4.0 kV  | Product Standards:                       | IEC 60255-26:2013   |
| Electrostatic Discharge<br>(ESD):          | IEC 61000-4-2:2008<br>IEEE C37.90.3-2001<br>Contact:<br>±8 kV<br>Air Discharge:<br>±15 kV   | Emissions:                               | IEC 60255-26:2013, Section 7.1<br>Class A<br>47 CFR Part 15B<br>Class A<br>Canada ICES-001 (A) / NMB-001 (A)  |
| Radiated RF Immunity:                      | IEEE C37.90.2-2004<br>IEC 61000-4-3:2006 + A1:2007 +<br>A2:2010<br>20 V/m (>35 V/m, 80% AM, 1 kHz)<br>Sweep: 80 MHz to 1 GHz<br>Spot: 80, 160, 450, 900 MHz<br>10 V/m (>15 V/m, 80% AM, 1 kHz)<br>Sweep: 80 MHz to 1 GHz<br>Sweep: 1.4 GHz to 2.7 GHz<br>Spot: 80, 160, 380, 450, 900, 1850,<br>2150 MHz                                | <b>Environmental</b>                     |   |
| Electrical Fast Transient<br>Burst (EFTB): | IEC 61000-4-4:2012<br>Zone A:<br>±2 kV: Communication ports<br>±4 kV: All other ports   | Product Standards:                       | IEC 60255-27:2013   |
|  |   | Cold, Operational:                       | IEC 60068-2-1:2007<br>Test Ad: 16 hours at –40°C  |
|  |   | Cold, Storage:                           | IEC 60068-2-1:2007<br>Test Ad: 16 hours at –40°C  |
|  |   | Dry Heat, Operational:                   | IEC 60068-2-2:2007<br>Test Bd: 16 hours at +85°C  |
|  |   | Dry Heat, Storage:                       | IEC 60068-2-2:2007<br>Test Bd: 16 hours at +85°C  |
|  |   | Damp Heat, Cyclic:                       | IEC 60068-2-30:2005<br>Test Db: +25 °C to +55 °C, 6 cycles (12 +<br>12-hour cycle), 95% RH  |
|  |   | Damp Heat, Steady State:                 | IEC 60068-2-78:2013<br>Severity: 93% RH, +40 °C, 10 days  |
|  |   | Vibration Resistance:                    | EC 60255-21-1:1988<br>Class 2 Endurance, Class 2 Response   |
|  |   | Shock Resistance:                        | IEC 60255-21-2:1988<br>Class 1 Shock Withstand, Class 1 Bump<br>Withstand, Class 2 Shock Response   |
|  |   | Seismic:                                 | IEC 60255-21-3:1993<br>Class 2 Quake Response   |

## Reporting Functions

### High-Resolution Data

|       |  |
|-------|--|
| Rate: | 8000 samples/second<br>4000 samples/second<br>2000 samples/second<br>1000 samples/second |
|-------|--|

Output Format: Binary COMTRADE

**Note:** Per IEEE C37.111-1999 and IEEE C37.111-2013, *Common Format for Transient Data Exchange (COMTRADE) for Power Systems*.

### Event Reports

|                     |   |
|---------------------|---|
| Length:             | 0.25–24 seconds (based on LER and SRATE settings)           |
| Volatile Memory:    | 3 s of back-to-back event reports sampled at 8 kHz          |
| Nonvolatile Memory: | At least 4 event reports of a 3 s duration sampled at 8 kHz |
| Resolution:         | 4 and 8 samples/cycle                                       |

### Event Summary

Storage: 100 summaries

### Breaker History

Storage: 128 histories

### Sequential Events Recorder

|                   |   |
|-------------------|---|
| Storage:          | 1000 entries  |
| Trigger Elements: | 250 relay elements                                      |
| Resolution:       | 0.5 ms for contact inputs<br>1/8 cycle for all elements |

## Processing Specifications

### AC Voltage and Current Inputs

8000 samples per second  
Full-cycle cosine filtering

### Subscribed AC Input Current (Nominal Secondary)

|                  |                                   |
|------------------|-----------------------------------|
| 5 A Nominal:     | S, T, U, W, X, Y, and Z terminals |
| 1 A Nominal:     | S, T, U, W, X, Y, and Z terminals |
| 1 A/5 A Nominal: | Y terminal only (REF)             |

### Protection and Control Processing

8 times per power system cycle

### Control Points

96 remote bits  
96 local control bits  
32 latch bits in protection logic  
80 latch bits in automation logic

## Relay Element Pickup Ranges and Accuracies

### Differential Elements (General)

|                      |  |
|----------------------|--|
| Number of Zones:     | 2 (A, B, and C elements)               |
| Number of Terminals: | 7                                      |
| TAP Setting Range:   | $(0.1-32.0) \cdot I_{NOM}$ A secondary |
| TAP Limit:           | $TAP_{MAX}/TAP_{MIN} \leq 35$          |
| Time-Delay Accuracy: | $\pm 0.1\%$ plus $\pm 0.125$ cycle     |

### Differential Elements (Restraint)

|                                 |  |
|---------------------------------|--|
| Pickup Range:                   | 0.1–4.0 per unit   |
| Pickup Accuracy:                | 1 A nominal: $\pm 5\%$ of setting plus $\pm 0.02$ A<br>5 A nominal: $\pm 5\%$ of setting plus $\pm 0.10$ A |
| Pickup Time<br>(If E87UNB = N): | 1.25 minimum cycle<br>1.38 typical cycle<br>1.5 maximum cycle  |

|                                 |  |
|---------------------------------|--|
| Pickup Time<br>(If E87UNB = Y): | 0.5 minimum cycle<br>0.75 typical cycle<br>1.5 maximum cycle |
|---------------------------------|--|

|                |            |
|----------------|------------|
| Slope 1        |            |
| Setting Range: | 5% to 100% |

|                |            |
|----------------|------------|
| Slope 2        |            |
| Setting Range: | 5% to 100% |

### Differential Elements (Unrestraint)

|  |  |
|--|--|
| Pickup Range:                          | $(1.0-20.0) \cdot TAP$                                       |
| Pickup Accuracy:                       | $\pm 5\%$ of setting plus $\pm 0.02 \cdot I_{NOM}$ A         |
| Pickup Time<br>(Filtered Unrestraint): | 0.7 minimum cycle<br>0.85 typical cycle<br>1.2 maximum cycle |
| Pickup Time<br>(Raw Unrestraint):      | 0.25 minimum cycle<br>0.5 typical cycle<br>1.0 maximum cycle |

**Note:** The raw unrestraint pickup is set to  $U87P \cdot \sqrt{2} \cdot 2$ .

### Harmonic Elements (2nd, 4th, 5th)

|                      |   |
|----------------------|---|
| Pickup Range:        | OFF, 5–100% of fundamental  |
| Pickup Accuracy:     | 1 A nominal $\pm 5\%$ of setting plus $\pm 0.02$ A<br>5 A nominal $\pm 5\%$ of setting plus $\pm 0.10$ A          |
| Time-Delay Accuracy: | $\pm 0.1\%$ plus $\pm 0.125$ cycle (differential element)<br>$\pm 0.1\%$ plus $\pm 0.25$ cycle (distance element) |

### Negative-Sequence Differential Element

|                                 |  |
|---------------------------------|--|
| Pickup Range:                   | 0.05–1 per unit                                      |
| Slope Range:                    | 5% to 100%   |
| Pickup Accuracy:                | $\pm 5\%$ of setting plus $\pm 0.02 \cdot I_{NOM}$ A |
| Maximum Pickup/Dropout<br>Time: | 4 cycles   |
| Winding Coverage:               | 2%   |

### Incremental Restraint and Operating Threshold Current Supervision

|                |  |
|----------------|--|
| Setting Range: | 0.1–10.0 per unit                                  |
| Accuracy:      | $\pm 5\%$ of setting plus $\pm 0.02 \cdot I_{NOM}$ |

### Open-Phase Detection Logic

Three elements per terminal (S, T, U, W, X, Y, Z)

|              |             |
|--------------|-------------|
| Pickup Range |             |
| 1 A Nominal: | 0.04–1.00 A |
| 5 A Nominal: | 0.2–5.00 A  |

|                                 |             |
|---------------------------------|-------------|
| Maximum Pickup/Dropout<br>Time: | 0.625 cycle |
|---------------------------------|-------------|

### Restricted Earth Fault (REF)

#### Elements

|                                |   |
|--------------------------------|---|
| Three Independent<br>Elements: | REF1, REF2, REF3<br>REF1F, REF1R (Element 1, forward and reverse)<br>REF2F, REF2R (Element 2, forward and reverse)<br>REF3F, REF3R (Element 3, forward and reverse) |
|--------------------------------|---|

#### Operating Quantity

|         |               |
|---------|---------------|
| Select: | IY1, IY2, IY3 |
|---------|---------------|

#### Restraint Quantity

|               |   |
|---------------|---|
| Select:       | 3I0S, 3I0T, 3I0U, 3I0W, 3I0X, and 3I0Z                              |
| Pickup Range: | 0.05–5 per unit<br>0.02–0.05 positive-sequence ratio factor (I0/I1) |

## Pickup Accuracy

|              |              |
|--------------|--------------|
| 1 A Nominal: | $\pm 0.01$ A |
| 5 A Nominal: | $\pm 0.05$ A |

## Maximum Pickup/Dropout

|       |             |
|-------|-------------|
| Time: | 2.75 cycles |
|-------|-------------|

**Mho Phase Distance Elements**

## Zones 1–4 Impedance Reach

## Setting Range

|            |  |
|------------|--|
| 5 A Model: | OFF, 0.05 to 64 $\Omega$ secondary, 0.01 $\Omega$ steps  |
| 1 A Model: | OFF, 0.25 to 320 $\Omega$ secondary, 0.01 $\Omega$ steps |

## Sensitivity

|            |  |
|------------|--|
| 5 A Model: | 0.5 $A_{p-p}$ secondary  |
| 1 A Model: | 0.1 $A_{p-p}$ secondary<br>(Minimum sensitivity is controlled by the pickup of the supervising phase-to-phase overcurrent elements for each zone.) |

|                          |   |
|--------------------------|---|
| Accuracy (Steady State): | $\pm 3\%$ of setting at line angle for SIR (source-to-line impedance ratio) $< 30$<br>$\pm 5\%$ of setting at line angle for $30 \leq \text{SIR} \leq 60$ |
|--------------------------|---|

Zone 1 Transient Overreach:  $< 5\%$  of setting plus steady-state accuracy

Maximum Operating Time: 1.75 cycles at 90% of reach and SIR = 1

**Quadrilateral Phase Distance Elements**

## Zones 1–4 Impedance Reach

## Quadrilateral Reactance Reach

|            |  |
|------------|--|
| 5 A Model: | OFF, 0.05 to 64 $\Omega$ secondary, 0.01 $\Omega$ steps  |
| 1 A Model: | OFF, 0.25 to 320 $\Omega$ secondary, 0.01 $\Omega$ steps |

## Quadrilateral Resistance Reach

## Zones 1, 2, and 3

|            |  |
|------------|--|
| 5 A Model: | OFF, 0.05 to 50 $\Omega$ secondary, 0.01 $\Omega$ steps  |
| 1 A Model: | OFF, 0.25 to 250 $\Omega$ secondary, 0.01 $\Omega$ steps |

## Zones 4

|            |  |
|------------|--|
| 5 A Model: | OFF, 0.05 to 150 $\Omega$ secondary, 0.01 $\Omega$ steps |
| 1 A Model: | OFF, 0.25 to 750 $\Omega$ secondary, 0.01 $\Omega$ steps |

## Sensitivity

|            |                 |
|------------|-----------------|
| 5 A Model: | 0.5 A secondary |
| 1 A Model: | 0.1 A secondary |

|                          |  |
|--------------------------|--|
| Accuracy (Steady State): | $\pm 3\%$ of setting at line angle for SIR $< 30$<br>$\pm 5\%$ of setting at line angle for $30 \leq \text{SIR} \leq 60$ |
|--------------------------|--|

Transient Overreach:  $< 5\%$  of setting plus steady-state accuracy

Maximum Operating Time: 1.75 cycles at 90% of reach and SIR = 1

**Mho Ground Distance Elements**

## Zones 1–4 Impedance Reach

## Mho Element Reach

|            |  |
|------------|--|
| 5 A Model: | OFF, 0.05 to 64 $\Omega$ secondary, 0.01 $\Omega$ steps  |
| 1 A Model: | OFF, 0.25 to 320 $\Omega$ secondary, 0.01 $\Omega$ steps |

## Sensitivity

|            |  |
|------------|--|
| 5 A Model: | 0.5 A secondary  |
| 1 A Model: | 0.1 A secondary<br>(Minimum sensitivity is controlled by the pickup of the supervising phase and residual overcurrent elements for each zone.) |

|                          |  |
|--------------------------|--|
| Accuracy (Steady State): | $\pm 3\%$ of setting at line angle for SIR $< 30$<br>$\pm 5\%$ of setting at line angle for $30 \leq \text{SIR} \leq 60$ |
|--------------------------|--|

Zone 1 Transient Overreach:  $< 5\%$  of setting plus steady-state accuracy

Maximum Operating Time: 1.75 cycles at 90% of reach and SIR = 1

**Quadrilateral Ground Distance Elements**

## Zones 1–4 Impedance Reach

## Quadrilateral Reactance Reach

|            |  |
|------------|--|
| 5 A Model: | OFF, 0.05 to 64 $\Omega$ secondary, 0.01 $\Omega$ steps  |
| 1 A Model: | OFF, 0.25 to 320 $\Omega$ secondary, 0.01 $\Omega$ steps |

## Quadrilateral Resistance Reach

## Zones 1, 2, and 3

|            |  |
|------------|--|
| 5 A Model: | OFF, 0.05 to 50 $\Omega$ secondary, 0.01 $\Omega$ steps  |
| 1 A Model: | OFF, 0.25 to 250 $\Omega$ secondary, 0.01 $\Omega$ steps |

## Zones 4

|            |  |
|------------|--|
| 5 A Model: | OFF, 0.05 to 150 $\Omega$ secondary, 0.01 $\Omega$ steps |
| 1 A Model: | OFF, 0.25 to 750 $\Omega$ secondary, 0.01 $\Omega$ steps |

## Sensitivity

|            |  |
|------------|--|
| 5 A Model: | 0.5 A secondary  |
| 1 A Model: | 0.1 A secondary<br>(Minimum sensitivity is controlled by the pickup of the supervising phase and residual overcurrent elements for each zone.) |

|                          |  |
|--------------------------|--|
| Accuracy (Steady State): | $\pm 3\%$ of setting at line angle for SIR $< 30$<br>$\pm 5\%$ of setting at line angle for $30 \leq \text{SIR} \leq 60$ |
|--------------------------|--|

Transient Overreach:  $< 5\%$  of setting plus steady-state accuracy

Maximum Operating Time: 1.75 cycles at 90% of reach and SIR = 1

**Out-of-Step Elements**

## Blinders (R1) Parallel to the Line Angle

|            |  |
|------------|--|
| 5 A Model: | 0.05 to 140 $\Omega$ secondary<br>–0.05 to –140 $\Omega$ secondary |
| 1 A Model: | 0.25 to 700 $\Omega$ secondary<br>–0.25 to –700 $\Omega$ secondary |

## Blinders (X1) Perpendicular to Line Angle

|            |  |
|------------|--|
| 5 A Model: | 0.05 to 140 $\Omega$ secondary<br>–0.05 to –140 $\Omega$ secondary |
| 1 A Model: | 0.25 to 700 $\Omega$ secondary<br>–0.25 to –700 $\Omega$ secondary |

## Accuracy (Steady State)

|            |  |
|------------|--|
| 5 A Model: | $\pm 5\%$ of setting plus $\pm 0.01$ A for SIR (source to line impedance ratio) $< 30$<br>$\pm 10\%$ of setting plus $\pm 0.01$ A for $30 \leq \text{SIR} \leq 60$ |
| 1 A Model: | $\pm 5\%$ of setting plus $\pm 0.05$ A for SIR (source to line impedance ratio) $< 30$<br>$\pm 10\%$ of setting plus $\pm 0.05$ A for $30 \leq \text{SIR} \leq 60$ |

## Negative-Sequence Supervision

## Setting Range

|            |                           |
|------------|---------------------------|
| 5 A Model: | 0.5–100.0 A, 0.01 A steps |
| 1 A Model: | 0.1–20.0 A, 0.01 A steps  |

## Accuracy (Steady State)

|            |  |
|------------|--|
| 5 A Model: | $\pm 3\%$ of setting plus $\pm 0.05$ A |
| 1 A Model: | $\pm 3\%$ of setting plus $\pm 0.01$ A |

Transient Overreach:  $< 5\%$  of setting

**Instantaneous/Definite-Time Overcurrent Elements (50)**

## Phase- and Negative-Sequence, Ground-Residual Elements

## Pickup Range

|              |                                       |
|--------------|---------------------------------------|
| 5 A Nominal: | 0.25–100.00 A secondary, 0.01-A steps |
| 1 A Nominal: | 0.05–20.00 A secondary, 0.01-A steps  |

## Accuracy (Steady State)

|              |  |
|--------------|--|
| 5 A Nominal: | $\pm 3\%$ of setting plus $\pm 0.05$ A |
| 1 A Nominal: | $\pm 3\%$ of setting plus $\pm 0.01$ A |

|   |   |
|---|---|
| Transient Overreach (Phase and Ground Residual) |   |
| 5 A Nominal:                                    | ±5% of setting plus ±0.10 A             |
| 1 A Nominal:                                    | ±5% of setting plus ±0.02 A             |
| Transient Overreach (Negative Sequence)         |   |
| 5 A Nominal:                                    | ±6% of setting plus ±0.10 A             |
| 1 A Nominal:                                    | ±6% of setting plus ±0.02 A             |
| Time-Delay Range:                               | 0.00–16000.00 cycles, 0.125 cycle steps |
| Timer Accuracy:                                 | ±0.1% of setting plus ±0.25 cycle       |
| Maximum Pickup/Dropout Time:                    | 1.5 cycles                              |

### Adaptive Time-Overcurrent Elements (51)

|  |  |
|--|--|
| Pickup Range (Adaptive Within the Range)   |  |
| 5 A Nominal:   | 0.25–16.00 A secondary, 0.01 A steps   |
| 1 A Nominal:   | 0.05–3.20 A secondary, 0.01 A steps  |
| Accuracy (Steady State)  |  |
| 5 A Nominal:   | ±3% of setting plus ±0.05 A  |
| 1 A Nominal:   | ±3% of setting plus ±0.01 A  |
| Transient Overreach  |  |
| 5 A Nominal:   | ±5% of setting plus ±0.10 A  |
| 1 A Nominal:   | ±5% of setting plus ±0.02 A  |
| Time-Dial Range (Adaptive Within the Range)                                      |  |
| U.S.:  | 0.50–15.00, 0.01 steps   |
| IEC:   | 0.05–1.00, 0.01 steps  |
| Curve Timing Accuracy:   | ±1.50 cycles plus ±4% of curve time (for current between 2 and 30 multiples of pickup) |
| Curves operate on definite time for current greater than 30 multiples of pickup. |  |
| Reset:   | 1 power cycle or Electromechanical Reset Emulation time                                |

### Phase Directional Elements (67)

|                      |   |
|----------------------|---|
| Number:              | 7 (1 each for S, T, U, W, X, Y, Z)                            |
| Polarization:        | Positive-sequence memory voltage<br>Negative-sequence voltage |
| Time-Delay Range:    | 0.000–16,000 cycles, 0.125 cycle increment                    |
| Time-Delay Accuracy: | ±0.1% of setting plus ±0.25 cycle                             |

### Phase-to-Phase Directional Elements

|                        |  |
|------------------------|--|
| Number:                | 7 (1 each for S, T, U, W, X, Y, Z)                     |
| Polarization Quantity: | Negative-sequence voltage                              |
| Operate Quantity:      | Negative-sequence current (3I <sub>2</sub> )           |
| Sensitivity:           | 0.05 • I <sub>NOM</sub> A of secondary 3I <sub>2</sub> |
| Accuracy:              | ±0.05 Ω secondary                                      |
| Transient Overreach:   | +5% of set reach                                       |
| Max. Delay:            | 1.75 cycles  |
| Time-Delay Range:      | 0.000–16,000 cycles, 0.125-cycle increment             |
| Time-Delay Accuracy:   | ±0.1% of setting plus ±0.25 cycle                      |

### Ground Directional Elements

|                        |   |
|------------------------|---|
| Number:                | 7 (1 each for S, T, U, W, X, Y, Z)  |
| Outputs:               | Forward and reverse   |
| Polarization Quantity: | Zero-sequence voltage   |
| Operate Quantity:      | Zero-sequence current 3I <sub>0</sub> ,<br>where 3I <sub>0</sub> = IA + IB + IC |
| Sensitivity:           | 0.05 • I <sub>NOM</sub> A of secondary 3I <sub>0</sub>                          |
| Accuracy:              | ±0.05 Ω secondary   |

|                      |                  |
|----------------------|------------------|
| Transient Overreach: | +5% of set reach |
| Max. Delay:          | 1.75 cycles      |

### Undervoltage and Overvoltage Elements

#### Pickup Ranges

|                          |  |
|--------------------------|--|
| Phase Elements:          | 2–300 V <sub>L-N</sub> in 0.01-V steps |
| Phase-to-Phase Elements: | 4–520 V <sub>L-L</sub> in 0.01-V steps |
| Sequence Elements:       | 2–300 V <sub>L-N</sub> in 0.01-V steps |

#### Pickup Accuracy (Steady State)

|                                  |                            |
|----------------------------------|----------------------------|
| Phase Elements:                  | ±3% of setting plus ±0.5 V |
| Phase-to-Phase Elements (Wye):   | ±3% of setting plus ±0.5 V |
| Phase-to-Phase Elements (Delta): | ±3% of setting plus ±1 V   |
| Sequence Elements:               | ±5% of setting plus ±1 V   |

#### Pickup Accuracy (Transient Overreach)

|                                  |     |
|----------------------------------|-----|
| Phase Elements:                  | ±5% |
| Phase-to-Phase Elements (Wye):   | ±5% |
| Phase-to-Phase Elements (Delta): | ±5% |
| Sequence Elements:               | ±5% |

#### Maximum Pickup/Dropout Time

|                                |            |
|--------------------------------|------------|
| Phase Elements:                | 1.5 cycles |
| Phase-to-Phase Elements (Wye): | 1.5 cycles |
| Sequence Elements:             | 1.5 cycles |

### Under- and Overfrequency Elements

|   |  |
|---|--|
| Pickup Range:                           | 40.01–69.99 Hz, 0.01-Hz steps  |
| Accuracy, Steady State Plus Transient:  | ±0.005 Hz for frequencies between 40.00 and 70.00 Hz                 |
| Maximum Pickup/Dropout Time:            | 3.0 cycles   |
| Time-Delay Range:                       | 0.04–300.00 s, 0.001-s increment                                     |
| Time-Delay Accuracy:                    | ±0.1% of setting plus ±0.0042 s                                      |
| Pickup Range, Undervoltage Blocking:    | 20.00–200.00 V <sub>L-N</sub> (Wye) or V <sub>L-L</sub> (Open-Delta) |
| Pickup Accuracy, Undervoltage Blocking: | ±2% of setting plus ±0.5 V   |

### Volts/Hertz Elements (24)

#### Definite-Time Element

|                                |  |
|--------------------------------|--|
| Pickup Range:                  | 100% to 200% steady state              |
| Pickup Accuracy, Steady-State: | ±1% of setting                         |
| Maximum Pickup/Dropout Time:   | 1.5 cycles                             |
| Time-Delay Range:              | 0.0–400.00 s                           |
| Time-Delay Accuracy:           | ±0.1% of setting plus ±4.2 ms at 60 Hz |
| Reset Time-Delay Range:        | 0.00–400.00 s                          |

#### User-Definable Curve Element

|                         |                |
|-------------------------|----------------|
| Pickup Range:           | 100% to 200%   |
| Pickup Accuracy:        | ±1% of setting |
| Reset Time-Delay Range: | 0.00–400.00 s  |

### Breaker Failure Instantaneous Overcurrent

|               |                           |
|---------------|---------------------------|
| Setting Range |                           |
| 5 A Nominal:  | 0.50–50 A, 0.01-A steps   |
| 1 A Nominal:  | 0.10–10.0 A, 0.01-A steps |

|                       |   |
|-----------------------|---|
| Accuracy              |   |
| 5 A Nominal:          | $\pm 3\%$ of setting plus $\pm 0.05$ A        |
| 1 A Nominal:          | $\pm 3\%$ of setting plus $\pm 0.01$ A        |
| Transient Overreach   |   |
| 5 A Nominal:          | $\pm 5\%$ of setting plus $\pm 0.1$ A         |
| 1 A Nominal:          | $\pm 5\%$ of setting plus $\pm 0.02$ A        |
| Maximum Pickup Time:  | 1.5 cycles                                    |
| Maximum Dropout Time: | Less than 1 cycle                             |
| Maximum Reset Time:   | Less than 1 cycle                             |
| Timers                |   |
| Setting Range:        | 0–6000 cycles, 0.125-cycle steps              |
| Time-Delay Accuracy:  | $\pm 0.1\%$ of setting plus $\pm 0.125$ cycle |

### Directional Overpower/Underpower Element

|                       |   |
|-----------------------|---|
| Operating Quantities: | OFF, 3PmF, 3QmF, 3PqpF, 3QqpF<br>( $m = S, T, U, W, X, Y, Z$<br>$qp = ST, TU, UW, WX$ )                             |
| Pickup Range:         | –20000.00 VA (secondary) to 20000.00 VA<br>(secondary, 0.01 steps)<br>Pickup range cannot fall within $\pm I_{NOM}$ |
| Pickup Accuracy:      | $\pm 3\%$ of setting plus $\pm 5$ VA, power factor<br>> $\pm 0.5$ at nominal frequency                              |
| Time-Delay Range:     | 0.000–16,000 cycles, 0.25-cycle increment   |
| Time-Delay Accuracy:  | $\pm 0.1\%$ of setting plus $\pm 0.25$ cycle  |

### Bay Control

|                          |  |
|--------------------------|--|
| Breakers:                | 7 maximum                                    |
| Disconnects (Isolators): | 20 maximum                                   |
| Timers                   |  |
| Setting Range:           | 1–99999 cycles, 1-cycle steps                |
| Time-Delay Accuracy:     | $\pm 0.1\%$ of setting plus $\pm 0.25$ cycle |

### Station DC Battery System Monitor Specifications

|   |   |
|---|---|
| Rated Voltage:  | 24–250 Vdc  |
| Operational Voltage Range:                              | 0–300 Vdc   |
| Sampling Rate:  | 2 kHz   |
| Processing Rate:  | 1/8 cycle   |
| Operating Time:   | Less than 1.5 cycles (all elements except ac ripple)<br>Less than 1.5 seconds (ac ripple element)                                   |
| Setting Range   |   |
| 15–300 Vdc, 1 Vdc steps (all elements except ac ripple) |   |
| 1–300 Vac, 1 Vac steps (ac ripple element)              |   |
| Accuracy  |   |
| Pickup Accuracy:  | $\pm 3\%$ of setting plus $\pm 2$ Vdc (all elements except ac ripple)<br>$\pm 10\%$ of setting plus $\pm 2$ Vac (ac ripple element) |

### Metering Accuracy

All metering accuracies are based on an ambient temperature of 20°C and nominal frequency.

#### Currents

|                            |  |
|----------------------------|--|
| Phase Current Magnitude    |  |
| 5 A Model:                 | $\pm 0.2\%$ plus $\pm 4$ mA (0.25–15 A secondary)          |
| 1 A Model:                 | $\pm 0.2\%$ plus $\pm 0.8$ mA (0.05–3.0 A secondary)       |
| Phase Current Angle        |  |
| All Models:                | $\pm 0.2^\circ$ in the current range (0.5–3.0) • $I_{NOM}$ |
| Sequence Current Magnitude |  |
| 5 A Model:                 | $\pm 0.3\%$ plus $\pm 4$ mA (0.25–15 A secondary)          |
| 1 A Model:                 | $\pm 0.3\%$ plus $\pm 0.8$ mA (0.05–3 A secondary)         |

#### Sequence Current Angle

All Models:  $\pm 0.3^\circ$  in the current range (0.5–3.0) •  $I_{NOM}$

### Voltages

#### 300 V Maximum Inputs

|   |   |
|---|---|
| Phase and Phase-to-Phase Voltage Magnitude: | $\pm 2.5\%$ plus $\pm 1$ V (5–33.5 V)<br>$\pm 0.1\%$ (33.5–300 V) |
| Phase and Phase-to-Phase Angle:             | $\pm 1.0^\circ$ (5–33.5 V)<br>$\pm 0.5^\circ$ (33.5–300 V)        |
| Sequence Voltage Magnitude (V1, V2, 3V0):   | $\pm 2.5\%$ plus $\pm 1$ V (5–33.5 V)<br>$\pm 0.1\%$ (33.5–300 V) |
| Sequence Voltage Angle (V1, V2, 3V0):       | $\pm 1.0^\circ$ (5–33.5 V)<br>$\pm 0.5^\circ$ (33.5–300 V)        |

#### 8 V LEA Maximum Inputs

|   |  |
|---|--|
| Phase and Phase-to-Phase Voltage Magnitude: | $\pm 0.3\%$ (0.2–0.6 V)<br>$\pm 0.1\%$ (0.6–8.0 V)   |
| Phase and Phase-to-Phase Angle:             | $\pm 0.5^\circ$ (0.2–8.0 V)                          |
| Sequence Voltage Magnitude (V1, V2, 3V0):   | $\pm 0.3\%$ , (0.2–0.6 V)<br>$\pm 0.1\%$ (0.6–8.0 V) |
| Sequence Voltage Angle (V1, V2, 3V0):       | $\pm 0.5^\circ$ (0.2–8.0 V)                          |

### Power

|   |  |
|---|--|
| MW (P), Per Phase (Wye), 3 $\phi$ (Wye or Delta) Per Terminal   | $\pm 1\%$ (0.1–1.2) • $I_{NOM}$ , 33.5–300 Vac, PF = 1, 0.5 lead, lag (1 $\phi$ )<br>$\pm 0.7\%$ (0.1–1.2) • $I_{NOM}$ , 33.5–300 Vac, PF = 1, 0.5 lead, lag (3 $\phi$ ) |
| MVAr (Q), Per Phase (Wye), 3 $\phi$ (Wye or Delta) Per Terminal | $\pm 1\%$ (0.1–1.2) • $I_{NOM}$ , 33.5–300 Vac, PF = 0, 0.5 lead, lag (1 $\phi$ )<br>$\pm 0.7\%$ (0.1–1.2) • $I_{NOM}$ , 33.5–300 Vac, PF = 0, 0.5 lead, lag (3 $\phi$ ) |
| MVA (S), Per Phase (Wye), 3 $\phi$ (Wye or Delta) Per Terminal  | $\pm 1\%$ (0.1–1.2) • $I_{NOM}$ , 33.5–300 Vac, PF = 1, 0.5 lead, lag (1 $\phi$ )<br>$\pm 0.7\%$ (0.1–1.2) • $I_{NOM}$ , 33.5–300 Vac, PF = 1, 0.5 lead, lag (3 $\phi$ ) |
| PF, Per Phase (Wye), 3 $\phi$ (Wye or Delta) Per Terminal       | $\pm 1\%$ (0.1–1.2) • $I_{NOM}$ , 33.5–300 Vac, PF = 1, 0.5 lead, lag (1 $\phi$ )<br>$\pm 0.7\%$ (0.1–1.2) • $I_{NOM}$ , 33.5–300 Vac, PF = 1, 0.5 lead, lag (3 $\phi$ ) |

### Energy

|   |  |
|---|--|
| MWh (P), Per Phase (Wye), 3 $\phi$ (Wye or Delta)   | $\pm 1\%$ (0.1–1.2) • $I_{NOM}$ , 33.5–300 Vac, PF = 1, 0.5 lead, lag (1 $\phi$ )<br>$\pm 0.7\%$ (0.1–1.2) • $I_{NOM}$ , 33.5–300 Vac, PF = 1, 0.5 lead, lag (3 $\phi$ ) |
| MVARh (Q), Per Phase (Wye), 3 $\phi$ (Wye or Delta) | $\pm 1\%$ (0.1–1.2) • $I_{NOM}$ , 33.5–300 Vac, PF = 0, 0.5 lead, lag (1 $\phi$ )<br>$\pm 0.7\%$ (0.1–1.2) • $I_{NOM}$ , 33.5–300 Vac, PF = 0, 0.5 lead, lag (3 $\phi$ ) |

### Demand/Peak Demand Metering

|   |  |
|---|--|
| Time Constants:                             | 5, 10, 15, 30, and 60 minutes                                      |
| IA, IB, and IC per Terminal:                | $\pm 0.2\%$ plus $\pm 0.0008$ • $I_{NOM}$<br>(0.1–1.2) • $I_{NOM}$ |
| 3I2 per Terminal                            |  |
| 3I0 (IG) per Terminal (Wye-Connected Only): | $\pm 0.3\%$ plus $\pm 0.0008$ • $I_{NOM}$<br>(0.1–20) • $I_{NOM}$  |

### Optional RTD Elements

#### (Models Compatible With SEL-2600 Series RTD Module)

12 RTD inputs via SEL-2600 Series RTD Module and SEL-2800 Fiber-Optic Transceiver

Monitor Ambient or Other Temperatures

PT 100, NI 100, NI 120, and CU 10 RTD-Types Supported, Field Selectable

As long as 500 m Fiber-Optic Cable to SEL-2600 Series RTD Module

**Synchrophasor**

|   |  |
|---|--|
| Number of Synchrophasor Data Streams:   | 5  |
| Number of Synchrophasors for Each Stream (Terminal Z Ordered as a Voltage Terminal With Dual AC Input Cards): | 24 phase synchrophasors (6 voltages and 18 currents)<br>8 positive-Sequence synchrophasors (2 voltages and 6 currents) |
| Number of Synchrophasors for Each Stream (Terminal Z Ordered as a Current Terminal With Dual AC Input Cards): | 24 phase synchrophasors (3 voltages and 21 currents)<br>8 positive-sequence synchrophasors (1 voltage and 7 currents)  |
| Number of Synchrophasors for Each Stream (Single AC Input Card):  | 12 phase synchrophasors (3 voltages and 9 currents)<br>4 positive-sequence synchrophasors (1 voltage and 3 currents)   |
| Number of User Analogs for Each Stream:   | 16   |
| Number of User Digitals for Each Stream:  | 64   |
| Synchrophasor Protocol:   | IEEE C37.118-2005,<br>SEL Fast Message (Legacy)  |
| Synchrophasor Data Rate:  | As many as 60 messages per second  |

**Synchrophasor Accuracy**

|                   |   |
|-------------------|---|
| Voltage Accuracy: | $\pm 1\%$ Total Vector Error (TVE)<br>Range 30–150 V, $f_{NOM} \pm 5$ Hz                    |
| Current Accuracy: | $\pm 1\%$ Total Vector Error (TVE)<br>Range $(0.1-2.0) \cdot I_{NOM}$ A, $f_{NOM} \pm 5$ Hz |
| Current Accuracy: | $\pm 1\%$ Total Vector Error (TVE)<br>Range $(0.1-2.0) \cdot I_{NOM}$ A, $f_{NOM} \pm 5$ Hz |

|                               |   |
|-------------------------------|---|
| Synchrophasor Data Recording: | Records as much as 120 s<br>IEEE C37.232-2011, File Naming Convention |
|-------------------------------|---|

**Breaker Monitoring**

|   |   |
|---|---|
| Running Total of Interrupted Current (kA) per Pole: | $\pm 5\%$ plus $\pm 0.02 \cdot I_{NOM}$ |
| Percent kA Interrupted for Trip Operations:         | $\pm 5\%$                               |
| Percent Breaker Wear per Pole:                      | $\pm 5\%$                               |
| Compressor/Motor Start and Run Time:                | $\pm 1$ s                               |
| Time Since Last Operation:                          | $\pm 1$ day                             |

## Technical Support

---

We appreciate your interest in SEL products and services. If you have questions or comments, please contact us at:

Schweitzer Engineering Laboratories, Inc.  
2350 NE Hopkins Court  
Pullman, WA 99163-5603 U.S.A.  
Tel: +1.509.338.3838  
Fax: +1.509.332.7990  
Internet: [selinc.com/support](http://selinc.com/support)  
Email: [info@selinc.com](mailto:info@selinc.com)

# Notes

---

---

© 2018-2026 by Schweitzer Engineering Laboratories, Inc.

Content subject to change without notice.

Unless otherwise agreed in writing, all SEL product sales are subject to SEL's terms and conditions located here: <https://selinc.com/company/termsandconditions/>.

**SCHWEITZER ENGINEERING LABORATORIES, INC.**

2350 NE Hopkins Court • Pullman, WA 99163-5603 U.S.A.

Tel: +1.509.332.1890 • Fax: +1.509.332.7990

selinc.com • info@selinc.com



\* P D S 4 8 7 E - 0 5 \*