



# SEL-700G Family of Generator and Intertie Protection Relays

Basic to Comprehensive Protection

Intertie Protection

Basic Dual-Feeder Overcurrent Protection



**SEL-700G0, SEL-700G1**

Small, Medium, and Large Generators



**SEL-700GT**

Intertie and Generator



**SEL-700GW**

Wind Generator

## New Features

- ▶ Extended support for low-energy analog (LEA) voltage sensor inputs and Rogowski coil or low power current transformer (LPCT) inputs. The optional Slot Z and Slot E card allows low energy voltages and currents analogs selection.
- ▶ IEC 61850 simulation mode, local/remote control authority, and functional naming support for easy commissioning and control.
- ▶ Rapid Spanning Tree Protocol (RSTP) provides faster recovery in response to network changes and failures in switched mode applications.
- ▶ Disconnect control from the Bay Screens application.
- ▶ Three-position disconnects for increased safety.
- ▶ A built-in web server that simplifies access to relay data and supports firmware upgrade.
- ▶ Faster firmware downloads via the Ethernet port.
- ▶ IEEE 1588-2008 firmware-based Precision Time Protocol (PTP) provides ease of integration.

- EtherNet/IP provides ease of integration for industrial automation applications.
- Visualization of system parameters and synchronization of your generator to your system with built-in Synchroscope/Auto Synchronizer applications on the touchscreen display.

## Major Features and Benefits

---

The SEL-700G family of protection relays provides unsurpassed protection, integration, and control features in a flexible, compact, and cost-effective package.

### ➤ **Basic Generator Protection Features (SEL-700G0):**

- Ground differential
- Sensitive restricted earth fault
- Thermal overload
- Phase, negative-sequence, residual-ground, and neutral-ground overcurrent elements for backup
- Residual-ground and neutral-ground time-overcurrent elements
- Directional residual-ground and neutral-ground overcurrent elements
- Current unbalance element
- Voltage-controlled, voltage-restrained time-overcurrent element for backup protection
- Breaker failure protection for three-pole breaker
- Under- and overvoltage elements
- Inverse-time over- and undervoltage elements
- Loss-of-potential element
- Volts/hertz or overexcitation protection
- Directional power elements
- Loss-of-field
- Over- and underfrequency protection elements
- Off-frequency time accumulators
- Rate-of-change-of- frequency elements
- Vector shift elements for islanding detection
- Inadvertent energization protection
- RTD protection (requires internal or external SEL-2600 RTD option)
- Field ground using an SEL-2664 Field Ground Module.

### ➤ **Optional Generator Protection Features (SEL-700G0+, SEL-700G1, SEL-700G1+):**

- Generator synchronism-check elements
- Synchronism-check under- and overvoltage elements
- Inverse-time over- and undervoltage elements
- Autosynchronism
- Synchroscope
- Backup compensator distance elements
- Out-of-step elements
- Vector shift elements for islanding detection
- 100% stator ground protection elements
- Dual-slope current differential protection with harmonic blocking and restraint elements to provide sensitive and secure protection.
- The high-security mode provides additional security against CT saturation during external events including external transformer energization, external faults, etc.

### ➤ **Intertie Protection Features (SEL-700GT):**

- Phase, negative-sequence, and residual-ground overcurrent elements for overcurrent, time-overcurrent, and directional overcurrent protection
- Breaker failure protection for three-pole breaker
- Under- and overvoltage elements
- Inverse-time over- and undervoltage elements
- Loss-of-potential element
- Directional power elements
- Over- and underfrequency protection elements
- Rate-of-change-of-frequency elements
- Vector shift elements for islanding detection
- Tie synchronism-check elements
- Synchroscope
- RTD protection (requires internal or external SEL-2600 RTD option).

- **Optional Intertie Protection Features (SEL-700GT+).** Addition of basic generator protection features, as shown above for the SEL-700G0, to create intertie and generator protection. The relay also includes generator synchronism-check, synchroscope, and autosynchronism functions.

- **Wind Generator Protection Features (SEL-700GW).** The SEL-700GW is configured with two sets of phase, negative-sequence, and residual-ground overcurrent elements, and phase, negative-sequence, and residual-ground time-overcurrent elements to provide dual-feeder protection in a multiple wind generator network application. The relay also includes three-pole breaker failure protection for two breakers.
- **Generator Monitoring.** Monitor ambient and generator winding temperature using optional analog inputs or RTDs and protect the generator from thermal damage. Use off-frequency time accumulators and protect steam turbine blades from fatigue failures because of off-frequency vibration.
- **Optional Low-Energy Analog (LEA) Voltage Sensor Inputs and Rogowski Coil/LPCT Currents Inputs.** The LEA input range for voltages is as high as 8 Vac rms. Based on the nominal feeder current, the relay automatically sets the gain for the LEA current channel inputs, which allows for a wide range of primary currents.
- **Operator Controls.** Eight programmable front-panel pushbuttons each with two programmable tricolor LEDs allow for a wide variety of uses, including easy trip and close control and status indications for a breaker. Implement local and remote operator control schemes using 32 local and 32 remote control bits.
- **Integrated Web Server.** View settings and metering and monitoring data, download event reports, and upgrade relay firmware with an intuitive password-protected web server.
- **Relay and Logic Settings Software.** ACSELERATOR QuickSet<sup>®</sup> SEL-5030 Software reduces engineering costs for relay settings and logic programming. The tools in QuickSet make it easy to develop SELOGIC<sup>®</sup> control equations. Use the built-in phasor display to verify proper CT polarity and phasing. Use the synchroscope to watch the autosynchronization controls.
- **Metering and Reporting.** Built-in metering functions eliminate separately mounted metering devices. Analyze Sequential Events Recorder (SER) reports and oscillographic event reports for rapid commissioning, testing, and post-fault diagnostics. Unsolicited SER protocol allows station-wide collection of binary SER messages.
- **Front-Panel HMI.** Navigate the relay HMI using a 2 x 16-character LCD or optional 5-inch, color, 800 x 480-pixel touchscreen display.
- **Additional Standard Features.** Includes Modbus<sup>®</sup> RTU, Event Messenger support, MIRRORED BITS<sup>®</sup> communications, built-in web server and communications, load profile report, 128 remote analogs, support for 12 external RTDs (SEL-2600 module), IRIG-B input, advanced SELOGIC, configurable labels, IEEE C37.118-2005 compliant synchrophasor protocol, and fiber-optic serial port.
- **Optional Communications Protocols.** Optional communications protocols include IEC 61850 Edition 2, Modbus TCP/IP, Simple Network Time Protocol (SNTP), IEEE 1588-2008 firmware-based PTP, EtherNet/IP, DNP3 LAN/WAN, DNP3 serial, IEC 60870-5-103, RSTP, and PRP. With an Ethernet equipped relay, use the integrated web server to view settings and metering and monitoring data, download reports, and upgrade firmware.
- **Optional Communications Ports.** Elective communications ports include EIA-232 or EIA-485 multimode fiber-optic serial port and single or dual, copper or fiber-optic Ethernet ports.
- **Optional I/O Cards.** Digital and analog I/O options include 4 AI/4 AO, 4 DI/4 DO, 8 DI, 8 DO, 8 AI, 3 DI/4 DO/1 AO, 4 DI/3 DO, and 14 DI. An optional 10 internal RTD card is also available for the SEL-700G. Conformal coating for chemically harsh and/or high moisture environments is also available as an option.
- **Language Support.** Choose English or Spanish for your serial ports, including the front-panel serial port. The standard relay front-panel overlay is in English; a Spanish overlay is available as an ordering option.

## Model Comparison Guide: Exploring the SEL-700G Options

### AC Analog Inputs

The SEL-700G has between 6 and 14 analog inputs, depending on the model and options selected. All analog inputs are recorded for event reporting and oscillography. *Table 1* shows the current and voltage inputs for the different models available. The SEL-700G supports both conventional current and potential transformer inputs and

low-energy analog sensor inputs. For conventional option, current inputs are 1 A or 5 A nominal rating and voltage inputs are 300 V continuous rating. For the LEA option, the current sensor inputs are based on Rogowski coils/low-power current transformers (LPCT), and the voltage sensor inputs are based on resistive or capacitive voltage dividers.

**Table 1 Current (ACI) and Voltage (AVI) Card Selection for SEL-700G Models**

Model	Description	Slot Z Card (MOT Digits)	Slot Z Inputs	Slot E Card (MOT Digits)	Slot E Inputs
700G0	Basic generator protection	4 ACI/3 AVI (81, 82, 85, 86, L1)	IAX, IBX, ICX, IN, VAX, VBX, VCX	(OX)	
700G0+	Basic generator protection plus (see <i>Table 2</i> for additional protection elements)	4 ACI/3 AVI (81, 82, 85, 86, L1)	IAX, IBX, ICX, IN, VAX, VBX, VCX	2 AVI (74, L4)	VS, VN
700G1	Full generator protection	4 ACI/3 AVI (81, 82, 85, 86, L1)	IAX, IBX, ICX, IN, VAX, VBX, VCX	3 ACIE (73, 77, L3)	IAY, IBY, ICY
700G1+	Full generator protection plus (see <i>Table 2</i> for additional protection elements)	4 ACI/3 AVI (81, 82, 85, 86, L1)	IAX, IBX, ICX, IN, VAX, VBX, VCX	3 ACI/2 AVI (72, 76, L2)	IAY, IBY, ICY, VS, VN
700GT	Intertie protection	1 ACI (84, 88, L4)	IN	3 ACI/4 AVI (71, 75, L1)	IAY, IBY, ICY, VS, VAY, VBY, VCY
700GT+	Intertie and generator protection	4 ACI/3 AVI (81, 82, 85, 86, L1)	IAX, IBX, ICX, IN, VAX, VBX, VCX	3 ACI/4 AV (71, 75, L1)	IAY, IBY, ICY, VS, VAY, VBY, VCY
700GW	Basic wind generator protection	3 ACIZ (83, 87, L3)	IAX, IBX, ICX	3 ACIE (73, 77, L3)	IAY, IBY, ICY

The SEL-700G offers an extensive variety of protection features, depending on the model and options selected. *Table 2* shows the protection features available in the different models.

**Table 2 SEL-700G Protection Elements (Sheet 1 of 2)**

Protection Elements	Basic Generator Protection	Basic With				Intertie Protection	Intertie and Generator Protection	Wind Generator Protection
		21C, 25, 64G, 78	21C, 78, 87	21C, 25, 64G, 78, 87				
		700G0	700G0+	700G1	700G1+			
87	Phase Differential			X	X			
87N	Ground Differential	X	X	X	X		X	
REF	Restricted Earth Fault	X	X	X	X		X	
64G	100% Stator Ground		X		X			
64F	Field Ground	X	X	X	X		X	X
40	Loss of Field	X	X	X	X		X	
49T	Thermal Overload	X	X	X	X		X	
49RTD	RTDs	X	X	X	X	X	X	X
46	Current Unbalance	X	X	X	X		X	
24	Volts/Hz	X	X	X	X		X	
78	Out of Step		X	X	X			
78VS	Vector Shift	X	X	X	X	X	X	
INAD	Inadvertent Energization	X	X	X	X		X	
21C	Compensator Distance		X	X	X			
51C	Voltage-Controlled TOC	X	X	X	X		X	
51V	Voltage-Restrained TOC	X	X	X	X		X	
51PX	Phase Time-Overcurrent	X	X	X	X		X	X
51PY	Phase Time-Overcurrent					X <sup>a</sup>	X <sup>a</sup>	X
51QX	Neg.-Seq. Time-Overcurrent	X	X	X	X		X	X
51QY	Neg.-Seq. Time-Overcurrent					X <sup>a</sup>	X <sup>a</sup>	X
51GX	Ground Time-Overcurrent	X <sup>a</sup>	X <sup>a</sup>	X <sup>a</sup>	X <sup>a</sup>		X <sup>a</sup>	X
51GY	Ground Time-Overcurrent					X <sup>a</sup>	X <sup>a</sup>	X

Table 2 SEL-700G Protection Elements (Sheet 2 of 2)

Protection Elements		Basic Generator Protection	Basic With			Intertie Protection	Intertie and Generator Protection	Wind Generator Protection
			21C, 25, 64G, 78	21C, 78, 87	21C, 25, 64G, 78, 87			
		700G0	700G0+	700G1	700G1+	700GT	700GT+	700GW
51N	Neutral Time-Overcurrent	X <sup>a</sup>	X <sup>a</sup>	X <sup>a</sup>	X <sup>a</sup>	X	X <sup>a</sup>	
50PX	Phase Overcurrent	X	X	X	X		X	X
50PY	Phase Overcurrent			X	X	X	X	X
67PY	Directional Phase Overcurrent					X	X	
50QX	Neg.-Seq. Overcurrent	X	X	X	X		X	X
50QY	Neg.-Seq. Overcurrent			X	X	X	X	X
67QY	Directional Neg.-Seq. Overcurrent					X	X	
50GX	Ground Overcurrent	X	X	X	X		X	X
67GX	Directional Ground Overcurrent	X	X	X	X		X	
50GY	Ground Overcurrent			X	X	X	X	X
67GY	Directional Ground Overcurrent					X	X	
50N	Neutral Overcurrent	X <sup>b</sup>	X <sup>b</sup>	X <sup>b</sup>	X <sup>b</sup>	X	X <sup>b</sup>	
67N	Directional Neutral Overcurrent	X	X	X	X		X	
27X	Undervoltage	X	X	X	X		X	
27Y	Undervoltage					X	X	
27S	Synchronism Undervoltage		X		X	X	X	
27I	Inverse-Time Undervoltage <sup>c</sup>	X	X	X	X	X	X	
59X	Oversvoltage (P, Q, G)	X	X	X	X		X	
59Y	Oversvoltage (P, Q, G)					X	X	
59S	Synchronism Oversvoltage		X		X	X	X	
59I	Inverse-Time Oversvoltage <sup>d</sup>	X	X	X	X	X	X	
32X	Directional Power	X	X	X	X		X	
32Y	Directional Power					X	X	
81X	Over/Underfrequency	X	X	X	X		X	
81Y	Over/Underfrequency					X	X	
81RX	Rate-of-Change of Frequency	X	X	X	X		X	
81RY	Rate-of-Change of Frequency					X	X	
BFX	Breaker Failure	X	X	X	X		X	X
BFY	Breaker Failure					X	X	X
60LOPX	Loss of Potential	X	X	X	X		X	
60LOPY	Loss of Potential					X	X	
25 GEN	Synchronism Check		X		X		X	
25 TIE	Synchronism Check					X	X	
	Autosynchronizer		X		X		X	
	Off-Frequency Accumulators	X	X	X	X		X	


<sup>a</sup> These inverse time-overcurrent elements have directional control.

<sup>b</sup> The 50N element uses the 67NnP and 67NnT Relay Word bits for the SEL-700G0, SEL-700G0+, SEL-700G1, SEL-700G1+, and SEL-700GT+ models.

<sup>c</sup> Two elements are available (select X- and/or Y-side phase, phase-to-phase, positive sequence, or synchronism voltage VS, depending on the part number).

<sup>d</sup> Two elements are available (select X- and/or Y-side phase, phase-to-phase, residual, positive sequence, negative sequence, neutral voltage VN, or synchronism voltage VS, depending on the part number).


# Functional Overview

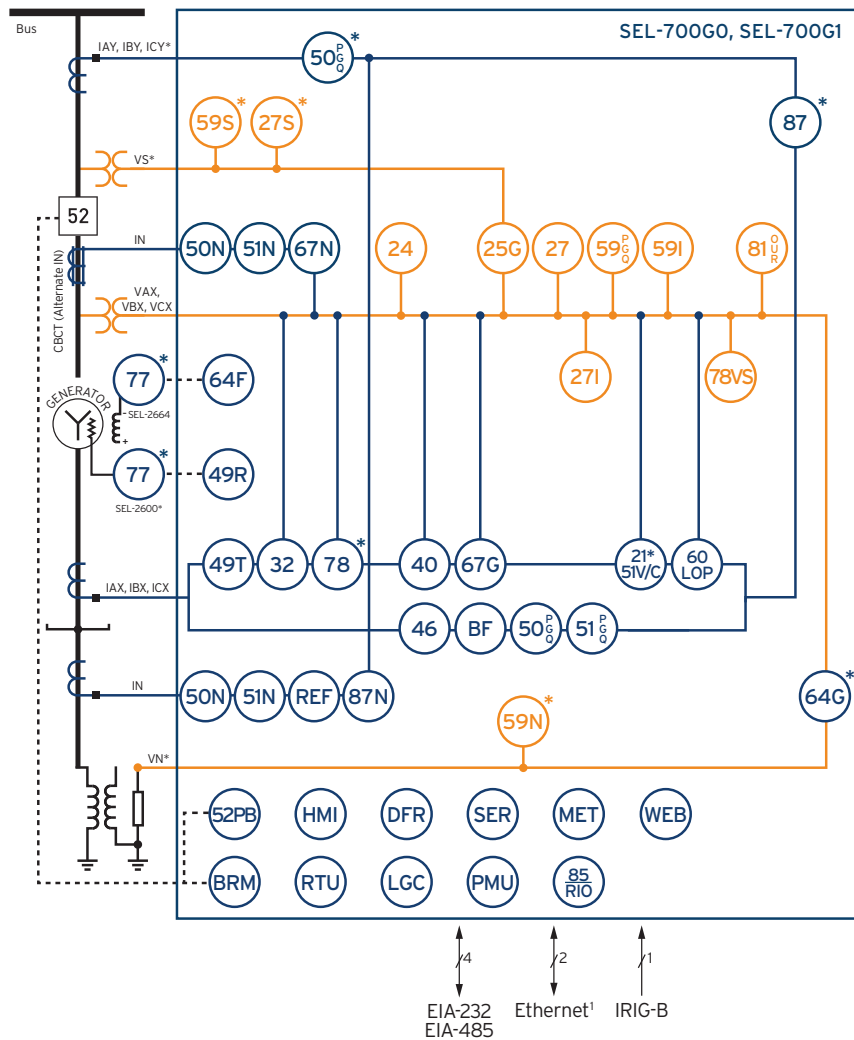

- Sequential Events Recorder
- Event Reports
- Web Server
- SEL ASCII, Ethernet\*, Modbus TCP\*, SNTP\*, IEEE 1588-2008 firmware-based PTP\*, IEC 61850\*, IEC 60870-5-103\*, EtherNet/IP, RSTP\*, PRP\*, DNP3 LAN/WAN\*, DNP3 Serial\*, Modbus RTU, Telnet\*, FTP\*, PTP\*, and DeviceNet™ Communications\*
- Eight Front-Panel Target LEDs, Six of Which Are Programmable
- Two Inputs and Three Outputs Standard
- I/O Expansion\*—Additional Contact Inputs, Contact Outputs, Analog Inputs, Analog Outputs, and RTD Inputs
- Single or Dual Ethernet Copper or Fiber-Optic Communications Port\*
- Battery-Backed Clock, IRIG-B Time Synchronization
- Instantaneous Metering, Demand Metering
- Eight Programmable Pushbuttons Each With Two Tricolor LEDs
- Off-Frequency Operation Time Accumulators
- Advanced SELOGIC Control Equations
- 32 Programmable Display Messages
- MIRRORING BITS Communications
- Synchrophasor (IEEE C37.118)
- Breaker Wear Monitor
- Event Messenger Compatible
- Front-Panel HMI With 2 x 16-Character LCD or Optional 5-Inch, Color, 800 x 480-Pixel Touchscreen Display

\*Optional


**Figure 1 SEL-700G0, SEL-700G1 Generator Protection Relay**

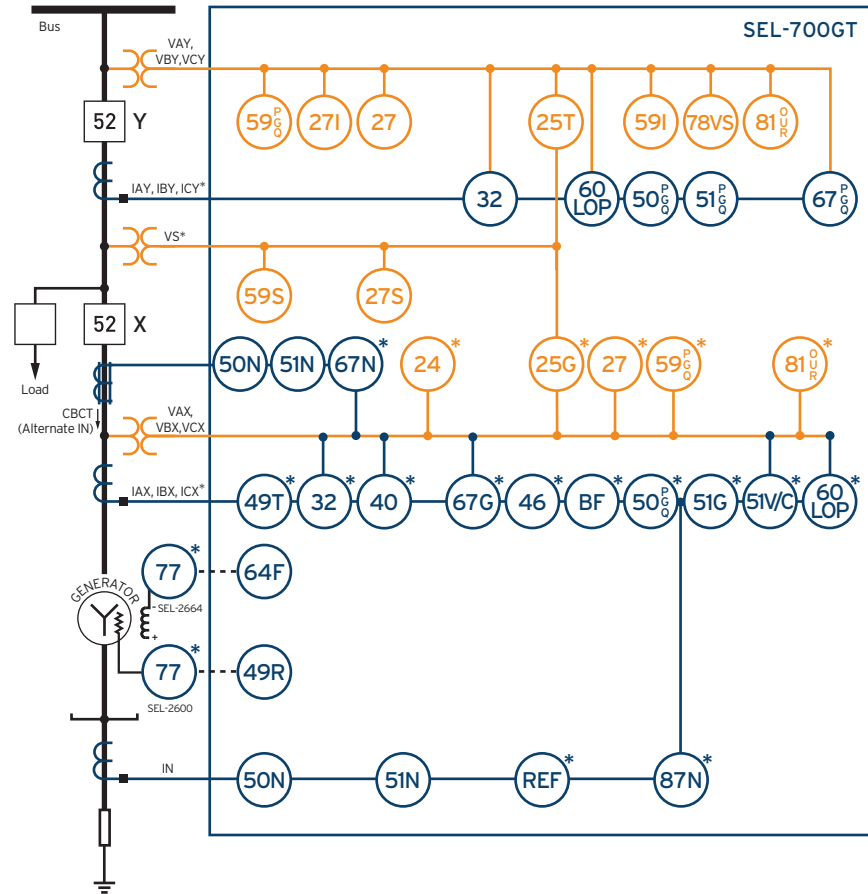

- Sequential Events Recorder
- Event Reports
- Web Server
- SEL ASCII, Ethernet\*, Modbus TCP\*, SNTP\*, IEEE 1588 firmware-based PTP\* IEC 61850\*, IEC 60870-5-103\*, EtherNet/IP, RSTP\*, PRP\*, DNP3 LAN/WAN\*, DNP3 Serial\*, Modbus RTU, Telnet\*, FTP\*, PTP\*, and DeviceNet Communications\*
- Eight Front-Panel Target LEDs, Six of Which Are Programmable
- Two Inputs and Three Outputs Standard
- I/O Expansion\*—Additional Contact Inputs, Contact Outputs, Analog Inputs, Analog Outputs, and RTD Inputs
- Single or Dual Ethernet Copper or Fiber-Optic Communications Port\*
- Battery-Backed Clock, IRIG-B Time Synchronization
- Instantaneous Metering, Demand Metering
- Eight Programmable Pushbuttons Each With Two Tricolor LEDs
- Off-Frequency Operation Time Accumulators
- Advanced SELOGIC Control Equations
- 32 Programmable Display Messages
- MIRRORING BITS Communications
- Synchrophasor (IEEE C37.118)
- Breaker Wear Monitor
- Event Messenger Compatible
- Front-Panel HMI With 2 x 16-Character LCD or Optional 5-Inch, Color, 800 x 480-Pixel Touchscreen Display

\*Optional

**Figure 2 SEL-700GT Intertie and Generator Protection Relay**

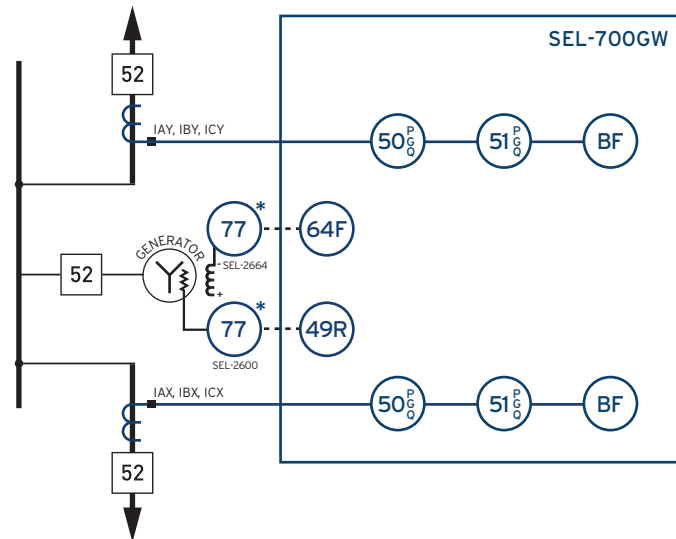

- Sequential Events Recorder
- Event Reports
- Web Server
- SEL ASCII, Ethernet\*, Modbus TCP\*, SNTP\*, IEEE 1588-2008 firmware-based PTP\*, IEC 61850\*, IEC 60870-5-103\*, EtherNet/IP, RSTP\*, PRP\*, DNP3 LAN/WAN\*, DNP3 Serial\*, Modbus RTU, Telnet\*, FTP\*, PTP\*, and DeviceNet Communications\*
- Eight Front-Panel Target LEDs, Six of Which Are Programmable
- Two Inputs and Three Outputs Standard
- I/O Expansion\*—Additional Contact Inputs, Contact Outputs, Analog Inputs, Analog Outputs, and RTD Inputs
- Single or Dual Ethernet Copper or Fiber-Optic Communications Port\*
- Battery-Backed Clock, IRIG-B Time Synchronization
- Instantaneous Metering, Demand Metering
- Eight Programmable Pushbuttons Each With Two Tricolor LEDs
- Off-Frequency Operation Time Accumulators
- Advanced SELOGIC Control Equations
- 32 Programmable Display Messages
- MIRRORING BITS Communications
- Synchrophasor (IEEE C37.118)
- Breaker Wear Monitor
- Event Messenger Compatible
- Front-Panel HMI With 2 x 16-Character LCD or Optional 5-Inch, Color, 800 x 480-Pixel Touchscreen Display

\*Optional

**Figure 3 SEL-700G0, SEL-700G1 Generator Protection Relay**



# Protection Features

## Overcurrent Protection

The SEL-700G provides complete overcurrent protection with as many as two sets of three-phase CTs and one neutral CT input. Phase overcurrent protection is provided for both three-phase inputs. The following overcurrent elements are provided.

### Instantaneous Overcurrent Elements

The following instantaneous overcurrent elements are provided in the SEL-700G as shown in *Table 2*. All instantaneous overcurrent elements provide torque control and definite-time delay settings.

- As many as six instantaneous phase overcurrent elements (50P) with peak detection algorithms to enhance element sensitivity during high-fault current conditions where severe CT saturation may occur.
- As many as four instantaneous negative-sequence overcurrent (50Q) elements.
- As many as four residual-ground instantaneous overcurrent (50G) elements. These elements use calculated residual (3I0) current levels.
- As many as two neutral instantaneous overcurrent elements (50N).

### Directional Instantaneous Overcurrent Elements

The following directional overcurrent elements are available in the SEL-700G with directional control (see *Table 2*).

- As many as three directional phase overcurrent elements (67P).
- As many as two directional negative-sequence overcurrent elements (67Q).
- As many as four directional residual-ground overcurrent elements (67G).
- As many as two directional neutral-ground overcurrent elements (67N).

### Time-Overcurrent Elements

The SEL-700G provides the time-overcurrent elements listed in *Table 2*. These time-overcurrent elements support the IEC and US (IEEE) time-overcurrent characteristics. Electromechanical disc reset capabilities are provided for all time-overcurrent elements.

- As many as two phase time-overcurrent (51P) elements are provided. These phase elements operate on the maximum of phase currents. One 51P element has directional control.

- As many as two negative-sequence time-overcurrent (51Q) elements are provided. These elements operate on the calculated negative-sequence current for each set of three-phase inputs. One 51Q element has directional control.
- As many as two residual time-overcurrent (51G) elements are provided. These elements use calculated residual (3I0) current levels. Both 51G elements have directional control.
- One neutral time-overcurrent (51N) element is provided with directional control.

## Differential Protection (87)

When specified, the SEL-700G detects stator faults using a secure, sensitive current differential function. This function has a sensitive percentage-restrained differential element and an unrestrained element. The differential function provides the unique capability of power transformer and CT connection compensation. This allows you to conveniently include the unit step-up transformer in the generator differential zone using wye-connected CTs for both input sets. The relay allows you to choose harmonic blocking, harmonic restraint, or both, providing a reliable differential protection during transformer inrush conditions. Even-numbered harmonics (second and fourth) provide security during energization, while fifth harmonic blocking provides security for overexcitation conditions. Set second-, fourth-, and fifth-harmonic thresholds independently. The dual-slope percentage restraint characteristic improves element security for through-fault conditions. The high-security mode provides additional security against CT saturation during external events including external transformer energization, external faults, etc.

## Restricted Earth Fault (REF) Protection

Apply the REF protection feature for sensitive detection of internal ground faults on grounded wye-connected windings. The neutral current CT provides the operating current. Polarizing current is derived from the residual current calculated for the protected winding. A sensitive directional element determines whether the fault is internal or external. Zero-sequence current thresholds and selectable CT saturation logic supervise tripping.

## Ground Differential Protection (87N)

SEL-700G relays with generator protection are equipped with a ground differential function that provides selective ground fault detection for solidly grounded and low-

impedance grounded generators. This function helps protect generators on multimachine buses, because the element does not respond to ground faults on the parallel generators.

## Generator Synchronism Check (25G)


You can specify the SEL-700G with a built-in generator synchronism-check function (25G). The synchronism-check function is extremely accurate and provides supervision for acceptable voltage window and maximum percentage difference, maximum and minimum allowable slip frequency, target closing angle, and breaker closing delay. The synchronism-check report gives complete information on the three latest paralleling operations, including the generator and system voltages and frequencies, slip frequency, and phase angle when the close was initiated. The relay also keeps a running average of the breaker close time.

## Intertie Synchronism Check (25T)

The intertie model of the SEL-700G has the tie synchronism-check function (25T), which provides the closing window for the bus-tie breaker when connecting to the utility system.

## Autosynchronizer and Synchroscope

Selected SEL-700G models have the built-in autosynchronizer function, which provides output contact interfaces for the generator field voltage regulator and the prime mover speed control governor. Frequency, voltage, and phase are automatically synchronized and the generator is connected to the power system with this function. The relay also provides generator autosynchronism reports to record the automatic synchronizing event. The generator synchronization process can be viewed on a PC-based synchroscope (see example in *Figure 4*) with QuickSet.

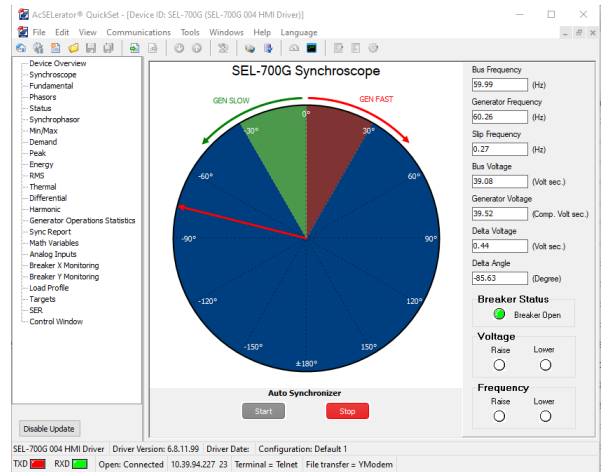

**Figure 4 QuickSet Synchroscope**

Relays equipped with the touchscreen display come with a built-in Synchroscope application in the Monitor folder, which displays a graphical representation of the phasor difference between the bus and the generator or tie. You can also use the Auto Synchronization application in the Control folder to initiate auto-synchronization of your generator and your system.

## 100 Percent Stator Ground Detection (64G)

The SEL-700G detects stator ground faults on high-impedance grounded generators using a conventional neutral-overvoltage element and a third-harmonic voltage differential detection scheme for 100 percent stator winding coverage. The neutral overvoltage element detects winding ground faults in approximately 85 percent of the winding. Faults closer to the generator neutral do not result in high neutral voltage but are detected using third harmonic neutral and terminal voltages. The combination of the two measuring methods provides ground fault protection for the full winding.

Use the SEL-2664S Stator Ground Protection Relay for 100 percent stator ground protection using a multisine signal injection method for a superior solution that is independent of third-harmonic voltage magnitude. This relay works with the generator in or out of service and during generator ramp up without any blind spots.

## Field Ground Protection (64F)

The SEL-700G, with the SEL-2664 Field Ground Module, detects field ground faults by measuring field insulation-to-ground resistance using the switched dc voltage injection method. Two-level protection for alarm and trip functions is provided.

## Directional Power Detection (32)

Sensitive directional power elements in the SEL-700G provide antimotoring and/or low forward power tripping. As many as eight elements (four each for the X side and Y side) for detecting real (Watts) or reactive (VARs) directional power flows, having independent time-delays and sensitivities are provided. Directly trip the generator under loss-of-prime mover conditions to prevent prime movers from motoring, or use low forward power indication as a tripping interlock when an orderly shut-down is required.

## Over-Excitation Protection (24)

The SEL-700G provides one definite-time for alarm and one composite inverse-time volts/hertz element. The composite inverse-time characteristic may be enabled with a two-step definite-time characteristic, a definite/inverse-time characteristic, or a simple inverse-time characteristic. A custom curve option is also available.

## Loss-of-Field Protection (40)

Two offset positive-sequence mho elements detect loss-of-field conditions. Settable time-delays help reject power swings that pass through the machine impedance characteristic. By using the included directional supervision, one of the mho elements can be set to coordinate with the generator minimum excitation limiter and its steady-state stability limit.

## Out-of-Step Protection (78)

SEL-700G relays use a single or a double-blinder scheme, depending on user selection, to detect an out-of-step condition. In addition to the blinders, the scheme uses a mho circle that restricts the coverage of the out-of-step function to the desired extent. Furthermore, both schemes contain current supervision and torque control to supervise the operation of the out-of-step element.

## Negative-Sequence Overcurrent Protection (46)

Negative-sequence current heats the rotor at a higher rate than positive-sequence or ground current. The negative-sequence definite-time element provides alarm for early stages of an unbalanced condition. The inverse time-overcurrent element provides tripping for sustained

unbalance conditions to prevent machine damage. The inverse-time negative-sequence element provides industry standard  $(I_2)^2 \cdot t$  protection curves.

## System Backup Protection (21C, 51V, 51C)

The SEL-700G offers you the choice of three methods for performing system backup protection. Compensator distance elements (21C), a voltage-restrained phase time-overcurrent element (51V), and a voltage-controlled phase time-overcurrent (51C) element are all available; you simply enable the element you wish to use.

## Over- and Undervoltage Protection (27, 59)

Phase, phase-to-phase, and positive-sequence undervoltage (27), overvoltage (59), residual overvoltage (59G) and negative-sequence overvoltage (59Q) elements help you create protection and control schemes, such as undervoltage load shedding, or standby generation start/stop commands.

- Phase and phase-to-phase undervoltage elements operate with the minimum of the measured voltage magnitudes; these elements operate when any single measurement falls below the set thresholds.
- Phase and phase-to-phase overvoltage elements operate with the maximum of the measured voltage magnitudes.
- The positive-sequence undervoltage elements operate when the calculated positive-sequence voltage V1 drops below the set thresholds.
- The positive-sequence overvoltage elements operate when the calculated positive-sequence voltage V1 exceeds the set thresholds.
- The negative-sequence overvoltage elements operate when the calculated negative-sequence voltage V2 exceeds set thresholds.
- The residual-ground voltage element operates when the zero-sequence voltage 3V0 exceeds the set point.
- Inverse-time overvoltage (59I) and inverse-time undervoltage (27I) elements that operate on the measure phase-to-neutral voltages, phase-to-phase voltages, or VS channel voltage, depending on the relay part number.

All voltage elements provide definite-time delay settings.

## Loss-of-Potential Logic (60LOP)

Relay functions that use phase voltages or symmetrical component voltages rely on valid inputs to make the correct decisions. The LOP logic detects open voltage transformer fuses or other conditions that cause a loss of relay secondary voltage input. The SEL-700G with voltage inputs, includes loss-of-potential logic that detects one, two, or three potentially blown fuses. This patented logic is unique and is universally applicable. It also offers a SELOGIC setting to block the LOP logic under user-defined conditions. The LOP feature allows for the blocking of protection elements to add security during fuse failure.

## Breaker Failure Protection (BF)

The SEL-700G offers breaker failure protection for up to two three-pole breakers. Use the breaker failure detection to issue re-trip commands to the failed breaker, or to trip adjacent breakers using the relay's contact output logic or communications-based tripping schemes.

## Inadvertent Energization Detection

Occasionally, the unit breaker for an out-of-service generator is closed inadvertently. The SEL-700G detects this condition using voltage, current, and other supervisory conditions you select through an SELOGIC control equation.

## Frequency Protection (81)

Six levels of over- or underfrequency elements detect abnormal frequency operating conditions. Use the independently time-delayed output of these elements to trip or alarm. Phase undervoltage supervision prevents undesired frequency element operation during start-up, shut-down, and faults, and while the field is de-energized. SEL-700G frequency elements have high accuracy (less than 0.01 Hz).

## Rate-of-Change-of-Frequency Protection (81R)

Four independent rate-of-change-of-frequency elements are provided with individual time delays for use when frequency changes occur, for example, when there is a sudden imbalance between generation and load. They call for control action or switching action such as network decoupling or load shedding. Each element includes logic to detect either increasing or decreasing frequency and above or below nominal frequency.

## Vector Shift Protection (78VS)

When distributed generators (DG) are connected in the utility network, the vector shift element (78VS) is used to detect islanding conditions and trip the DG. Failure to trip islanding generators can lead to problems such as personnel safety, out-of-synchronization reclosing, and degradation of power quality. Based on the change in the angle of the voltage waveform, the islanding condition can be detected by the vector shift function. Use the vector shift element with the 81RF element as a backup for fast and secure islanding detection. The vector shift element operates within three cycles, which is fast enough to prevent reclosing out-of-synchronism with the network feeders to avoid generator damage.

## Off-Frequency Accumulators

The SEL-700G tracks the total time-of-operation in up to six off-nominal frequency bands. If the off-nominal time of operation exceeds one of the independent time set points, the relay can trip or alarm.

## Thermal Overload Protection (49T)

The SEL-700G thermal element provides generator overload protection based on the thermal model described in IEC standard 60255-8. The model can be biased by ambient temperature if the RTD option is used.

The relay operates a thermal model with a trip value defined by the relay settings and a present heat estimate that varies with time and changing generator current.

## RTD Thermal Protection


When the SEL-700G is equipped with either an optional 10 RTD input expansion card or an external SEL-2600 RTD Module with up to 12 RTD inputs, as many as 12 thermal elements in the relay can be programmed for two levels of thermal protection per element. Each RTD input provides an alarm and trip thermal pickup setting in degrees C, provides open and shorted RTD detection, and is compatible with the following three-wire RTD types:

- PT100 (100  $\Omega$  platinum)
- NI100 (100  $\Omega$  nickel)
- NI120 (120  $\Omega$  nickel)
- CU10 (10  $\Omega$  copper)

Additionally, the winding RTDs and the ambient temperature RTD can be configured and used to bias the generator thermal model and thermal protection.

# Operator Controls

Operator controls eliminate traditional panel control switches. Eight conveniently sized operator controls are located on the relay front panel (see *Figure 5*). The SER can be set to track operator controls. Change operator control functions using SELOGIC control equations.

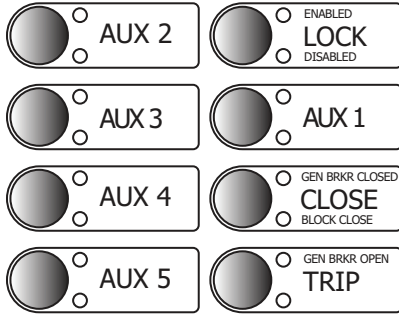

**Figure 5 Operator Controls (Shown for the SEL-700G0, SEL-700G1 Models)**

The following operator control descriptions are for factory-set logic for the model shown.

**LOCK:** The **LOCK** operator control blocks selected functions. Press it for at least three seconds to engage or disengage the lock function. While locked in position, the following operator controls cannot change state if pressed: **TRIP** and **CLOSE**.

**AUX:** The **AUX** operator control and LEDs are user programmable.

**CLOSE and TRIP:** Use the **CLOSE** and **TRIP** operator controls to close and open the connected circuit breaker. They can be programmed with intentional time delays to support operational requirements for breaker-mounted relays. This allows the operator to press the **CLOSE** or **TRIP** pushbutton, then move to an alternate location before the breaker command is executed.

In the SEL-700G with the touchscreen display, you can also use the front-panel operator control pushbuttons to jump to a specific screen while also using them for **LOCK/CLOSE/TRIP** operations, etc. You can program the selectable operator pushbutton screen settings under the Touchscreen settings category in QuickSet and map the button to a specific screen.

# Built-In Web Server

Every Ethernet-equipped SEL-700G includes a built-in web server. Use any standard web browser to interface with the relay and perform the following actions:

- Log in with password protection.
- Safely read the relay settings.
- Verify the relay self-test status and view the relay configuration.
- Inspect meter reports.
- Download SER and event reports.
- Upload new firmware (firmware upgrade).

Figure 6 shows the fundamental metering screen that can be accessed by clicking **Meter > Fundamental**. Use the Meter menu to view all the available relay metering statistics.

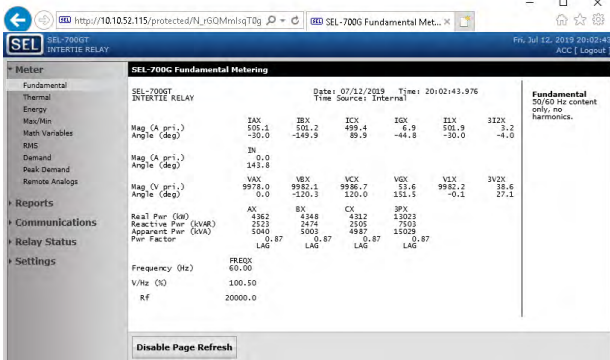


Figure 6 Fundamental Meter Report Webpage

Figure 7 shows the Group 1 settings webpage. You can view the settings of each relay settings class by selecting **Settings** and the respective relay settings class.

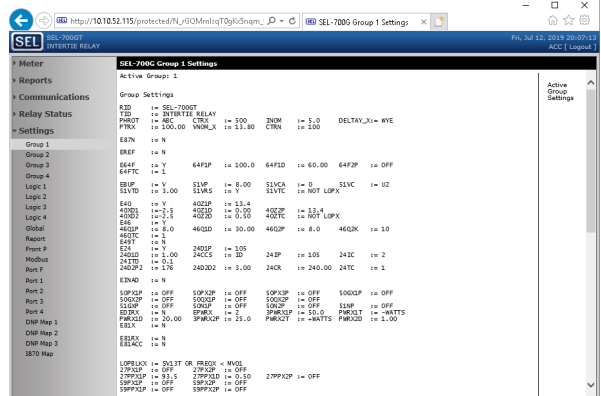


Figure 7 Group 1 Settings Webpage

You can upgrade the relay firmware through the relay web server by clicking **System > File Management** and selecting the firmware upgrade file. Figure 8 shows the firmware upgrade webpage.

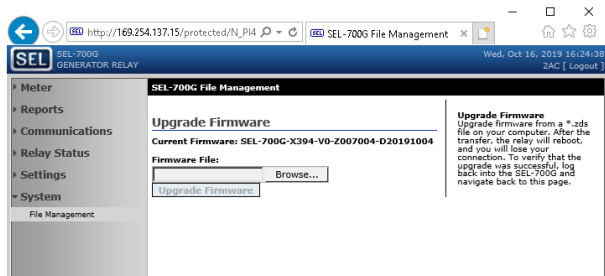


Figure 8 Upgrade the Relay Firmware From the File Management Webpage

# Relay and Logic Settings Software

QuickSet Software simplifies settings and provides analysis support for the SEL-700G. With QuickSet you have several ways to create and manage relay settings:

- Develop settings off-line with an intelligent settings editor that only allows valid settings.
- Create SELOGIC control equations with a drag-and-drop text editor.
- Configure proper settings using online help.
- Organize settings with the relay database manager
- Load and retrieve settings using a simple PC communications link.

With QuickSet you can verify settings and analyze events; and analyze power system events with the integrated waveform and harmonic analysis tools.

The following features of QuickSet can monitor, commission, and test the SEL-700G:

- The PC interface remotely retrieves power system data.
- The HMI monitors meter data, Relay Word bits, and output contacts status during testing. The control window allows resetting of metering quantities, and other control functions.
- The synchroscope screen provides a visual display of the autosynchronizer function.

- Bay control allows you to design new bay screens and edit existing bay screens by launching ACSELERATOR Bay Screen Builder SEL-5036 Software for the SEL-700G relays with the touchscreen display.

## ACSELERATOR Bay Screen Builder SEL-5036 Software

The SEL-700G with the touchscreen display layout option provides you with the ability to design bay configuration screens to meet your system needs. You can display the bay configuration as a single-line diagram (SLD) on the touchscreen. You can use ANSI and IEC symbols, along with analog and digital labels, for the SLD to indicate the status and control of the breaker and two- or three-position disconnects, bus voltages, and power flow through the breaker. In addition to SLDs, you can design the screens to show the status of various relay elements via Relay Word bits or to show analog quantities for commissioning or day-to-day operations. You can design these screens with the help of Bay Screen Builder in conjunction with QuickSet. Bay Screen Builder provides an intuitive and powerful interface to design bay screens to meet your application needs.

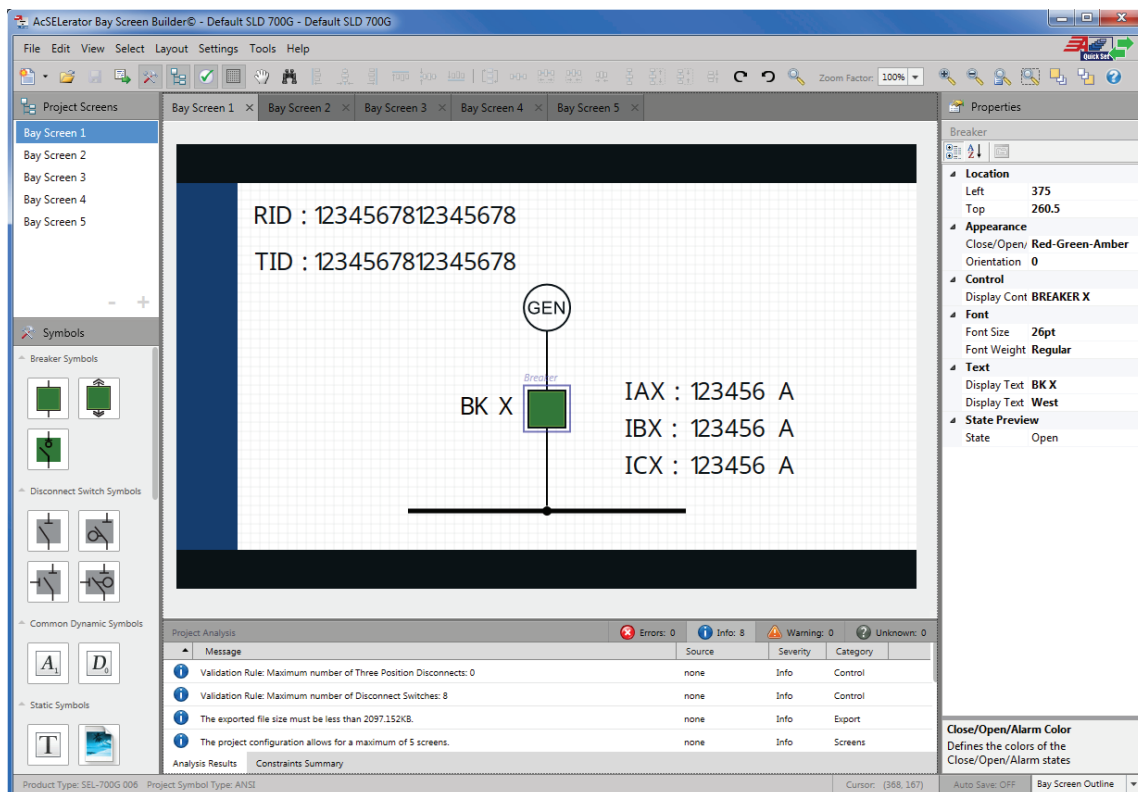


Figure 9 Bay Screen Builder

# Metering and Monitoring

The SEL-700G, depending on the model selected, provides extensive metering capabilities. See *Specifications on page 38* for metering and power measurement accuracies. As shown in *Table 3*, metered quantities include voltages and currents; sequence

voltages and currents; power, frequency, and energy; and maximum/minimum logging of selected quantities. The relay reports all metered quantities in primary quantities (current in A primary and voltage in V primary).

**Table 3 SEL-700G Metered Values**

Types of Metering			
Instantaneous	Differential	Max/Min	Analog Inputs
Remote Analogs	Math Variables	Synchrophasors	Thermal
Demand and Peak Demand	Energy	RMS	Harmonics
Quantities	Description		
Currents: $I_{An}$ , $I_{Bn}$ , $I_{Cn}$ , $I_{Gn}$ , $I_N$	Phase currents, calculated residual currents ( $I_G = 3I_0 = I_A + I_B + I_C$ ) and neutral current, for $n = X$ and $Y$		
Voltages: $V_{An}$ , $V_{Bn}$ , $V_{Cn}$ , $V_N$	Wye-connected voltage inputs for $n = X$ and $Y$		
Voltages: $V_{ABn}$ , $V_{BCn}$ , $V_{CAn}$	Delta-connected voltage inputs for $n = X$ and $Y$		
Voltage VS	Synchronism-check voltage input		
Power $kW_{An}$ , $Bn$ , $Cn$ , $3Pn$ $kVAR_{An}$ , $Bn$ , $Cn$ , $3Pn$ $kVA_{An}$ , $Bn$ , $Cn$ , $3Pn$	Single and three-phase kilowatts, kilovars, and kilovolt-amps for $n = X$ and $Y$		
Energy $MWh_{An}$ , $Bn$ , $Cn$ , $3Pn$ $MVARh_{An}$ , $Bn$ , $Cn$ , $3Pn$ $MVAh_{An}$ , $Bn$ , $Cn$ , $3Pn$	Single and three-phase real, reactive and apparent energy for $n = X$ and $Y$		
Power Factor $PF_{An}$ , $Bn$ , $Cn$ , $3Pn$	Single and three-phase power factor for $n = X$ and $Y$		
Sequence $I_{1n}$ , $3I_{2n}$ , $3I_{0n}$ , $V_{1n}$ , $3V_{2n}$ , $3V_{0n}$	Positive, negative and zero-sequence currents and voltages for $n = X$ and $Y$		
Frequency $FREQ_n$ , $FREQS$ (Hz)	Instantaneous power system frequency for $n = X$ and $Y$ and for synchronism-check voltage input VS		
V/Hz	Calculated volts/hertz in percent, using highest measured voltage and measured frequency		
VPX3, VN3	Phase and neutral third harmonic voltage for stator ground protection		
Gen TCU %	Generator thermal capacity used (%)		
Rf kOhm	Field winding insulation resistance to ground (kOhm)		
AXx01–AXx04	Analog inputs		
MV01–MV32	Math variables		
RA001–RA128	Remote analogs		
RTD $_n$ ( $n = 1$ to $12$ )	RTD temperature measurement (degrees C)		




## Load Profile

The SEL-700G features a programmable Load Profile (LDP) recorder that records as many as 17 metering quantities into nonvolatile memory at fixed time intervals. The LDP saves several days to several weeks of the most recent data depending on the LDP settings (9800 entries total).

## Synchrophasor Measurements

Combine the SEL-700G with an SEL IRIG-B time source to measure the system angle in real time with a timing accuracy of  $\pm 10 \mu\text{s}$ . Measure instantaneous voltage and current phase angles in real time to improve system operation with synchrophasor information. Replace state measurement, study validation, or track system stability. Use SEL-5703 SYNCHROWAVE<sup>®</sup> Monitoring Software to view system angle at multiple locations for precise system analysis and system-state measurement (see *Figure 10*).

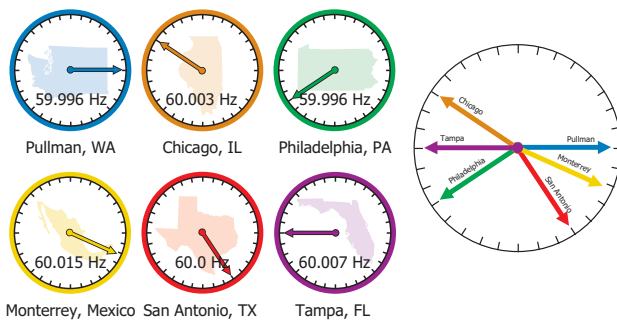

**Figure 10** View of System Angle at Multiple Locations

Send synchrophasor data using IEEE C37.118-2005 protocol to SEL synchrophasor applications. These include the SEL-3378 Synchrophasor Vector Processor (SVP), SEL-3530 Real-Time Automation Controller (RTAC), and the SEL-5078-2 SYNCHROWAVE Central Visualization and Analysis Software suite.


The SEL-3373 Station Phasor Data Concentrator (PDC) and the SEL-5073 SYNCHROWAVE PDC software correlate data from multiple SEL-700G relays and concentrate the result into a single output data stream. These products also provide synchrophasor data archiving capability. The SEL-3378 SVP enables control applications based on synchrophasors. Directly measure the oscillation modes of your power system and then act on the result. Use wide-area phase angle slip and accelera-

tion measurements to properly control islanding of distributed generation. With the SVP, you can customize a synchrophasor control application according to the unique requirements of your power system.

The data rate of SEL-700G synchrophasors is selectable with a range of 1–60 messages per second. This flexibility is important for efficient use of communication capacity.

The SEL-700G phasor measurement accuracy meets the highest IEEE C37.118-2005 Level 1 requirement of 1 percent total vector error (TVE). This means you can use any SEL-700G model in an application that otherwise would require purchasing a separate dedicated phasor measurement unit (PMU).

Use the SEL-700G with SEL communications processors, or the RTAC, to change nonlinear state estimation into linear state estimation. If all necessary lines include synchrophasor measurements then state estimation is no longer necessary. The system state is directly measured.

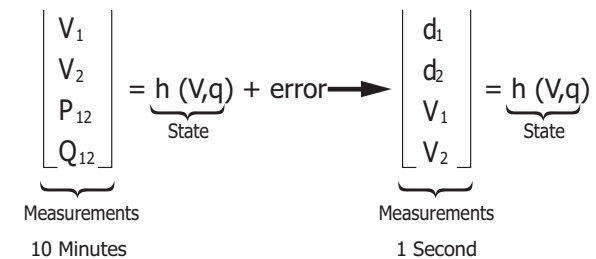

**Figure 11** Synchrophasor Measurements Turn State Estimation into State Measurement

## Generator Operating Statistics Monitoring

The SEL-700G relay, having generator elements, tracks the performance and utilization of the protected generator by tracking the following generator operating statistics.

- Total generator running hours
- Total generator stopped hours
- Generator full load hours
- Percent of time running
- Accumulated generator  $I_2^2 \cdot t$
- Average real and reactive power outputs
- Average power factor

# Improve Situational Awareness

Provide improved information to system operators. Advanced synchrophasor-based tools produce a real-time view of system conditions. Use system trends, alarm points, and preprogrammed responses to help operators prevent a cascading system collapse and maximize system stability. Awareness of system trends provides operators with an understanding of future values based on measured data.

- Increase system loading while maintaining adequate stability margins.
- Improve operator response to system contingencies such as overload conditions, transmission outages, or generator shutdown.
- Advance system knowledge with correlated event reporting and real-time system visualization.
- Validate planning studies to improve system load balance and station optimization.

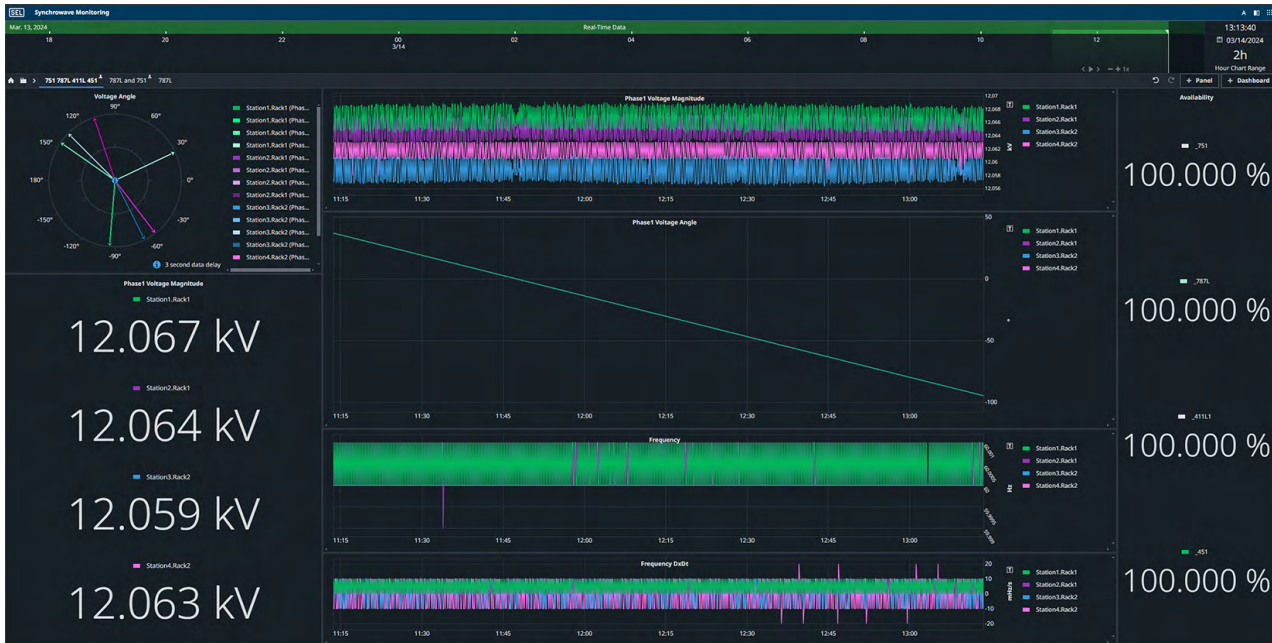


Figure 12 Visualization of Phase Angle Measurements Across a Power System

## Event Reporting and SER

Event reports and the SER simplify post-fault analysis and improve understanding of simple and complex protective scheme operations. In response to a user-selected trigger, the voltage, current, frequency, and element status information contained in each event report confirms the relay scheme and system performance for every fault. Decide how much detail is necessary when you request an event report (e.g., 1/4-cycle or 1/32-cycle resolution, filtered or raw analog data, respectively).

The relay stores as many as 6 of the most recent 180-cycle event reports, 18 of the most recent 64-cycle event reports, or 74 of the most recent 15-cycle event reports in nonvolatile memory. The relay always appends relay settings at the time of the event to the bottom of each event report.

The following analog data formats are available:

- 1/4-cycle or 1/32-cycle resolution, filtered or unfiltered analog, ASCII or Compressed ASCII reports
- 1/32-cycle resolution COMTRADE reports

The relay SER feature stores the latest 1024 entries. Use this feature to gain a broad perspective at a glance. An SER entry helps to monitor input/output change-of-state occurrences and element pickup/dropout.


## Synchrophasor Measurements

The IRIG-B time-code input synchronizes the SEL-700G time to within  $\pm 5$  ms of the time-source input.

A convenient source for this time code is an SEL-2401 Satellite-Synchronized Clock, the SEL-3530 Real Time Automation Controller (RTAC), or the SEL-2032, SEL-2030, or SEL-2020 Communications Processor (via Serial Port 3 on the SEL-700G).

## Generator Autosynchronism Report

The SEL-700G with the autosynchronism function generates a generator autosynchronism report with all the relevant analog and digital signals for a quick analysis of the event. The sample rate can be selected between 0.25, 1, and 5 cycles. The report captures 4800 time-stamped data points.

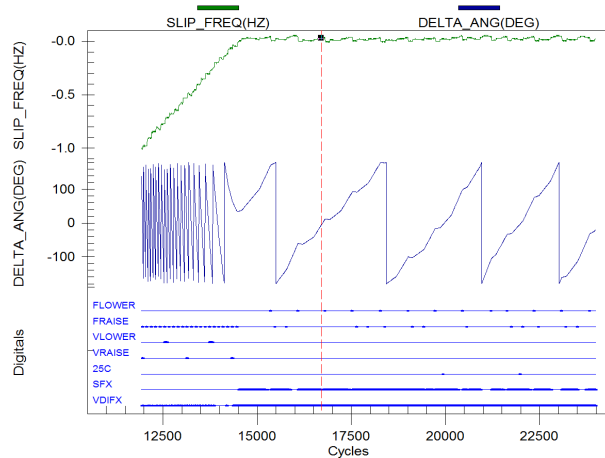

**Figure 13** Graphical Display of Generator Synchronizer Report

## IEC 61850 Test Mode

Test Mode allows you to test an in-service relay without accidentally operating control output contacts. Test Mode includes five different modes:

**On:** In On mode, the relay operates as normal; it reports IEC 61850 Mode/Behavior status as On and processes all inputs and outputs as normal. If the quality of the subscribed GOOSE messages satisfies the GOOSE processing, the relay processes the received GOOSE messages as valid.

**Blocked:** This mode is similar to On mode, except that the device does not trip any physical contact output.

**Test:** In Test mode, the relay processes valid incoming test signals and normal messages and operates physical contact outputs, if the outputs are triggered.

**Test/Blocked:** This is similar to Test mode, except that the device does not trip any physical contact outputs.

**Off:** The device does not process any incoming data or control commands (except commands to change the mode). All protection logic is disabled and all data quality is marked as invalid.

**Simulation:** In this mode, the relay continues to process normal GOOSE messages until a simulated GOOSE message is received for a subscription. Once a simulated GOOSE message is received, only simulated GOOSE messages are processed for that subscription. The simulated mode only terminates when LPHDSIM is returned to FALSE. When the relay is not in simulation mode, only normal GOOSE messages are processed for all subscriptions.

# Touchscreen Display

You can order the SEL-700G Generator Protection Relay with an optional touchscreen display (5-inch, color, 800 x 480 pixels). The touchscreen display makes relay data metering, monitoring, and control quick and efficient. The touchscreen display option in the SEL-700G features a straightforward application-driven control structure and includes intuitive and graphical screen designs.

The touchscreen display allows you to:

- View and control bay screens
- Access metering and monitoring data
- Inspect targets
- View event history, summary data, and SER information
- View relay status and configuration
- Control relay operations
- View and edit settings
- Enable the rotating display
- Program control pushbuttons to jump to a specific screen
- Visualize and synchronize your generator to the system with built-in Synchroscope/Auto Synchronizer applications

You can navigate the touchscreen by selecting the folders and applications. The folders and applications of the Home screen are shown in *Figure 14*. Folders and applications are labeled according to functionality. Additional folder and application screens for the SEL-700G touchscreen display option can be seen in *Figure 15* through *Figure 24*.

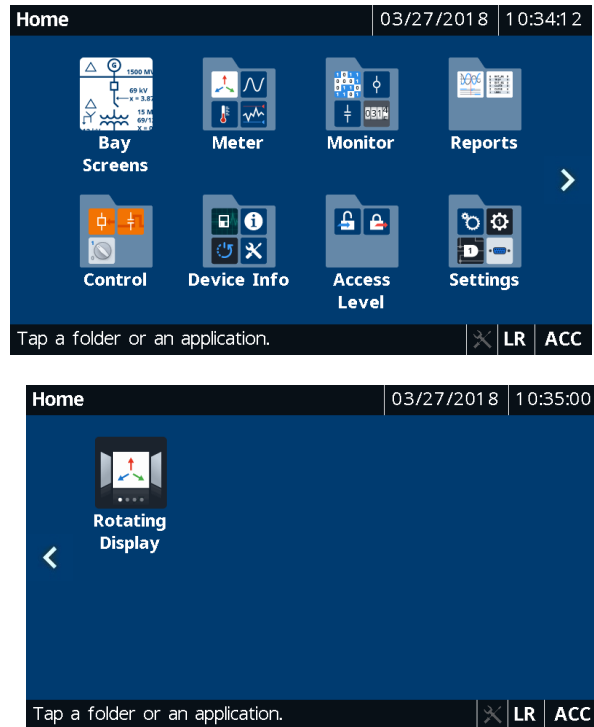


Figure 14 Home (Default FPHOME Screen)

## Bay Screens Application

The SEL-700G with the touchscreen display option provides you with the ability to design bay configuration screens to meet your system needs. The bay configuration can be displayed as an SLD on the touchscreen. You can create as many as five bay screens with up to two controllable breakers, eight controllable two-position disconnects, and two controllable three-position disconnects. ANSI and IEC symbols, along with analog and digital labels, are available for you to create detailed SLDs of the bay to indicate the status and control of the breaker and disconnects, bus voltages, and power flow through the breaker. *Figure 15* shows the default SLD for the touchscreen display option.

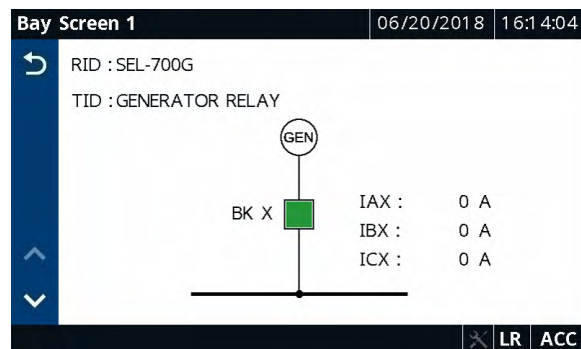


Figure 15 Default Bay Screen

## Meter Folder Applications

The applications in the Meter folder are part-number dependent. Only those metering applications specific to your part number appear in the Meter folder. Select an application in the **Meter** folder to display the report for that particular application. Select the **Phasor** application to view the current and voltage phasors (see *Figure 16*).

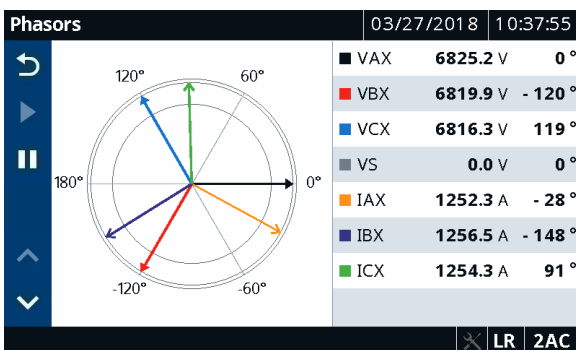



Figure 16 Meter Phasor

Select the **Energy** application to view the energy metering quantities (see *Figure 17*). A reset feature is provided for the Energy, Max/Min, Thermal, Demand, and Peak Demand applications. Press the **Reset** button  (see *Figure 17*) to navigate to the reset confirmation screen. Once you confirm the reset, the data are reset to zero.

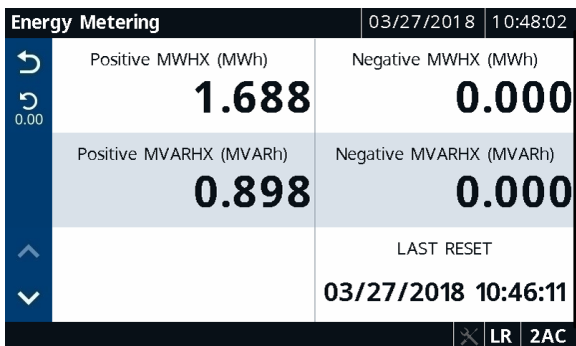


Figure 17 Meter Energy

## Reports Folder Applications

Select the **Reports** folder to navigate to the screen where you can access the Events and SER applications. Use these applications to view events and SERs. To view the event summary (see *Figure 18*) of a particular event record, you can select the event record on the Event History screen. You can also trigger an event report from the Event History screen.

Event Summary		03/30/2018	16:37:53
Ref_Num	10081	Event	Volt/Hz 24 Tri
Date	03/30/2018	Time	16:28:47.356
TARGETS	11000101		
IAX (A)	1246.3	VAX (V)	6825
IBX (A)	1252.5	VBX (V)	6820
ICX (A)	1254.0	VCX (V)	6815
IGX (A)	5.6	VGX (V)	5
IAY (A)	1251.0	VAY (V)	6782

Figure 18 Event Summary

Select the **Sequential Events Recorder** application to view a history of the SER reports (see *Figure 19*).

Sequential Events Recorder		03/30/2018	16:38:29	
#	DATE	TIME	ELEMENT	STATE
1	03/30/2018	16:28:48.356	3PWRX2T	Asserted
2	03/30/2018	16:28:47.356	24D1T	Deasserted
3	03/30/2018	16:28:47.356	24C2T	Deasserted
4	03/30/2018	16:28:47.356	3PWRX2T	Deasserted
5	03/30/2018	16:28:47.356	Relay	Settings Changed
6	03/30/2018	16:27:34.766	3PWRX2T	Asserted
7	03/30/2018	16:27:34.754	24D1T	Asserted
8	03/30/2018	16:27:33.908	24C2T	Asserted

Figure 19 Sequential Events Recorder

Select the **Trash** button, shown in *Figure 19*, on the Event History and Sequential Events Recorder screens and confirm the delete action to remove the records from the relay.

## Control Folder Applications

Select the **Control** folder to navigate to the screen where you can access the Breaker Control, Disconnect Control, Output Pulsing, Local Bits, Auto Synchronizer, and Reset TCU applications. Use the applications to perform breaker control operations, pulse output contacts (*Figure 20*), control the local bits (*Figure 21*), and reset TCU for the thermal overload element.

Digital Output Pulsing - Slot A			02/08/2017	10:16:10
OUT101	OUT102	OUT103		
1	0	0		

Figure 20 Digital Output Pulsing-Slot A

Local Bits			02/08/2017	10:25:26
#	LOCAL BIT NAME	STATE		
LB01	SPERV SW	OPEN		
LB02	FAN START	OFF		

Tap a row. LR 2AC

Figure 21 Local Bits

Use the Auto Synchronizer application to initiate auto-synchronization of your generator to the system. Throughout the process, you can see the phasor difference between the bus and the generator via the Synchroscope.

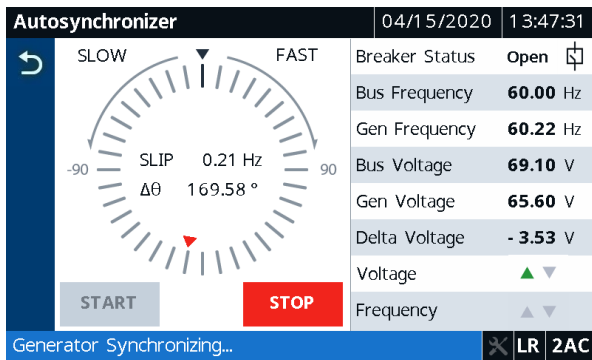


Figure 22 Auto Synchronizer

## Device Info Folder Applications

Select the **Device Info** folder to navigate to the screen where you can access specific device information applications (Status, Configuration, and Trip & Diag. Messages) and the Reboot application.

## Automation

### Flexible Control Logic and Integration

The SEL-700G can be ordered with as many as four independently operated serial ports:

- EIA-232 port on the front panel
- EIA-232 or EIA-485 port on the Slot B in the rear
- EIA-232 fiber-optic port on Slot B card in the rear
- EIA-232 or EIA-485 port on the optional communications card in Slot C in the rear

Select the **Status** application to view the relay status, firmware version, part number, etc. (see *Figure 23*).

Device Status		03/30/2018	16:51:15
Status	Relay Enabled		
Serial No	3162580026		
FID String	SEL-700G-X346-V0-Z006003-D2018031		
Part Number	0700GT1B1X0X7585A33X		
SEL Display	1.0.40700.3450		
Customer Display	1.540384993		
IEC-61850 CID			

LR 2AC

Figure 23 Status

To view the trip and diagnostic messages, select the **Trip & Diag. Messages** application (see *Figure 24*). When a diagnostic failure, trip, or warning occurs, the relay displays the diagnostic message on the screen until it is either overridden by the restart of the rotating display, or the inactivity timer expires.

Trip, Warning, & Diagnostic Messages				03/30/2018	16:52:46
TYPE	DATE	TIME	EVENT		
TRIP	03/30/2018	16:27:33.912	Volt/Hz 24 Trip		

View Events or Status reports for details. LR 2AC

Figure 24 Trip and Diagnostics

Optionally, the relay supports single or dual, copper or fiber-optic Ethernet ports.


The relay does not require special communications software. You can use any system that emulates a standard terminal system. Establish communication by connecting: computers, modems, protocol converters, printers, an SEL Real-Time Automation Controller (RTAC), SEL communications processor, SEL computing platform, SCADA serial port, and RTUs for local or remote communication. Refer to *Table 4* for a list of communications protocols available in the SEL-700G.

**Table 4 Communications Protocols**

Type	Description
Simple ASCII	Plain language commands for human and simple machine communications. Use for metering, setting, self-test status, event reporting, and other functions.
Compressed ASCII	Comma-delimited ASCII data reports. Allows external devices to obtain relay data in an appropriate format for direct import into spreadsheets and database programs. Data are checksum protected.
Extended Fast Meter and Fast Operate	Binary protocol for machine-to-machine communications. Quickly updates SEL communications processors, RTUs, and other substation devices with metering information, relay element, I/O status, time-tags, open and close commands, and summary event reports. Data are checksum protected. Binary and ASCII protocols operate simultaneously over the same communications lines so control operator metering information is not lost while a technician is transferring an event report. Direct communications with the SEL-2600 RTD Module are possible using the unsolicited Fast Meter protocol to read incoming temperature data from the SEL-2600.
Fast SER Protocol	Provides SER events to an automated data collection system.
Fast Message Protocol	Use this protocol to write remote analog data from other SEL relays or communications processors via unsolicited writes.
DNP3	Serial or Ethernet-based DNP3 protocols. Provides default and mappable DNP3 objects that include access to metering data, protection elements, Relay Word bits, contact I/O, targets, SER, relay summary event reports, and setting group selection.
Modbus	Serial- or Ethernet-based Modbus with point remapping. Includes access to metering data, protection elements, contact I/O, targets, SER, relay summary event reports, and setting groups.
IEC 61850 Edition 2	Ethernet-based international standard for interoperability between intelligent devices in a substation. Operates remote bits and I/O. Monitors Relay Word bits and analog quantities.
Synchrophasors	IEEE C37.118-compliant synchrophasors for system state, response, and control capabilities.
Event Messenger	The use of SEL-3010 Event Messenger allows you to receive alerts directly on your cell phone. Alerts can be triggered through relay events and can include quantities measured by the relay.
DeviceNet	Allows for connection to a DeviceNet network for access to metering data, protection elements, contact I/O, targets, and setting groups. (The DeviceNet option has been discontinued and is no longer available to order as of September 25, 2017.)
SNTP	Ethernet-based protocol that provides time synchronization of the relay.
IEEE 1588-2008 firm-ware-based PTP	Ethernet-based protocol that provides time synchronization of the relay.
PRP	Provides seamless recovery from any single Ethernet network failure in a dual redundant Ethernet network, in accordance with IEC 62439-3.
IEC 60870-5-103	Serial communications protocol—international standard for interoperability between intelligent devices in a substation.
EtherNet/IP	Ethernet-based protocol that includes access to metering data, protection elements, targets, and contact I/O.
RSTP	Provides faster recovery in response to changes and failures in switched mode dual redundant Ethernet networks in accordance with IEEE 802.1Q-2014.

Apply an SEL communications processor as the hub of a star network, with point-to-point fiber or copper connection between the hub and the SEL-700G (Figure 25).

The communications processor supports external communications links including the public switched telephone network for engineering access to dial-out alerts and private line connections of the SCADA system.

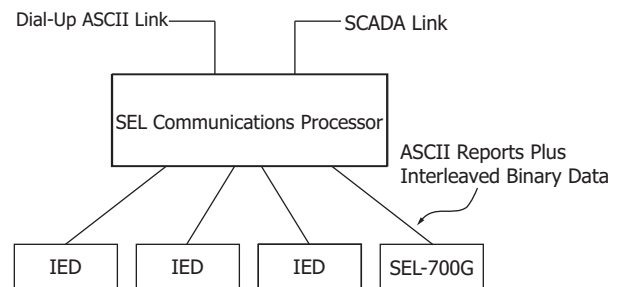

**Figure 25 Example Communications System**

SEL manufactures a variety of standard cables for connecting this and other relays to a variety of external devices. Consult your SEL representative for more information on cable availability. SEL-700G control logic improves integration in the following ways:

- ▶ **Replaces traditional panel control switches.** Eliminate traditional panel control switches with 32 local bits. Set, clear, or pulse local bits with the front-panel pushbuttons and display. Program the local bits into your control scheme with SELOGIC control equations. Use the local bits to perform functions such as a trip test or a breaker trip/close.
- ▶ **Eliminates RTU-to-relay wiring.** Eliminate RTU-to-relay wiring with 32 remote bits. Set, clear, or pulse remote bits using serial port commands. Program the remote bits into your control scheme with SELOGIC control equations. Use remote bits for SCADA-type control operations such as trip, close, and settings group selection.
- ▶ **Replaces traditional latching relays.** Replace up to 32 traditional latching relays for such functions as “remote control enable” with latch bits. Program latch set and latch reset conditions with SELOGIC control equations. Set or reset the nonvolatile latch bits using optoisolated inputs, remote bits, local bits, or any programmable logic condition. The latch bits retain their state when the relay loses power.
- ▶ **Replaces traditional indicating panel lights.** Replace traditional indicating panel lights with 32 programmable displays. Define custom messages (e.g., *Breaker Open*, *Breaker Closed*) to report power system or relay conditions on the front-panel display. Use Advanced SELOGIC control equations to control which messages the relay displays.
- ▶ **Eliminates external timers.** Eliminate external timers for custom protection or control schemes with 32 general purpose SELOGIC control equation timers. Each timer has independent time-delay pickup and dropout settings. Program each timer input with any desired element (e.g., time qualify a current element). Assign the timer output to trip logic, transfer trip communications, or other control scheme logic.
- ▶ **Eliminates settings changes.** Selectable setting groups make the SEL-700G ideal for applications requiring frequent setting changes and for adapting the protection to changing system conditions.

The relay stores three setting groups. Select the active setting group by optoisolated input, command, or other programmable conditions. Use these setting groups to cover a wide range of protection and control contingencies.

Switching setting groups switches logic and relay element settings. Program groups for different operating conditions, such as station maintenance, seasonal operations, emergency contingencies, loading, source changes, and downstream relay setting changes.

## Fast SER Protocol

SEL Fast SER Protocol provides SER events to an automated data collection system. SEL Fast SER Protocol is available on any rear serial port. Devices with embedded processing capability can use these messages to enable and accept unsolicited binary SER messages from SEL-700G relays.


SEL relays and communications processors have two separate data streams that share the same serial port. The normal serial interface consists of ASCII character commands and reports that are intelligible to people using a terminal or terminal emulation package. The binary data streams can interrupt the ASCII data stream to obtain information, and then allow the ASCII data stream to continue. This mechanism allows a single communications channel to be used for ASCII communications (e.g., transmission of a long event report) interleaved with short bursts of binary data to support fast acquisition of metering or SER data.

## Fast Message Protocol


SEL Fast Message Protocol is a method to input or modify remote analogs in the SEL-700G. These remote analogs can then be used in SEL Math or SELOGIC control equations. Remote analogs can also be modified via Modbus, DNP3, and IEC 61850.




# Ethernet Network Architectures

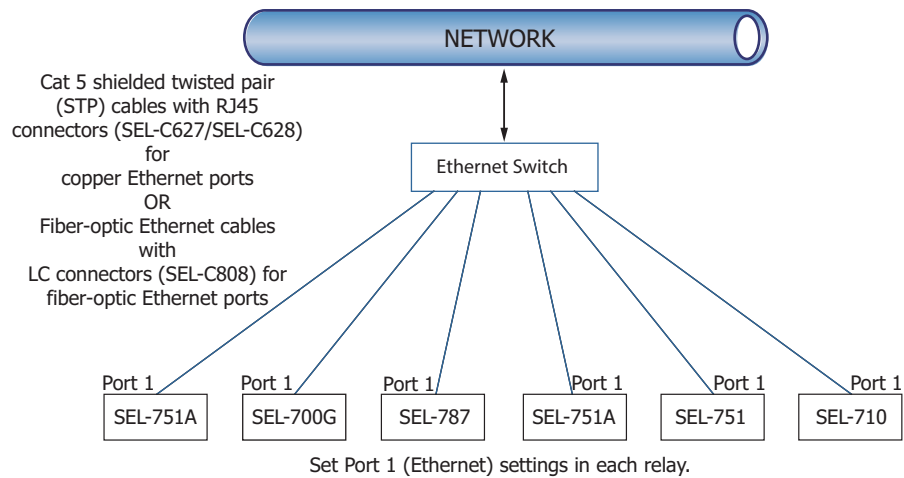

**Figure 26 Simple Ethernet Network Configuration**

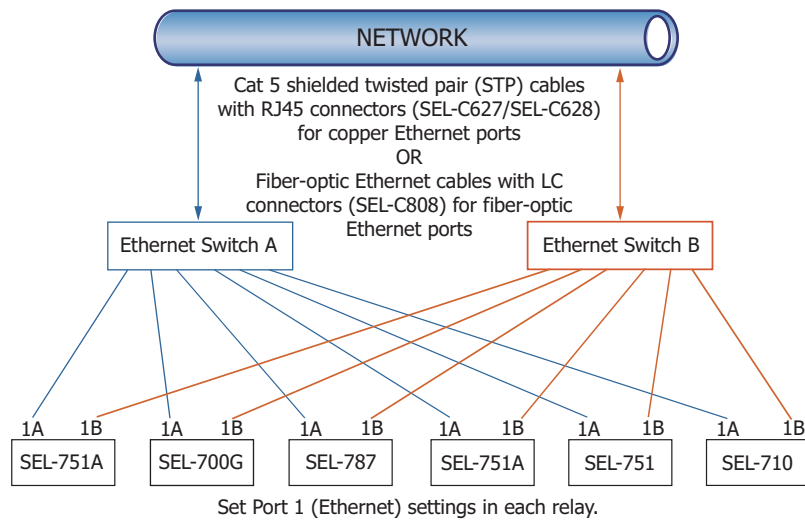

**Figure 27 Ethernet Network Configuration With Dual Redundant Connections (Failover Mode)**

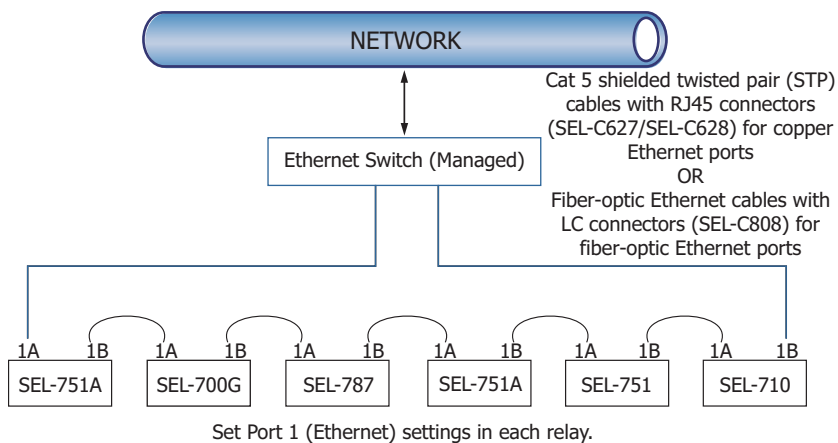


**Figure 28 Ethernet Network Configuration With Ring Structure (Switched Mode)**

## Additional Features

### MIRRORED BITS Relay-to-Relay Communications

The SEL-patented MIRRORED BITS communications technology provides bidirectional relay-to-relay digital communications. MIRRORED BITS can operate independently on as many as two EIA-232 rear serial ports and one fiber-optic rear serial port on a single SEL-700G.

This bidirectional digital communication creates eight additional virtual outputs (transmitted MIRRORED BITS) and eight additional virtual inputs (received MIRRORED BITS) for each serial port operating in the MIRRORED BITS mode (see *Figure 29*). Use these MIRRORED BITS to transmit/receive information between upstream relays and a downstream relay to enhance coordination and achieve faster tripping for downstream faults. MIRRORED BITS technology also helps reduce total scheme operating time by eliminating the need to assert output contacts to transmit information.

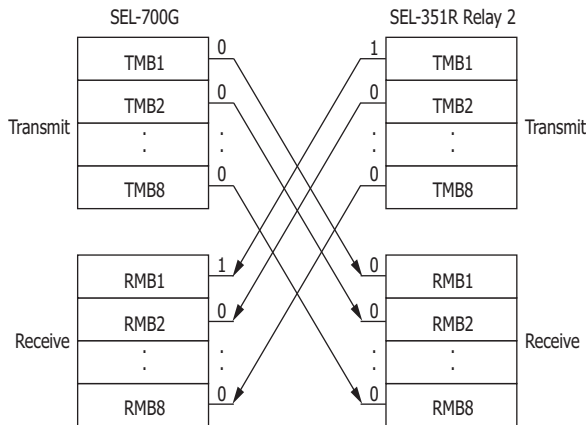

**Figure 29** MIRRORED BITS Transmit and Receive Bits

### Status and Trip Target LEDs

The SEL-700G includes 24 tricolor status and trip target LEDs on the front panel. When shipped from the factory, all LEDs are predefined and fixed in settings. You can

reprogram these LEDs for specific applications. This combination of targets is explained and shown in *Figure 32*. Some front-panel relabeling of LEDs may be needed if you reprogram them for unique or specific applications—see *Configurable Labels*.

### Configurable Labels

Use the configurable labels to relabel the operator controls and LEDs (shown in *Figure 32*) to suit the installation requirements. This feature includes preprinted labels (with factory-default text), blank label media, and a Microsoft® Word template. The Microsoft Word template is available at selinc.com. This allows quick, professional-looking labels for the SEL-700G. Labels may also be customized without the use of a PC by writing the new label on the blank stock provided. The ability to customize the control and indication features allows specific utility or industry procedures to be implemented without the need for adhesive labels. All of the figures in this data sheet show the factory-default labels of the SEL-700G, including the standard model shown in *Figure 32*.


### Web Server

Web Server allows you to communicate with the relay via the Ethernet Port without the need for additional communication software (web browser required). Web Server allows you to access metering and monitoring data, and also supports firmware upgrades.

### Firmware Download Via Ethernet Ports

Relay firmware can be securely downloaded to your relay via the Ethernet port. The firmware is digitally signed to prevent malicious modification. Additionally, the Ethernet firmware download allows you to access and update all your network relays simultaneously.

# Relay Dimensions

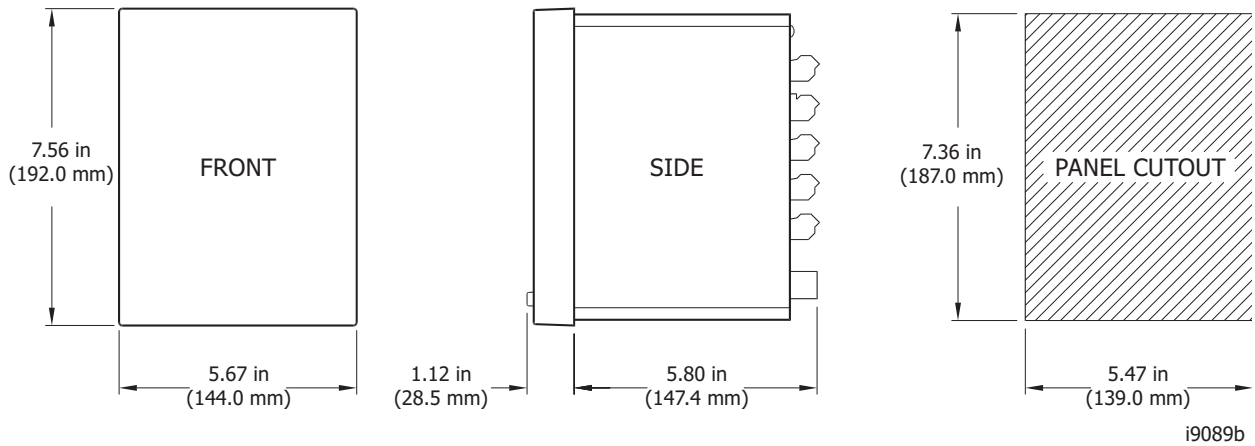

**Figure 30 SEL-700G Dimensions for Rack- and Panel-Mount Models**

# Hardware Overview


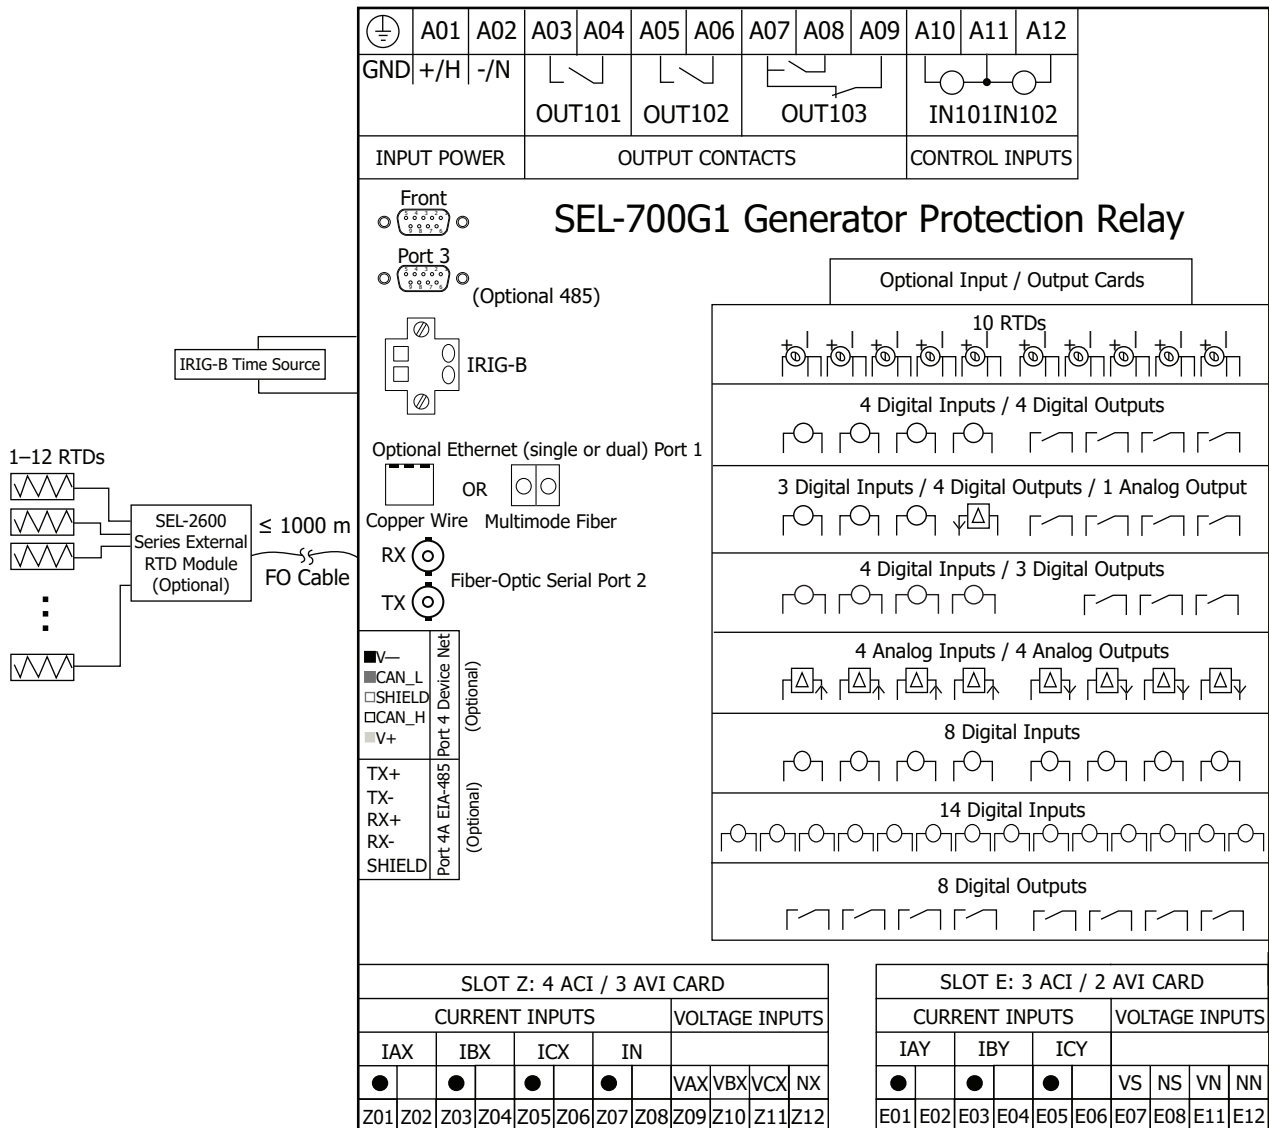


Figure 31 Typical Connection Diagram

# Relay Panel Diagrams


## SEL-700G1 Generator

(A) Front Panel With Default Configuration Labels

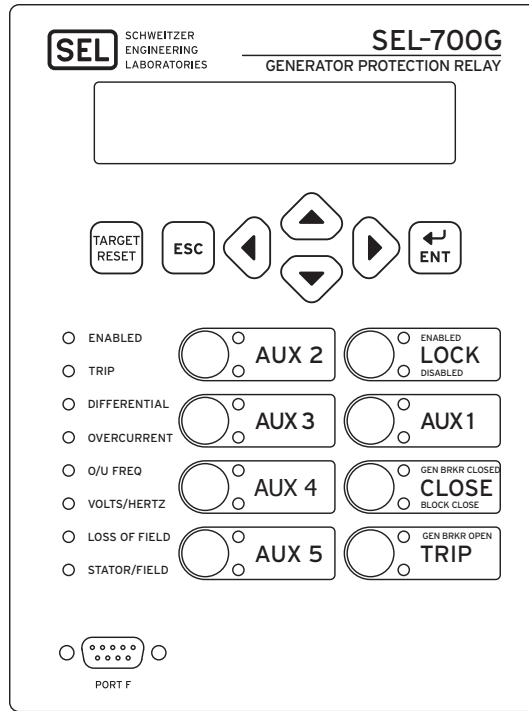


i4485a

(B) Rear-Panel View

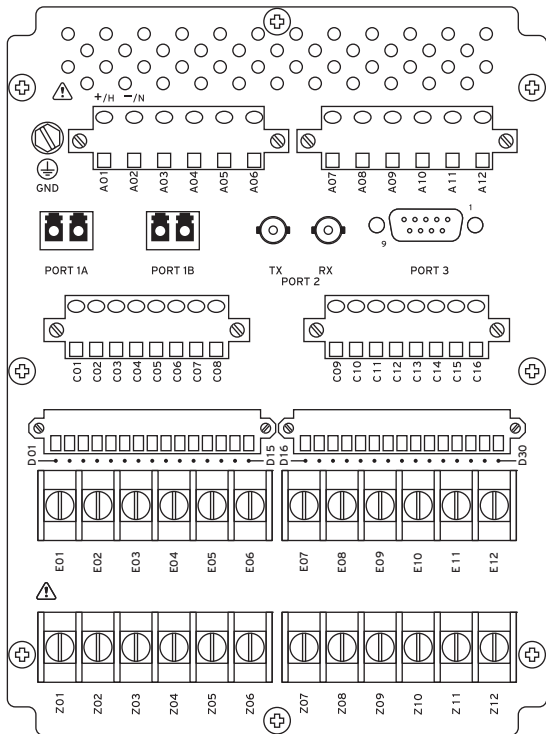

i4491a

(C) Side-Panel View

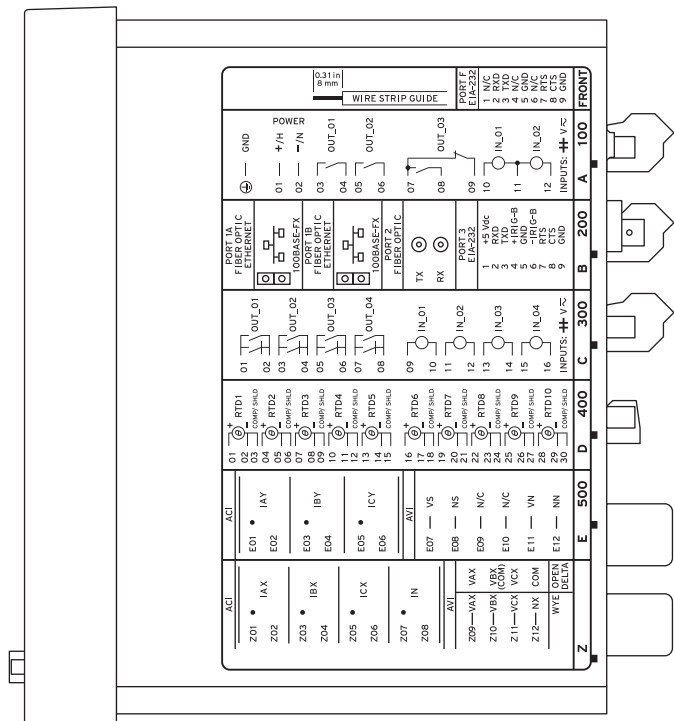


‡ SEE DOCUMENTATION FOR INPUT VOLTAGE RATING

i4488a


**Figure 32 Dual-Fiber Ethernet, Fast Hybrid 4 DI/4 DO, 10 RTDs, 3 ACI/2 AVI, 4 ACI/3 AVI (Relay MOT 0700G11ACA9X76850830)**

# SEL-700GT Intertie

(A) Front Panel With Default Configuration Labels

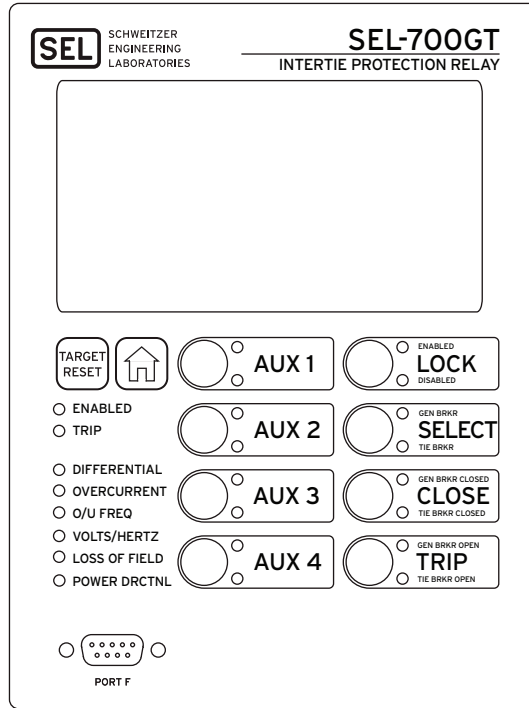


(B) Rear-Panel View

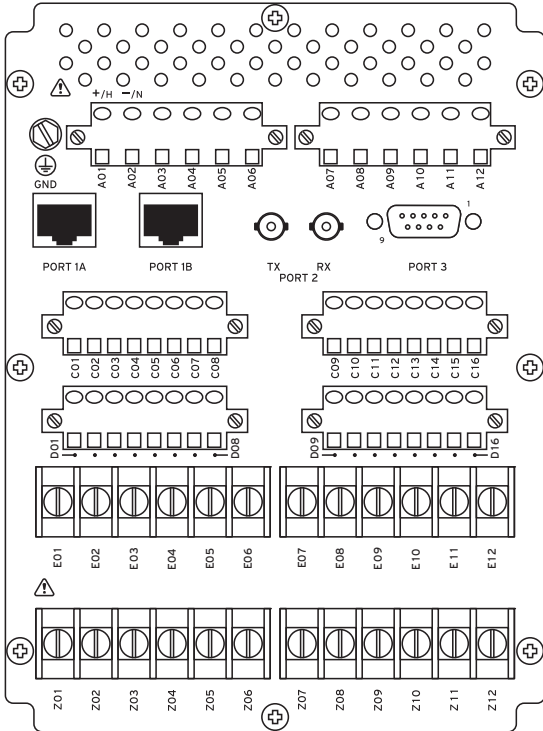

i4492a

(C) Side-Panel View

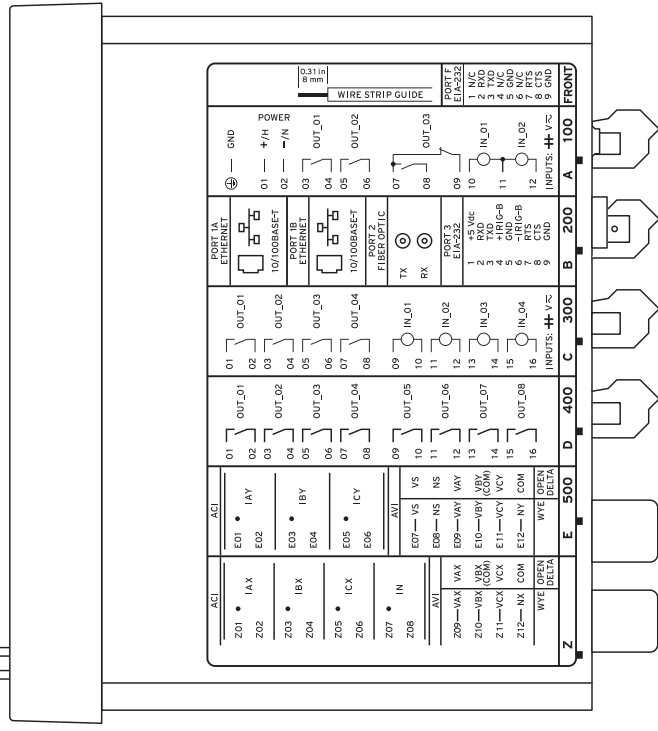


‡ SEE DOCUMENTATION FOR INPUT VOLTAGE RATING

i4489a

**Figure 33 Dual Copper Ethernet, 4 DI/4 DO, 8 DO, 3 ACI/4 AVI, 4 ACI/3 AVI (Relay MOT 0700GT1A2X7585A630)**


# SEL-700GW Wind Generator

(A) Front Panel With Default Configuration Labels

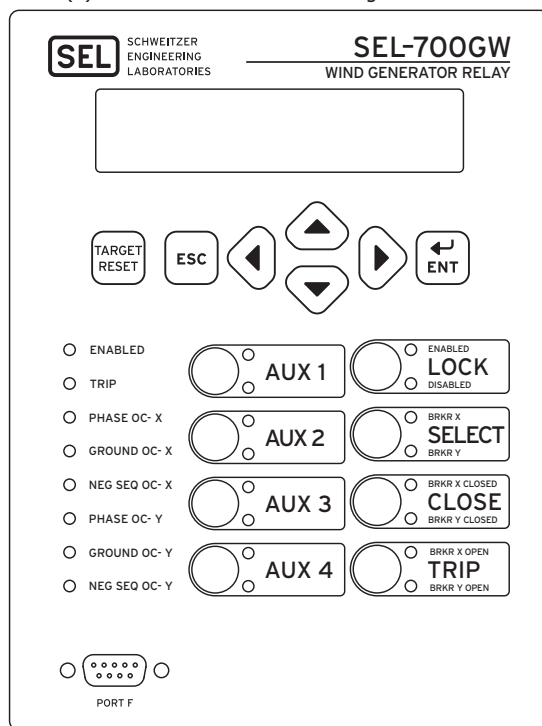


i4487a

(B) Rear-Panel View

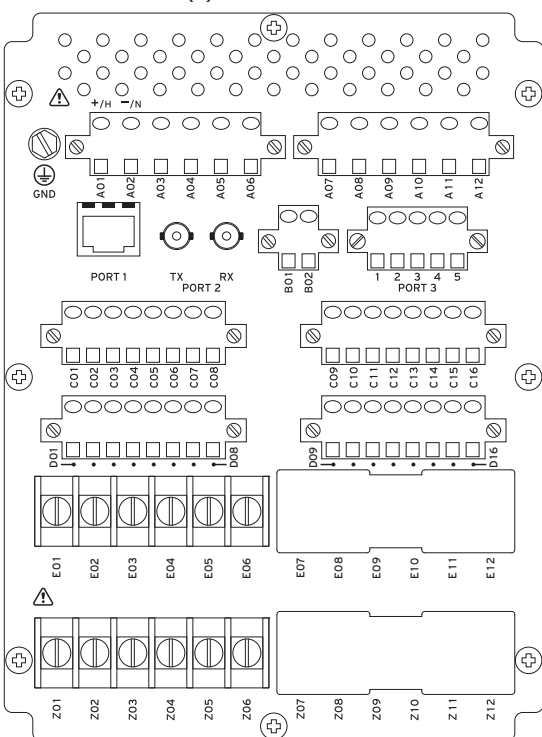

i4493b

(C) Side-Panel View

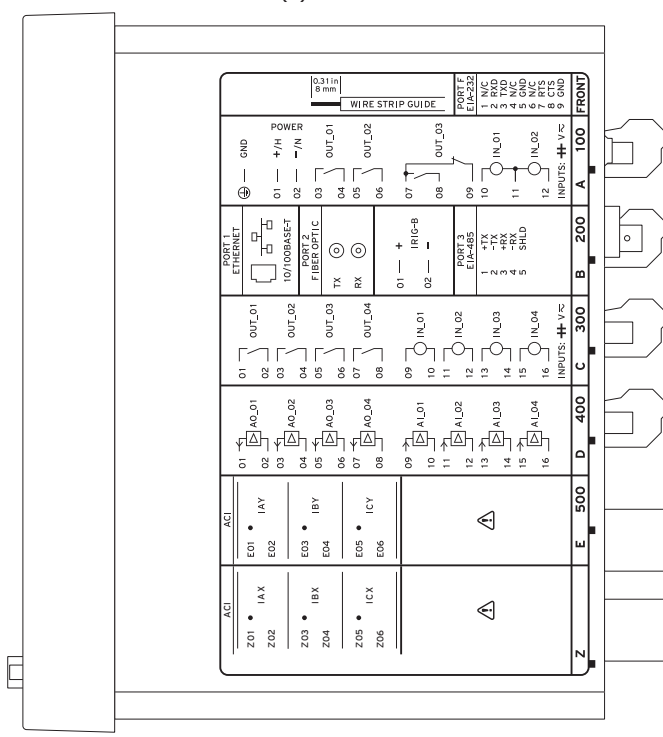

i4490b

**Figure 34 Copper Ethernet, 4 DI/4 DO, 4 AI/4 AO, 3 ACIE, 3 ACIZ (Relay MOT 0700GW1A1A6X77870310)**

# Applications

The SEL-700GT Intertie Protection Relay provides comprehensive multifunction protection, control, and monitoring for intertie applications and intertie generator applications. The SEL-700GT Relay capabilities meet or exceed the protection and control requirements specified in the ANSI/IEEE Std 1547-2018, Standard for Interconnecting Distributed Resources with Electric Power Systems.

## SEL-700G1 Generator Relay—Example 1


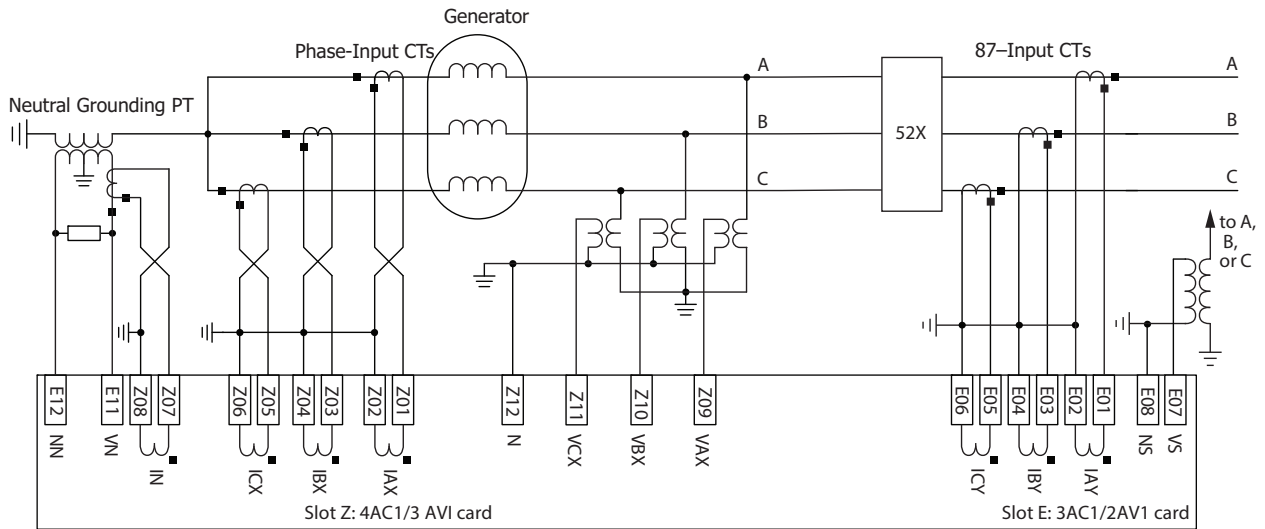


Figure 35 SEL-700G1 Relay Typical AC Current and Four-Wire Wye Voltage Connection



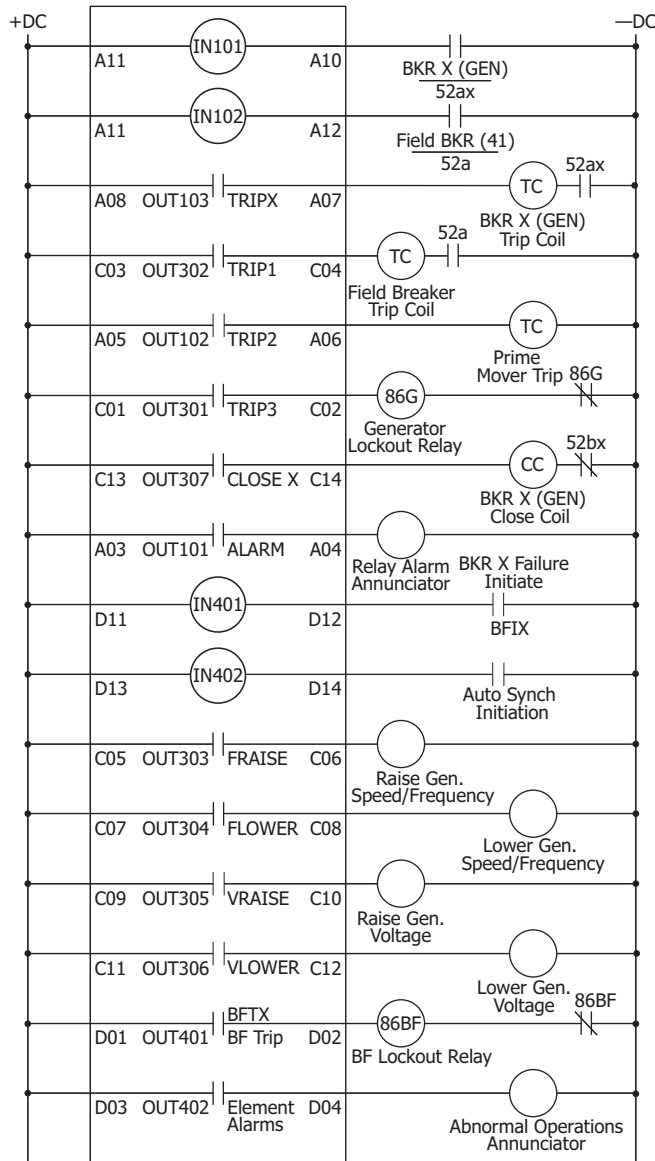


NOTES:

- IN101–102 and OUT 101–103 are in the “base” relay—Slot A Power Supply card.
- Slot C—Select 8DO card, OUT301–OUT308.
- Slot D—Select 3DI/4DO/1AO, IN401–IN403, OUT401–OUT404, or AO401.
- Spares IN403, OUT403–404, AO401, OUT308.
- Use Ethernet Port 1 for Synchrophasors, Modbus, DNP or IEC 61850.
- Use Port 2 for SEL-2600 RTD Module.
- Use Port 3 for SEL-2664 Field Ground Module (with a SEL-2812MR or 2812MT and a C805 fiber-optic cable).
- Settings changes required are not shown.
- Additional I/O and relay logic may be necessary for a specific application.

Figure 36 SEL-700G1 Typical DC External Connections

# SEL-700G1 Generator Relay-Example 2

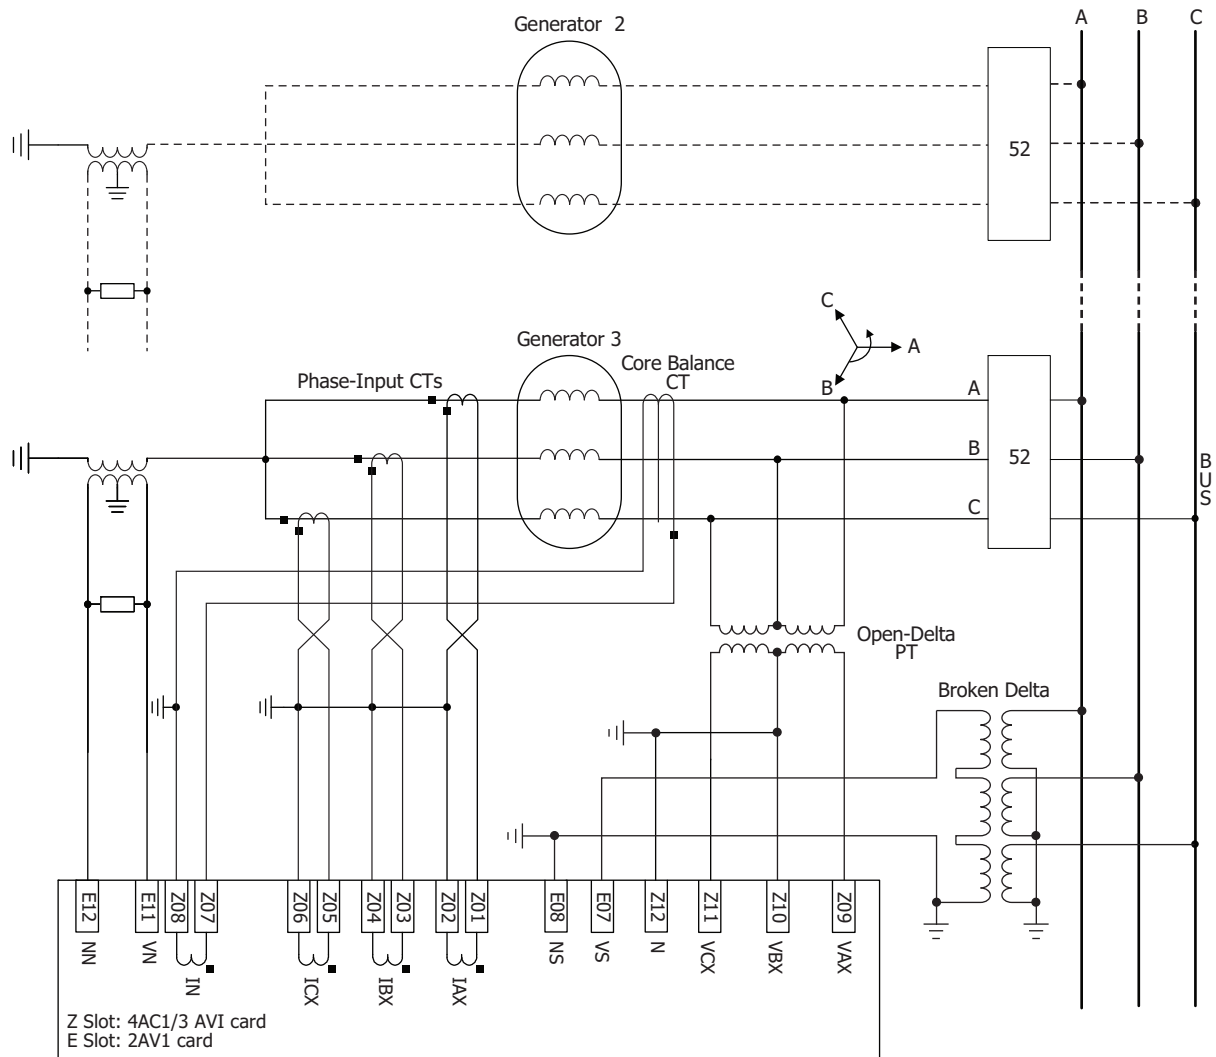

**Figure 37 SEL-700G1+ Relay AC Connection Example, Multiple High-Impedance Grounded Generators Connected to a Common Bus, With 67N and Other Protection**

# SEL-700GT Intertie Relay


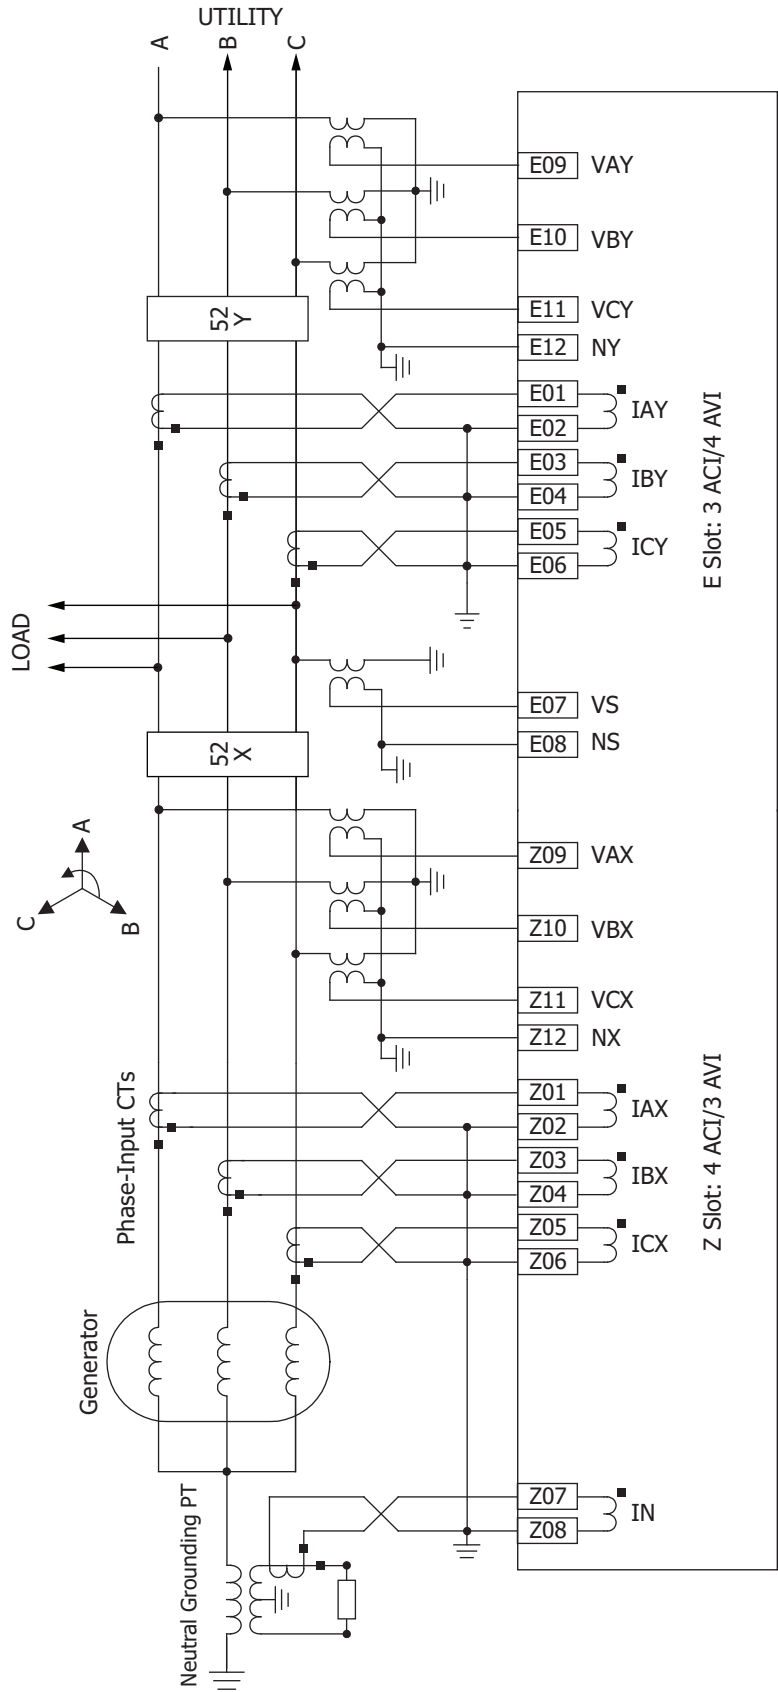



Figure 38 SEL-700GT Relay Typical AC Current and Four-Wire Wye Voltage Connection

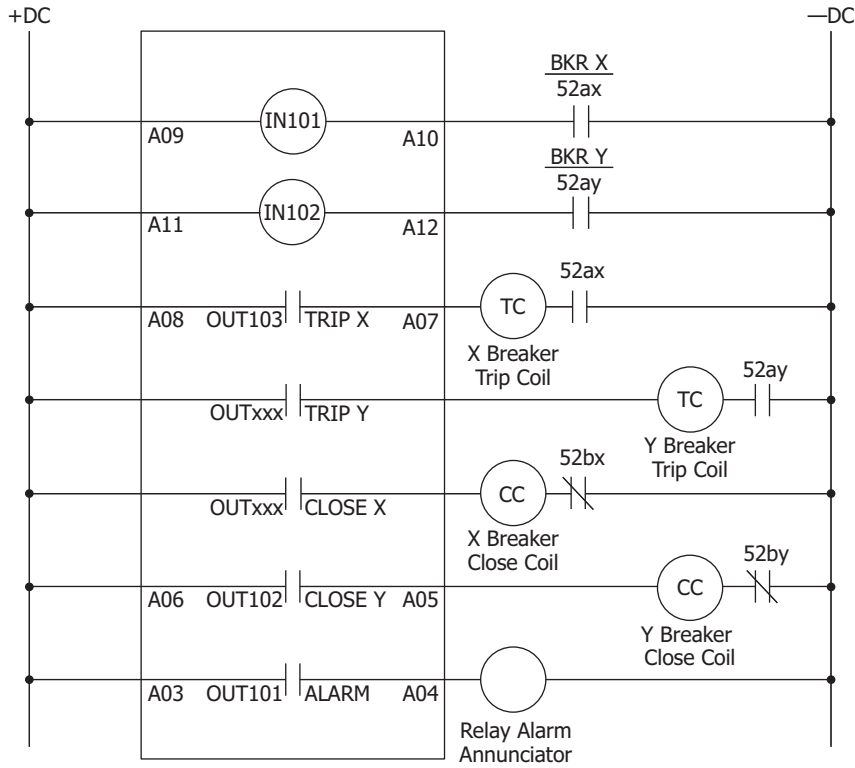


- NOTES:
- OUTxxx requires an additional I/O card in Slot C or D.
  - IN101-102 and OUT 101-103 are in the "base" relay.
  - Additional I/O and relay logic may be necessary for a specific application.
  - Settings changes are not shown.
  - RTD Inputs—requires SEL-2600 RTD Module or RTD input card in Slot D.

Figure 39 SEL-700GT Typical DC External Connections

# SEL-700GW Wind Generator Relay

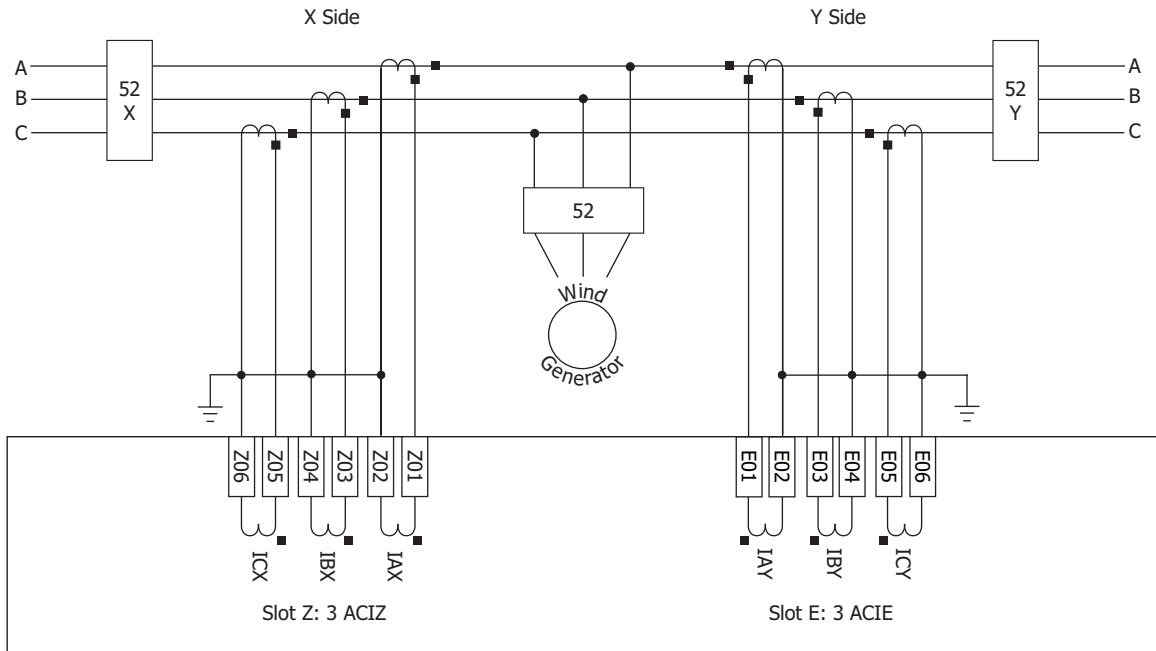

**Figure 40 SEL-700GW Dual Feeder AC Current Connections**

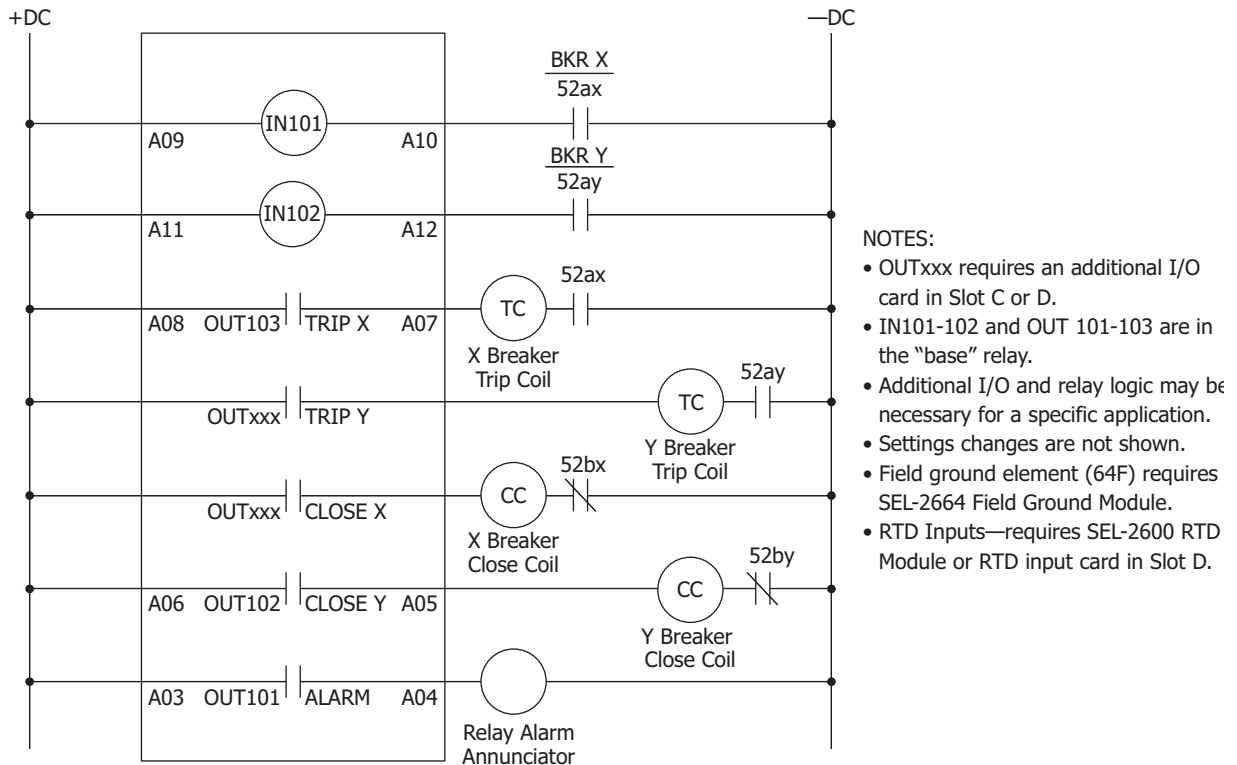

**Figure 41 SEL-700GW Typical DC External Connections**

# Specifications

## Compliance

Designed and manufactured under an ISO 9001 certified quality management system

47 CFR 15B, Class A

**Note:** This equipment has been tested and found to comply with the limits for a Class A digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference when the equipment is operated in a commercial environment. This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instruction manual, may cause harmful interference to radio communications. Operation of this equipment in a residential area is likely to cause harmful interference in which case the user will be required to correct the interference at his own expense.

CE Mark in accordance with the requirements of the European Union

RCM Mark in accordance with the requirements of Australia

UKCA Mark in accordance with the requirements of United Kingdom


## Normal Locations

UL Listed to U.S. and Canadian safety standards (File E212775, NRGU, NRGU7)

## Hazardous Locations

UL Certified Hazardous Locations to U.S. and Canadian standards CL I, DIV 2; GP A, B, C, D; T3C, maximum surrounding temperature of 50°C (File E470448)

EU



EN 60079-0:2012 + A11:2013, EN 60079-7:2015, EN 60079-15:2010, EN 60079-11:2012

Ambient air temperature shall not exceed  $-20^{\circ}\text{C} \leq T_a \leq 50^{\circ}\text{C}$

**Note:** Where so marked, ATEX and UL Hazardous Locations Certification tests are applicable to rated supply specifications only and do not apply to the absolute operating ranges, continuous thermal, or short circuit duration specifications.

## General

### AC Current Input

Phase and Neutral Currents

$I_{\text{NOM}} = 1 \text{ A}$  or  $5 \text{ A}$  secondary depending on the model

Measurement Category: II

**$I_{\text{NOM}} = 5 \text{ A}$**

Continuous Rating:  $3 \cdot I_{\text{NOM}}$  @  $85^{\circ}\text{C}$   
 $4 \cdot I_{\text{NOM}}$  @  $55^{\circ}\text{C}$

A/D Measurement Limit: 217 A peak (154 A rms) symmetrical

Saturation Current Rating: Linear to 96 A symmetrical

1-Second Thermal: 500 A

Burden (per Phase):  $<0.1 \text{ VA}$  @ 5 A

**$I_{\text{NOM}} = 1 \text{ A}$**

Continuous Rating:  $3 \cdot I_{\text{NOM}}$  @  $85^{\circ}\text{C}$   
 $4 \cdot I_{\text{NOM}}$  @  $55^{\circ}\text{C}$

A/D Measurement Limit: 43 A peak (31 A rms) symmetrical

Saturation Current Rating: Linear to 19.2 A symmetrical

1-Second Thermal: 100 A

Burden (per Phase):  $<0.01 \text{ VA}$  @ 1 A

### Rogowski Coil-Based AC Current Inputs—Phase and Neutral Current

Continuous Rating: 30 Vrms

Nominal Input Voltage: 65 mV to 4.16 Vrms

Number of Gain Ranges: 6

Full Scale Voltage: 4, 8, 16, 32, 64, 128 Vrms

A/D Measurement Limit:  $\pm 185 \text{ Vpeak}$  @ 60 Hz

10-Second Thermal: 200 Vac

Input Impedance:  $2 \text{ M}\Omega // 50 \text{ pF}$   
Standard Compliance: IEC 61869-6  
IEC 61869-13

### Low-Power Current Transformer (LPCT) Inputs—Phase and Neutral Current

Continuous Rating: 4 Vrms  
Nominal Input Voltage: 16 mV to 260 mVrms  
Number of Gain Ranges: 4  
Full Scale Voltage: 1, 2, 4, 8 Vrms  
A/D Measurement Limit:  $\pm 11.3 \text{ Vpeak}$   
10-Second Thermal: 200 Vac  
Input Impedance:  $2 \text{ M}\Omega // 50 \text{ pF}$   
Standard Compliance: IEC 61869-6  
IEC 61869-13

### AC Voltage Inputs

$V_{\text{NOM}}$  (L-L secondary) Range: 20–250 V (if DELTA\_Y := DELTA)  
20–480 V (if DELTA\_Y := WYE)

Rated Continuous Voltage: 300 Vac

10-Second Thermal: 600 Vac

Burden:  $<0.1 \text{ VA}$

Input Impedance:  $2 \text{ M}\Omega$  single-ended (phase-to-neutral)  
 $4 \text{ M}\Omega$  differential (phase-to-phase)

### Low-Energy Analog Voltage Sensor Inputs (RJ45 Input)

Continuous Rating: 8 Vrms  
Nominal Input Voltage: 0.5–6.8 Vrms  
Full-Scale Voltage: 8 Vrms  
A/D Measurement Limit:  $\pm 12 \text{ Vpeak}$   
10-Second Thermal: 200 Vac  
Input Impedance:  $2 \text{ M}\Omega // 50 \text{ pF}$   
Standard Compliance: IEC 61869-6  
IEC 61869-13

### Power Supply

Relay Start-Up Time: Approximately 5–10 seconds (after power is applied until the ENABLED LED turns on)

### High-Voltage Supply

Rated Supply Voltage: 110–240 Vac, 50/60 Hz  
110–250 Vdc

Input Voltage Range (Design Range): 85–264 Vac  
85–275 Vdc

Power Consumption:  $<50 \text{ VA}$  (ac)  
 $<25 \text{ W}$  (dc)

Interruptions: 50 ms @ 125 Vac/Vdc  
100 ms @ 250 Vac/Vdc

### Low-Voltage Supply

Rated Supply Voltage: 24–48 Vdc

Input Voltage Range (Design Range): 19.2–60 Vdc

Power Consumption:  $<25 \text{ W}$  (dc)

Interruptions: 10 ms @ 24 Vdc  
50 ms @ 48 Vdc

### Fuse Ratings

#### LV Power Supply Fuse

Rating: 3.15 A  
Maximum Rated Voltage: 300 Vdc, 250 Vac  
Breaking Capacity: 1500 A at 250 Vac  
Type: Time-lag T

**HV Power Supply Fuse**

Rating: 3.15 A  
 Maximum Rated Voltage: 300 Vdc, 250 Vac  
 Breaking Capacity: 1500 A at 250 Vac  
 Type: Time-lag T

**Output Contacts**

The relay supports Form A, B, and C outputs.  
 Dielectric Test Voltage: 2500 Vac  
 Impulse Withstand Voltage (U<sub>IMP</sub>): 5000 V  
 Mechanical Durability: 100,000 no-load operations

**Standard Contacts**

Pickup/Dropout Time: ≤8 ms (coil energization to contact closure)

**DC Output Ratings**

Rated Operational Voltage: 250 Vdc  
 Rated Voltage Range: 19.2–275 Vdc  
 Rated Insulation Voltage: 300 Vdc  
 Make: 30 A @ 250 Vdc per IEEE C37.90  
 Continuous Carry: 6 A @ 70°C  
 4 A @ 85°C  
 1-Second Thermal: 50 A  
 Contact Protection: 360 Vdc, 115 J MOV protection across open contacts

**Breaking Capacity (10,000 Operations) per IEC 60255-0-20:1974:**

24 Vdc	0.75 A	L/R = 40 ms
48 Vdc	0.50 A	L/R = 40 ms
125 Vdc	0.30 A	L/R = 40 ms
250 Vdc	0.20 A	L/R = 40 ms

**Cyclic (2.5 Cycles/Second) per IEC 60255-0-20:1974:**

24 Vdc	0.75 A	L/R = 40 ms
48 Vdc	0.50 A	L/R = 40 ms
125 Vdc	0.30 A	L/R = 40 ms
250 Vdc	0.20 A	L/R = 40 ms

**AC Output Ratings**

Maximum Operational Voltage (U<sub>e</sub>) Rating: 240 Vac  
 Insulation Voltage (U<sub>i</sub>) Rating (excluding EN 61010-1): 300 Vac  
 1-Second Thermal: 50 A  
 Contact Rating Designation: B300

B300 (5 A Thermal Current, 300 Vac Max)			
	Maximum Current		Max VA
Voltage	120 Vac	240 Vac	—
Make	30 A	15 A	3600
Break	3 A	1.5 A	360
PF < 0.35, 50–60 Hz			

Utilization Category: AC-15

AC-15		
Operational Voltage (U <sub>e</sub> )	120 Vac	240 Vac
Operational Current (I <sub>e</sub> )	3 A	1.5 A
Make Current	30 A	15 A
Break Current	3 A	1.5 A
Electromagnetic loads > 72 VA, PF < 0.3, 50–60 Hz		

Voltage Protection Across Open Contacts: 270 Vac, 115 J

**Fast Hybrid (High-Speed, High-Current Interrupting)**

**DC Output Ratings**

Rated Operational Voltage: 250 Vdc  
 Rated Voltage Range: 19.2–275 Vdc  
 Rated Insulation Voltage: 300 Vdc  
 Make: 30 A @ 250 Vdc per IEEE C37.90  
 Continuous Carry: 6 A @ 70°C  
 4 A @ 85°C  
 1-Second Thermal: 50 A  
 Open State Leakage Current: <500 µA  
 MOV Protection (Maximum Voltage): 250 Vac/330 Vdc  
 Pickup Time: <50 µs, resistive load  
 Dropout Time: ≤8 ms, resistive load  
 Break Capacity (10,000 Operations) per IEC 60255-0-20:1974:  

48 Vdc	10.0 A	L/R = 40 ms
125 Vdc	10.0 A	L/R = 40 ms
250 Vdc	10.0 A	L/R = 20 ms

 Cyclic Capacity (4 Cycles in 1 Second, Followed by 2 Minutes Idle for Thermal Dissipation) per IEC 60255-0-20:1974:  

48 Vdc	10.0 A	L/R = 40 ms
125 Vdc	10.0 A	L/R = 40 ms
250 Vdc	10.0 A	L/R = 20 ms

**AC Output Ratings**

See AC Output Ratings for Standard Contacts.

**Optoisolated Control Inputs**

**When Used With DC Control Signals**

Pickup/Dropout Time: Depends on the input debounce settings

250 V: ON for 200–312.5 Vdc  
 OFF below 150 Vdc

220 V: ON for 176–275 Vdc  
 OFF below 132 Vdc

125 V: ON for 100–156.2 Vdc  
 OFF below 75 Vdc

110 V: ON for 88–137.5 Vdc  
 OFF below 66 Vdc

48 V: ON for 38.4–60 Vdc  
 OFF below 28.8 Vdc

24 V: ON for 19.2–30 Vdc  
 OFF below 5 Vdc

**When Used With AC Control Signals**

Pickup Time: 2 ms  
 Dropout Time: 16 ms

250 V: ON for 170.6–312.5 Vac  
 OFF below 106 Vac

220 V: ON for 150.2–275 Vac  
 OFF below 93.3 Vac

125 V: ON for 85–156.2 Vac  
 OFF below 53 Vac

110 V: ON for 75.1–137.5 Vac  
 OFF below 46.6 Vac

48 V: ON for 32.8–60 Vac  
 OFF below 20.3 Vac

24 V: ON for 18–30 Vac  
 OFF below 5 Vac

Current Draw at Nominal DC Voltage: 2 mA (at 220–250 V)  
 4 mA (at 48–125 V)  
 10 mA (at 24 V)

Rated Impulse Withstand Voltage (U<sub>imp</sub>): 4000 V

**Analog Output (Optional)**

	<b>1A0</b>	<b>4A0</b>
Current:	4–20 mA	±20 mA
Voltage:	—	±10 V
Load at 1 mA:	—	0–15 kΩ
Load at 20 mA:	0–300 Ω	0–750 Ω
Load at 10 V:	—	>2000 Ω
Refresh Rate:	100 ms	100 ms
% Error, Full Scale, at 25°C:	<±1%	<±0.55%
Select From:	Analog quantities available in the relay	

**Analog Input (Optional)**

Maximum Input Range:	±20 mA ±10 V Operational range set by user
Input Impedance:	200 Ω (current mode) >10 kΩ (voltage mode)
Accuracy at 25°C	
With user calibration:	0.050% of full scale (current mode) 0.025% of full scale (voltage mode)
Without user calibration:	Better than 0.5% of full scale at 25°C
Accuracy Variation With Temperature:	±0.015% per °C of full scale (±20 mA or ±10 V)

**Frequency and Phase Rotation**

System Frequency:	50, 60 Hz
Phase Rotation:	ABC, ACB
Frequency Tracking:	15–70 Hz

**Time-Code Input**

Format:	Demodulated IRIG-B
On (1) State:	$V_{ih} \geq 2.2 \text{ V}$
Off (0) State:	$V_{il} \leq 0.8 \text{ V}$
Input Impedance:	2 kΩ
Synchronization Accuracy	
Internal Clock:	±1 μs
Synchrophasor Reports (e.g., MET PM):	±10 μs
All Other Reports:	±5 ms
SNTP Accuracy:	±1 ms (in an ideal network)
PTP Accuracy:	±1 ms
PTP Profiles:	Default, C37.238-2011 (power profile)
Unsynchronized Clock Drift Relay Powered:	2 minutes per year, typically

**Communications Ports****Standard EIA-232 (2 Ports)**

Location:	Front Panel Rear Panel
Data Speed:	300–38400 bps

**EIA-485 Port (Optional)**

Location:	Rear Panel
Data Speed:	300–19200 bps

**Ethernet Port (Optional)**

Single/Dual 10/100BASE-T copper (RJ45 connector)	
Single/Dual 100BASE-FX (LC connector)	

**Standard Multimode Fiber-Optic Port**

Location:	Rear Panel
Data Speed:	300–38400 bps

**Fiber-Optic Ports Characteristics****Port 1 (or 1A, 1B) Ethernet**

Wavelength:	1300 nm
Optical Connector Type:	LC
Fiber Type:	Multimode
Link Budget:	16.1 dB
Typical TX Power:	–15.7 dBm
RX Min. Sensitivity:	–31.8 dBm
Fiber Size:	62.5/125 μm
Approximate Range:	~6.4 km
Data Rate:	100 Mbps
Typical Fiber Attenuation:	–2 dB/km

**Port 2 Serial**

Wavelength:	820 nm
Optical Connector Type:	ST
Fiber Type:	Multimode
Link Budget:	8 dB
Typical TX Power:	–16 dBm
RX Min. Sensitivity:	–24 dBm
Fiber Size:	62.5/125 μm
Approximate Range:	~1 km
Data Rate:	5 Mbps
Typical Fiber Attenuation:	–4 dB/km

**Optional Communications Cards**

Option 1:	EIA-232 or EIA-485 communications card
Option 2:	DeviceNet communications card

**Communications Protocols**

SEL, Modbus, DNP, FTP, TCP/IP, Telnet, SNTP, IEEE 1588-2008 firmware-based PTP, IEC 61850 Edition 2, IEC 60870-5-103, IEC 62439-3 PRP, IEEE 802.1Q-2014 Rapid Spanning Tree Protocol (RSTP), MIRRORING BITS, EVMSG, EtherNet/IP, C37.118 (synchrophasors), and DeviceNet

**Operating Temperature**

IEC Performance Rating:	–40° to +85°C (–40° to +185°F) (per IEC/EN 60068-2-1 and 60068-2-2)
-------------------------	--

**Note:** Not applicable to UL applications

**Note:** The front-panel display is impaired for temperatures below –20°C and above +70°C

**DeviceNet Communications**

Card Rating:	+60°C (140°F) maximum
Optoisolated Control Inputs:	As many as 26 inputs are allowed in ambient temperatures of 85°C or less. As many as 34 inputs are allowed in ambient temperatures of 75°C or less. As many as 44 inputs are allowed in ambient temperatures of 65°C or less.

**Operating Environment**

Insulation Class:	I
Pollution Degree:	2
Overvoltage Category:	II
Atmospheric Pressure:	80–110 kPa
Relative Humidity:	5%–95%, noncondensing
Maximum Altitude Without Derating (Consult the Factory for Higher Altitude Derating):	2000 m

**Dimensions**

144.0 mm (5.67 in) x 192.0 mm (7.56 in) x 147.4 mm (5.80 in)



**Weight**

2.7 kg (6.0 lb)

**Relay Mounting Screw (#8-32) Tightening Torque**

Minimum: 1.4 Nm (12 in-lb)  
 Maximum: 1.7 Nm (15 in-lb)

**Terminal Connections****Terminal Block**

Screw Size: #6  
 Ring Terminal Width: 0.310 inch maximum

**Terminal Block Tightening Torque**

Minimum: 0.9 Nm (8 in-lb)  
 Maximum: 1.4 Nm (12 in-lb)

**Compression Plug Tightening Torque**

Minimum: 0.5 Nm (4.4 in-lb)  
 Maximum: 1.0 Nm (8.8 in-lb)

**Compression Plug Mounting Ear Screw Tightening Torque**

Minimum: 0.18 Nm (1.6 in-lb)  
 Maximum: 0.25 Nm (2.2 in-lb)

**RTD Compression Plug Tightening Torque**

Maximum: 0.25 Nm (2.2 in-lb)

**Product Standards**

Electromagnetic Compatibility: IEC 60255-26:2013  
 IEC 60255-27:2013  
 UL 508  
 CSA C22.2 No. 14-05

**Type Tests****Environmental Tests**

Enclosure Protection: IEC 60529:2001 + CRDG:2003  
 IP65 enclosed in panel (2-line display models)  
 IP54 enclosed in panel (touchscreen display models)  
 IP50 for terminals enclosed in the dust protection assembly (protection against solid foreign objects only) (SEL Part #915900170). The 10°C temperature derating applies to the temperature specifications of the relay.  
 IP10 for terminals and the relay rear panel  
 IP20 for terminals and the relay rear panel with optional terminal block cover

**Note:** If the rear terminals are accessible during normal use, the product must be mounted in a locked enclosure or restricted area accessible by trained maintenance or operation personnel only.

Vibration Resistance: IEC 60255-21-1:1988  
 IEC 60255-27:2013, Section 10.6.2.1  
 Endurance: Class 2  
 Response: Class 2

Shock Resistance: IEC 60255-21-2:1988  
 IEC 60255-27:2013, Section 10.6.2.2  
 IEC 60255-27:2013, Section 10.6.2.3  
 Withstand: Class 1  
 Response: Class 2  
 Bump: Class 1

Seismic (Quake Response): IEC 60255-21-3:1993  
 IEC 60255-27:2013, Section 10.6.2.4  
 Response: Class 2

Cold: IEC 60068-2-1:2007  
 IEC 60255-27:2013, Section 10.6.1.2  
 IEC 60255-27:2013, Section 10.6.1.4  
 -40°C, 16 hours

Dry Heat: IEC 60068-2-2:2007  
 IEC 60255-27:2013, Section 10.6.1.1  
 IEC 60255-27:2013, Section 10.6.1.3  
 85°C, 16 hours

Damp Heat, Steady State: IEC 60068-2-78:2001  
 IEC 60255-27:2013, Section 10.6.1.5  
 40°C, 93% relative humidity, 10 days

Damp Heat, Cyclic: IEC 60068-2-30:2001  
 IEC 60255-27:2013, Section 10.6.1.6  
 25°–55°C, 6 cycles, 95% relative humidity

Change of Temperature: IEC 60068-2-14:2009  
 IEC 60255-1:2010, Section 6.12.3.5  
 -40° to 85°C, ramp rate 1°C/min, 5 cycles

**Dielectric Strength and Impulse Tests**

Dielectric (HiPot): IEC 60255-27:2013, Section 10.6.4.3  
 IEEE C37.90-2005  
 1.0 kVac on analog outputs, Ethernet ports  
 820 Vac on LEA inputs  
 2.0 kVac on analog inputs  
 2.0 kVdc on IRIG port  
 2.5 kVac on contact I/O  
 3.6 kVdc on power supply, current, and voltage inputs

Impulse: IEC 60255-27:2013, Section 10.6.4.2  
 0.5 J, 5 kV on power supply, contact I/O, ac current, and voltage inputs  
 0.5 J, 530 V on analog outputs  
 0.5 J, 1.5 kV on LEA inputs  
 IEEE C37.90:2005  
 0.5 J, 5 kV  
 0.5 J, 530 V on analog outputs

**RFI and Interference Tests****EMC Immunity**

Electrostatic Discharge Immunity: IEC 61000-4-2:2008  
 IEC 60255-26:2013, Section 7.2.3  
 IEEE C37.90.3:2001  
 Severity Level 4  
 8 kV contact discharge  
 15 kV air discharge

Radiated RF Immunity: IEC 61000-4-3:2010  
 IEC 60255-26:2013, Section 7.2.4  
 10 V/m  
 IEEE C37.90.2-2004  
 20 V/m

Fast Transient, Burst Immunity<sup>a</sup>: IEC 61000-4-4:2012  
 IEC 60255-26:2013, Section 7.2.5  
 4 kV @ 5.0 kHz  
 2 kV @ 5.0 kHz for comm. ports

Surge Immunity<sup>a,b</sup>: IEC 61000-4-5:2005  
 IEC 60255-26:2013, Section 7.2.7  
 2 kV line-to-line  
 4 kV line-to-earth  
 LEA ports compliant with IEC 61869-13 tested to 1 kV, 1 MHz line-to-earth only

Surge Withstand Capability Immunity<sup>a</sup>: IEC 61000-4-18:2010  
 IEC 60255-26:2013, Section 7.2.6  
 2.5 kV common mode  
 1.0 kV differential mode  
 1.0 kV common mode on comm. ports  
 IEEE C37.90.1-2012  
 2.5 kV oscillatory  
 4.0 kV fast transient

Conducted RF Immunity:	IEC 61000-4-6:2008 IEC 60255-26:2013, Section 7.2.8 10 Vrms
Magnetic Field Immunity:	IEC 61000-4-8:2009 IEC 60255-26:2013, Section 7.2.10 Severity Level: 1000 A/m for 3 seconds 100 A/m for 1 minute; 50/60 Hz IEC 61000-4-9:2001 Severity Level: 1000 A/m IEC 61000-4-10:2001 Severity Level: 100 A/m (100 kHz and 1 MHz)
Power Supply Immunity:	IEC 61000-4-11:2004 IEC 61000-4-17:1999 IEC 61000-4-29:2000 IEC 60255-26:2013, Section 7.2.11 IEC 60255-26:2013, Section 7.2.12 IEC 60255-26:2013, Section 7.2.13
<b>EMC Emissions</b>	
Conducted Emissions:	IEC 60255-26:2013 Class A FCC 47 CFR Part 15.107 Class A Canada ICES-001 (A) / NMB-001 (A) EN 55011:2009 + A1:2010 Class A EN 55022:2010 + AC:2011 Class A EN 55032:2012 + AC:2013 Class A CISPR 11:2009 + A1:2010 Class A CISPR 22:2008 Class A CISPR 32:2015 Class A
Radiated Emissions:	IEC 60255-26:2013 Class A FCC 47 CFR Part 15.109 Class A Canada ICES-001 (A) / NMB-001 (A) EN 55011:2009 + A1:2010 Class A EN 55022:2010 + AC:2011 Class A EN 55032:2012 + AC:2013 Class A CISPR 11:2009 + A1:2010 Class A CISPR 22:2008 Class A CISPR 32:2015 Class A

## Processing Specifications and Oscillography

AC Voltage and Current Inputs:	32 samples per power system cycle
Analog Inputs:	4 samples per power system cycle
Frequency Tracking Range:	15–70 Hz
Digital Filtering:	One-cycle cosine after low-pass analog filtering. Net filtering (analog plus digital) rejects dc and all harmonics greater than the fundamental.
Protection and Control Processing:	Processing interval is 4 times per power system cycle (except for math variables and analog quantities, which are processed every 25 ms). The protection elements 40, 51, and 78 are processed twice per cycle. Analog quantities for rms data are determined through use of data averaged over the previous 8 cycles.

## Oscillography

Length:	15, 64, 180 cycles
Sampling Rate:	32 samples per cycle unfiltered 4 samples per cycle filtered
Trigger:	Programmable with Boolean expression
Format:	ASCII and Compressed ASCII Binary COMTRADE (32 samples per cycle unfiltered)
Time-Stamp Resolution:	1 ms
Time-Stamp Accuracy:	±5 ms

## Sequential Events Recorder

Time-Stamp Resolution:	1 ms
Time-Stamp Accuracy (With Respect to Time Source) for all RWBs except those corresponding to digital inputs (IN <sub>xxx</sub> ):	±5 ms
Time-Stamp Accuracy (With Respect to Time Source) for RWBs corresponding to digital inputs (IN <sub>xxx</sub> ):	1 ms

## Relay Elements

### Instantaneous/Definite Time-Overcurrent (50P, 50G, 50N, 50Q)

Pickup Setting Range, A secondary	
5 A models:	0.25–96.00 A, 0.01 A steps
1 A models:	0.05–19.20 A, 0.01 A steps
Accuracy:	±5% of setting plus ±0.02 • I <sub>NOM</sub> A secondary (steady-state pickup)
Time Delay:	0.00–400.00 seconds, 0.01 seconds steps, ±0.5% plus ±0.25 cycle 0.10–400.00 seconds, 0.01 seconds steps, ±0.5% plus ±0.25 cycle for 50Q
Pickup/Dropout Time:	<1.5 cycle

### Inverse-Time Overcurrent (51P, 51G, 51N, 51Q)

Pickup Setting Range, A secondary	
5 A models:	0.25–16.00 A, 0.01 A steps
1 A models:	0.05–3.20 A, 0.01 A steps
Accuracy:	±5% of setting plus ±0.02 • I <sub>NOM</sub> A secondary (steady-state pickup)
Time Dial	
US:	0.50–15.00, 0.01 steps
IEC:	0.05–1.00, 0.01 steps
Accuracy:	±1.5 cycles plus ±4% between 2 and 30 multiples of pickup (within rated range of current)

## Differential (87)

Unrestrained Pickup Range:	1.0–20.0 in per unit of TAP
Restrained Pickup Range:	0.10–1.00 in per unit of TAP
Pickup Accuracy (A secondary)	
5 A Model:	±5% plus ±0.10 A
1 A Model:	±5% plus ±0.02 A
TAP Range (A secondary)	
5 A Model:	0.5–31.0 A
1 A Model:	0.1–6.2 A
Unrestrained Element	
Pickup Time:	0.8/1.0/1.9 cycles (Min/Typ/Max)
Restrained Element (With Harmonic Blocking)	
Pickup Time:	1.5/1.6/2.2 cycles (Min/Typ/Max)
Restrained Element (With Harmonic Restraint)	
Pickup Time:	2.62/2.72/2.86 cycles (Min/Typ/Max)

## Harmonics

Pickup Range (% of fundamental):	5%–100%
Pickup Accuracy (A secondary)	
5 A Model:	±5% plus ±0.10 A of harmonic current
1 A Model:	±5% plus ±0.02 A of harmonic current
Time Delay Accuracy:	±0.5% plus ±0.25 cycle

## Restricted Earth Fault (REF)

Pickup Range (per unit of I <sub>NOM</sub> of neutral current input, IN):	0.05–3.00 per unit, 0.01 per-unit steps
---	---

## Pickup Accuracy (A secondary)

5 A Model:	±5% plus ±0.10 A
1 A Model:	±5% plus ±0.02 A

## Timing Accuracy

Directional Output Maximum Pickup/Dropout Time:	1.75 cycles
ANSI Extremely Inverse TOC Curve (U4 With 0.5 Time Dial):	±5 cycles plus ±5% between 2 and 30 multiples of pickup (within rated range of current)

**Undervoltage (27P, 27PP, 27VI, 27S)**

Pickup Range:	Off, 2.0–300.0 V (2.0–520.0 V for phase-to-phase wye connected; 2.0–170.0 V positive-sequence, delta connected)
Accuracy:	±5% of setting plus ±2 V
Pickup/Dropout Time:	<1.5 cycle
Time Delay:	0.00–120.00 seconds, 0.01 second steps
Accuracy:	±0.5% plus ±0.25 cycle

**Overvoltage (59P, 59PP, 59VI, 59S, 59Q, 59G)**

Pickup Range:	Off, 2.0–300.0 V (2.0–520.0 V for phase-to-phase wye connected; 2.0–170.0 V positive sequence, delta connected)
Pickup Range (59G, 59Q):	Off, 2.0–200.0 V
Accuracy:	±5% of setting plus ±2 V
Pickup/Dropout Time:	<1.5 cycle
Time Delay:	0.00–120.00 seconds, 0.01 second steps
Accuracy:	±0.5% plus ±0.25 cycle

**Inverse-Time Undervoltage (27I)**

Setting Range:	OFF, 2.00–300.00 V (Phase elements, positive-sequence elements, phase- to-phase elements with delta inputs or synchronism voltage input) OFF, 2.00–520.00 V (Phase-to-phase elements with wye inputs)
Accuracy:	±1% of setting plus ±0.5 V
Time Dial:	0.00–16.00 s
Accuracy:	±1.5 cyc plus ±4% between 0.95 and 0.1 multiples of pickup

**Inverse-Time Overvoltage (59I)**

Setting Range:	OFF, 2.00–300.00 V (Phase elements, sequence elements, or phase-to-phase elements with delta inputs, neutral voltage input, or synchronism voltage input) OFF, 2.00–520.00 V (Phase-to-phase elements with wye inputs)
Accuracy:	±1% of setting plus ±0.5 V
Time Dial:	0.00–16.00 s
Accuracy:	±1.5 cyc plus ±4% between 1.05 and 5.5 multiples of pickup

**Volts/Hertz (24)**

## Definite-Time Element

Pickup Range:	100%–200%
Steady-State Pickup Accuracy:	±1% of set point
Pickup Time:	25 ms @ 60 Hz (Max)
Time-Delay Range:	0.04–400.00 s
Time-Delay Accuracy:	±0.1% plus ±4.2 ms @ 60 Hz
Reset Time Range:	0.00–400.00 s

## Inverse-Time Element

Pickup Range:	100%–200%
Steady-State Pickup Accuracy:	±1% of set point
Pickup Time:	25 ms @ 60 Hz (Max)
Curve:	0.5, 1.0, or 2.0
Factor:	0.1–10.0 s
Timing Accuracy:	±4% plus ±25 ms @ 60 Hz, for V/Hz above 1.2 multiple of pickup setting, and for operating times >4 s
Reset Time Range:	0.00–400.00 s

## Composite-Time Element

Combination of Definite-Time and Inverse-Time specifications

## User-Definable Curve Element

Pickup Range:	100%–200%
Steady-State Pickup Accuracy:	±1% of set point
Pickup Time:	25 ms @ 60 Hz (Max)
Reset Time Range:	0.00–400.00 s

**Vector Shift (78VS)**

Pickup Setting Range:	2.0°–30.0°, 0.1° increment
Accuracy:	±10% of the pickup setting, ±1 degree
Voltage Supervision Threshold:	20.0%–100.0% • VNOM
Pickup Time:	<3 cycles

**Directional Power (32)**

## Instantaneous/Definite Time, 3 Phase Elements

Type:	+W, –W, +VAR, –VAR
Pickup Settings Range, VA secondary	
5 A Model:	1.0–6500.0 VA, 0.1 VA steps
1 A Model:	0.2–1300.0 VA, 0.1 VA steps
Accuracy:	±0.10 A • (L-L voltage secondary) and ±5% of setting at unity power factor for power elements and zero power factor for reactive power element (5 A nominal) ±0.02 A • (L-L voltage secondary) and ±5% of setting at unity power factor for power elements and zero power factor for reactive power element (1 A nominal)
Pickup/Dropout Time:	<10 cycles
Time Delay:	0.00–240.00 seconds, 0.01 second steps
Accuracy:	±0.5% plus ±0.25 cycle

**Frequency (81)**

Setting Range:	Off, 15.00–70.00 Hz
Accuracy:	±0.01 Hz (V1 > 60 V)
Pickup/Dropout Time:	<4 cycles
Time Delay:	0.00–400.00 seconds, 0.01 second steps
Accuracy:	±0.5% plus ±0.25 cycle

**RTD Protection**

Setting Range:	Off, 1°–250°C
Accuracy:	±2°C
RTD Open-Circuit Detection:	>250°C
RTD Short-Circuit Detection:	<–50°C
RTD Types:	PT100, NI100, NI120, CU10
RTD Lead Resistance:	25 ohm max. per lead
Update Rate:	<3 s
Noise Immunity on RTD Inputs:	To 1.4 Vac (peak) at 50 Hz or greater frequency
RTD Fault/Alarm/Trip Time Delay:	Approx. 12 s

**Distance Element (21)**

Two zones of compensator distance elements with load encroachment block

Reach Pickup Range:	5 A model: 0.1–100.0 ohms 1 A model: 0.5–500.0 ohms
Offset Range:	5 A model: 0.0–10.0 ohms 1 A model: 0.0–50.0 ohms
Steady-State Impedance Accuracy:	5 A model: $\pm 5\%$ plus $\pm 0.1$ ohm 1 A model: $\pm 5\%$ plus $\pm 0.5$ ohm
Pickup Time:	33 ms at 60 Hz (Max)
Definite-Time Delay:	0.00–400.00 s
Accuracy:	$\pm 0.1\%$ plus $\pm 0.25$ cycle
Minimum Phase Current:	5 A model: 0.5 A 1 A model: 0.1 A
Maximum Torque Angle Range:	90°–45°, 1° step

**Loss-of-Field Element (40)**

Two Mho Zones

Zone 1 Offset:	5 A model: –50.0 to 0.0 ohms 1 A model: –250.0 to 0.0 ohms
Zone 2 Offset:	5 A model: –50.0 to 50.0 ohms 1 A model: –250.0 to 250.0 ohms
Zone 1 and Zone 2 Diameter:	5 A model: 0.1–100.0 ohms 1 A model: 0.5–500.0 ohms
Steady-State Impedance Accuracy:	5 A model: $\pm 0.1$ ohm plus $\pm 5\%$ of (offset + diameter) 1 A model: $\pm 0.5$ ohm plus $\pm 5\%$ of (offset + diameter)
Minimum Pos.-Seq. Signals:	5 A model: 0.25 V (V1), 0.25 A (I1) 1 A model: 0.25 V (V1), 0.05 A (I1)
Directional Element Angle:	–20.0° to 0.0°
Pickup Time:	3 cycles (Max)
Zone 1 and Zone 2 Definite-Time Delays:	0.00–400.00 s
Accuracy:	$\pm 0.1\%$ plus $\pm 1/2$ cycle

**Voltage-Restrained Phase Time-Overcurrent Element (51V)**

Phase Pickup (A secondary):	5 A Model: 2.0–16.0 A 1 A Model: 0.4–3.2 A
Steady-State Pickup Accuracy:	5 A Model: $\pm 5\%$ plus $\pm 0.10$ A 1 A Model: $\pm 5\%$ plus $\pm 0.02$ A
Time Dials:	US: 0.50–15.00, 0.01 steps IEC: 0.05–1.00, 0.01 steps
Accuracy:	$\pm 4\%$ plus $\pm 1.5$ cycles for current between 2 and 20 multiples of pickup (within rated range of current)
Linear Voltage Restraint Range:	0.125–1.000 per unit of VNOM

**Voltage-Controlled Phase Time-Overcurrent Element (51C)**

Phase Pickup (A secondary):	5 A Model: 0.5–16.0 A 1 A Model: 0.1–3.2 A
Steady State Pickup Accuracy:	5 A Model: $\pm 5\%$ plus $\pm 0.10$ A 1 A Model: $\pm 5\%$ plus $\pm 0.02$ A
Time Dials:	US: 0.50–15.00, 0.01 steps IEC: 0.05–1.00, 0.01 steps
Accuracy:	$\pm 4\%$ plus $\pm 1.5$ cycles for current between 2 and 20 multiples of pickup (within rated range of current)

**100 Percent Stator Ground Protection (64G)**

Neutral Fundamental Overvoltage (64G1):	OFF, 0.1–150.0 V
Steady-State Pickup Accuracy:	$\pm 5\%$ plus $\pm 0.1$ V
Pickup Time:	1.5 cycles (Max)
Definite-Time Delay:	0.00–400.00 s
Accuracy:	$\pm 0.1\%$ plus $\pm 0.25$ cycle

Third-Harmonic Voltage Differential or Third-Harmonic Neutral Undervoltage Pickup 64G2:	0.1–20.0 V
Steady-State Pickup Accuracy:	$\pm 5\%$ plus $\pm 0.1$ V

Third-Harmonic Voltage Differential Ratio Setting Range:	0.0 to 5.0
Pickup Time:	3 cycles (Max)
Definite-Time Delay:	0.00–400.00 s
Accuracy:	$\pm 0.1\%$ plus $\pm 0.25$ cycle

**Field Ground Protection (64F)  
(Requires SEL-2664 Field Ground Module)**

Field Ground Protection Element:	0.5–200.0 kilohms, 0.1 kilohm step
Pickup Accuracy:	$\pm 5\%$ plus $\pm 500$ ohms for $48 < VF < 825$ Vdc $\pm 5\%$ plus $\pm 20$ kilohms for $825 < VF < 1500$ Vdc (VF is the generator field winding excitation dc voltage)
Pickup Time:	2 s if the injection frequency in the SEL-2664 is selected at 1 Hz 8 s if the injection frequency in the SEL-2664 is selected at 0.25 Hz
Definite-Time Delay:	0.0–99.0 s
Maximum Definite-Time Delay Accuracy:	$\pm 0.5\%$ plus $\pm 5$ ms

**Out-of-Step Element (78)**

Forward Reach:	5 A model: 0.1–100.0 ohms 1 A model: 0.5–500.0 ohms
Reverse Reach:	5 A model: 0.1–100.0 ohms 1 A model: 0.5–500.0 ohms

Single Blinder

Right Blinder:	5 A model: 0.1–50.0 ohms 1 A model: 0.5–250.0 ohms
Left Blinder:	5 A model: 0.1–50.0 ohms 1 A model: 0.5–250.0 ohms

Double Blinder

Outer Resistance Blinder:	5 A model: 0.2–100.0 ohms 1 A model: 1.0–500.0 ohms
Inner Resistance Blinder:	5 A model: 0.1–50.0 ohms 1 A model: 0.5–250.0 ohms
Steady-State Impedance Accuracy:	5 A model: $\pm 0.1$ ohm plus $\pm 5\%$ of diameter 1 A model: $\pm 0.5$ ohm plus $\pm 5\%$ of diameter

Pos.-Seq. Current Supervision:	5 A model: 0.25–30.0 A 1 A model: 0.05–6.00 A
--------------------------------	--

Pickup Time:	3 cycles (Max)
Definite Time Delay:	0.00–1.00 s, 0.01 s step
Trip Delay Range:	0.00–1.00 s, 0.01 s step
Trip Duration Range:	0.00–5.00 s, 0.01 s step
Definite-Time Timers:	$\pm 0.1\%$ plus $\pm 1/2$ cycle

**Ground Differential Elements (87N)**

Ground Differential Pickup:	5 A Model: 0.10*CTR/CTRN – 15.00 A 1 A Model: 0.02*CTR/CTRN – 3.00 A (Ratio CTR/CTRN must be within 1.0–40.0)
Steady-State Pickup Accuracy:	5 A Model: $\pm 5\%$ plus $\pm 0.10$ A 1 A Model: $\pm 5\%$ plus $\pm 0.02$ A
Pickup Time:	1.5 cycles (Max)
Time Delay Range:	0.00–5.00 s
Time Delay Accuracy:	$\pm 0.5\%$ plus $\pm 1/4$ cycle

**Negative-Sequence Overcurrent Elements (46)**

Definite-Time and Inverse-Time Neg.-Seq. $I^2$ Pickup:	2%–100% of generator rated secondary current
Generator Rated Secondary Current:	5 A Model: 1.0–10.0 A secondary 1 A Model: 0.2–2.0 A secondary
Steady-State Pickup Accuracy:	5 A Model: $\pm 0.025$ A plus $\pm 3\%$ 1 A Model: $\pm 0.005$ A plus $\pm 3\%$
Pickup Time:	50 ms at 60 Hz (Max)
Definite-Time Delay Setting Range:	0.02–999.90 s
Maximum Definite-Time Delay Accuracy:	$\pm 0.1\%$ plus $\pm 4.2$ ms at 60 Hz
Inverse-Time Element Time Dial:	$K = 1$ to 100 s
Linear Reset Time:	240 s fixed
Inverse-Time Timing Accuracy:	$\pm 4\%$ plus $\pm 50$ ms at 60 Hz for $ I_2 $ above 1.05 multiples of pickup

**Rate-of-Change of Frequency (81R)**

Pickup Setting Range:	Off, 0.10–15.00 Hz/s
Accuracy:	$\pm 100$ mHz/s plus $\pm 3.33\%$ of pickup
Trend Setting:	INC, DEC, ABS
Pickup/Dropout Time:	3–30 cycles, depending on pickup setting
Pickup/ Dropout Delay Range:	0.10–60.00/0.00–60.00 s, 0.1 s increments
Voltage Supervision (Positive Sequence) Pickup Range:	Off, 12.5–300.0 V, 0.1 V increments

**Synchronism Check (25Y) for Tie Breaker**

Synchronism-Check Voltage Source:	VAY, VBY, VCY, VABY, VBCY, VCAY or angle from VAY or VABY
Voltage Window High Setting Range:	0.00–300.00 V
Voltage Window Low Setting Range:	0.00–300.00 V
Steady-State Voltage Accuracy:	$\pm 5\%$ plus $\pm 2.0$ V (over the range of 12.5–300 V)
Maximum Percentage Voltage Difference:	1.0–15.0%
Maximum Slip Frequency:	–0.05 Hz to 0.50 Hz
Steady-State Slip Accuracy:	$\pm 0.02$ Hz
Close Acceptance Angle 1, 2:	0°–80°
Breaker Close Delay:	0.001–1.000 s
Steady-State Angle Accuracy:	$\pm 2^\circ$

**Synchronism Check (25X) for Generator Breaker**

Synchronism-Check Voltage Source:	VAX, VBX, VCX, VABX, VBCX, VCAX or angle from VAX or VABX
Voltage Window High Setting Range:	0.00–300.00 V
Voltage Window Low Setting Range:	0.00–300.00 V
Steady-State Voltage Accuracy:	$\pm 5\%$ plus $\pm 2.0$ V (over the range of 12.5–300 V)
Maximum Percentage Voltage Difference:	1.0–15.0%
Minimum Slip Frequency:	–1.00 Hz to 0.99 Hz
Maximum Slip Frequency:	–0.99 Hz to 1.00 Hz
Steady-State Slip Accuracy:	$\pm 0.02$ Hz
Close Acceptance Angle 1, 2:	0°–80°
Target Close Angle:	–15° to 15°
Breaker Close Delay:	0.001–1.000 s
Close Failure Angle:	3°–120°
Steady-State Angle Accuracy:	$\pm 2^\circ$

**Generator Thermal Model (49T)**

Thermal Overload Trip Pickup Level:	30–250% of full load current (full load current $I_{NOM}$ range: $0.2-2.0 \cdot I_{NOM}$ , where $I_{NOM} = 1$ A or 5 A)
TCU Alarm Pickup Level:	50–99% Thermal Capacity Used
Time-Constant Range (2):	1–1000 minutes
Time Accuracy Pickup/ Dropout Time:	$\pm(5\% + 25$ ms) at multiple-of-pickup $\geq 2$ , 50/60 Hz (pre-load = 0)

**Autosynchronizing****Frequency Matching****Speed (Frequency) Control Outputs:**

Raise:	Digital output, adjustable pulse duration and interval
Lower:	Digital output, adjustable pulse duration and interval

**Frequency Synchronism**

Timer:	5–3600 s, 1 s increments
Frequency Adjustment Rate:	0.01–10.00 Hz/s, 0.01 Hz/s increment
Frequency Pulse Interval:	1–120 s, 1 s increment
Frequency Pulse Minimum:	0.10–60.00 s, 0.01 s increment
Frequency Pulse Maximum:	0.10–60.00 s, 0.01 s increment
Kick Pulse Interval:	1–120 s, 1 s increments
Kick Pulse Minimum:	0.02–2.00 s, 0.01 s increments
Kick Pulse Maximum:	0.02–2.00 s, 0.01 s increments

**Voltage Matching****Voltage Control Outputs:**

Raise:	Digital Output, adjustable pulse duration and interval
Lower:	Digital Output, adjustable pulse duration and interval

**Voltage Synchronized Timer:**

Voltage Synchronized Timer:	5–3600 s, 1 s increments
Voltage Adjustment Rate (Control System):	0.01–30.00 V/s, 0.01 V/s increment
Voltage Pulse Interval:	1–120 s, 1 s increment
Voltage Control Pulse Minimum:	0.10–60.00 s, 0.01 s increment
Voltage Control Pulse Maximum:	0.10–60.00 s, 0.01 s increment
Timing Accuracy:	$\pm 0.5\%$ plus $\pm 1/4$ cycle

**Inadvertent Energization**

Generator De-Energization Setting Range:	0.00–100.00 s, 0.01 s increment
Inadvertent Energization Setting Range:	0.00–10.00 s, 0.01 s increment
Accuracy:	$\pm 0.5\%$ of settings plus $\pm 0.25$ cycle

**Metering Accuracy**

Accuracies are specified at 20°C, nominal frequency, ac currents within  $(0.2-20.0) \cdot I_{NOM}$  A secondary, and ac voltages within 50–250 V secondary unless otherwise noted.

Phase Currents:	$\pm 1\%$ of reading, $\pm 1^\circ$ ( $\pm 2.5^\circ$ at 0.2–0.5 A for relays with $I_{NOM} = 1$ A)
3-Phase Average Current:	$\pm 1\%$ of reading
Differential Quantities:	$\pm 5\%$ of reading plus $\pm 0.1$ A (5 A nominal), $\pm 0.02$ A (1 A nominal)
Current Harmonics:	$\pm 5\%$ of reading plus $\pm 0.1$ A (5 A nominal), $\pm 0.02$ A (1 A nominal)
IG (Residual Current):	$\pm 2\%$ of reading, $\pm 2^\circ$ ( $\pm 5.0^\circ$ at 0.2–0.5 A for relays with $I_{NOM} = 1$ A)
IN (Neutral Current):	$\pm 1\%$ of reading, $\pm 1^\circ$ ( $\pm 2.5^\circ$ at 0.2–0.5 A for relays with $I_{NOM} = 1$ A)
3I2 Negative-Sequence Current:	$\pm 2\%$ of reading

System Frequency:	$\pm 0.01$ Hz of reading for frequencies within 20–70 Hz ( $V_1 > 60$ V)
Line-to-Line Voltages:	$\pm 1\%$ of reading, $\pm 1^\circ$ for voltages within 24–264 V
3-Phase Average Line-to-Line Voltage:	$\pm 1\%$ of reading for voltages within 24–264 V
Line-to-Ground Voltages:	$\pm 1\%$ of reading, $\pm 1^\circ$ for voltages within 24–264 V
3-Phase Average Line-to-Ground Voltages:	$\pm 1\%$ of reading for voltages within 24–264 V
Voltage Harmonics:	$\pm 5\%$ of reading plus $\pm 0.5$ V
3V2 Negative-Sequence Voltage:	$\pm 2\%$ of reading for voltages within 24–264 V
Real 3-Phase Power (kW):	$\pm 3\%$ of reading for $0.10 < \text{pf} < 1.00$
Reactive 3-Phase Power (kVAR):	$\pm 3\%$ of reading for $0.00 < \text{pf} < 0.90$
Apparent 3-Phase Power (kVA):	$\pm 3\%$ of reading
Power Factor:	$\pm 2\%$ of reading
RTD Temperatures:	$\pm 2^\circ\text{C}$

## Synchrophasor Accuracy

### Maximum Message Rate

Nominal 60 Hz System:	60 messages per second
Nominal 50 Hz System:	50 messages per second

### Accuracy for Voltages

Level 1 compliant as specified in IEEE C37.118 under the following conditions for the specified range.

#### Conditions

- At maximum message rate
- When phasor has the same frequency as the positive-sequence tracking quantity (see *Table K.10*)
- Frequency-based phasor compensation is enabled (PHCOMP := Y)
- The narrow bandwidth filter is selected (PMAPP := N)

#### Range

Frequency:	$\pm 5.0$ Hz of nominal (50 or 60 Hz)
Magnitude:	30 V–250 V
Phase Angle:	$-179.99^\circ$ to $180^\circ$
Out-of-Band Interfering Frequency (Fs):	$10 \text{ Hz} \leq F_s \leq (2 \cdot \text{FNOM})$

### Accuracy for Currents

Level 1 compliant as specified in IEEE C37.118 under the following conditions for the specified range.

#### Conditions

- At maximum message rate
- When phasor has the same frequency as the positive-sequence tracking quantity (see *Table K.10*)
- Frequency-based phasor compensation is enabled (PHCOMP := Y)
- The narrow bandwidth filter is selected (PMAPP := N)

#### Range

Frequency:	$\pm 5.0$ Hz of nominal (50 or 60 Hz)
Magnitude:	$(0.4-2) \cdot I_{\text{NOM}}$ ( $I_{\text{NOM}} = 1 \text{ A or } 5 \text{ A}$ )
Phase Angle:	$-179.99^\circ$ to $180^\circ$
Out-of-Band Interfering Frequency (Fs):	$10 \text{ Hz} \leq F_s \leq (2 \cdot \text{FNOM})$

- <sup>a</sup> Front port serial cable (non-fiber) lengths assumed to be  $< 3$  m.  
<sup>b</sup> RTD cable lengths assumed to be  $< 10$  m.

# Technical Support

---

We appreciate your interest in SEL products and services. If you have questions or comments, please contact us at:

Schweitzer Engineering Laboratories, Inc.

2350 NE Hopkins Court

Pullman, WA 99163-5603 U.S.A.

Tel: +1.509.338.3838

Fax: +1.509.332.7990

Internet: [selinc.com/support](http://selinc.com/support)

Email: [info@selinc.com](mailto:info@selinc.com)

---

© 2010-2025 by Schweitzer Engineering Laboratories, Inc. All rights reserved.

All brand or product names appearing in this document are the trademark or registered trademark of their respective holders. No SEL trademarks may be used without written permission. SEL products appearing in this document may be covered by U.S. and Foreign patents.

Schweitzer Engineering Laboratories, Inc. reserves all rights and benefits afforded under federal and international copyright and patent laws in its products, including without limitation software, firmware, and documentation.

The information in this document is provided for informational use only and is subject to change without notice. Schweitzer Engineering Laboratories, Inc. has approved only the English language document.

This product is covered by the standard SEL 10-year warranty. For warranty details, visit [selinc.com](http://selinc.com) or contact your customer service representative.

**SCHWEITZER ENGINEERING LABORATORIES, INC.**

2350 NE Hopkins Court • Pullman, WA 99163-5603 U.S.A.

Tel: +1.509.332.1890 • Fax: +1.509.332.7990

[selinc.com](http://selinc.com) • [info@selinc.com](mailto:info@selinc.com)

